



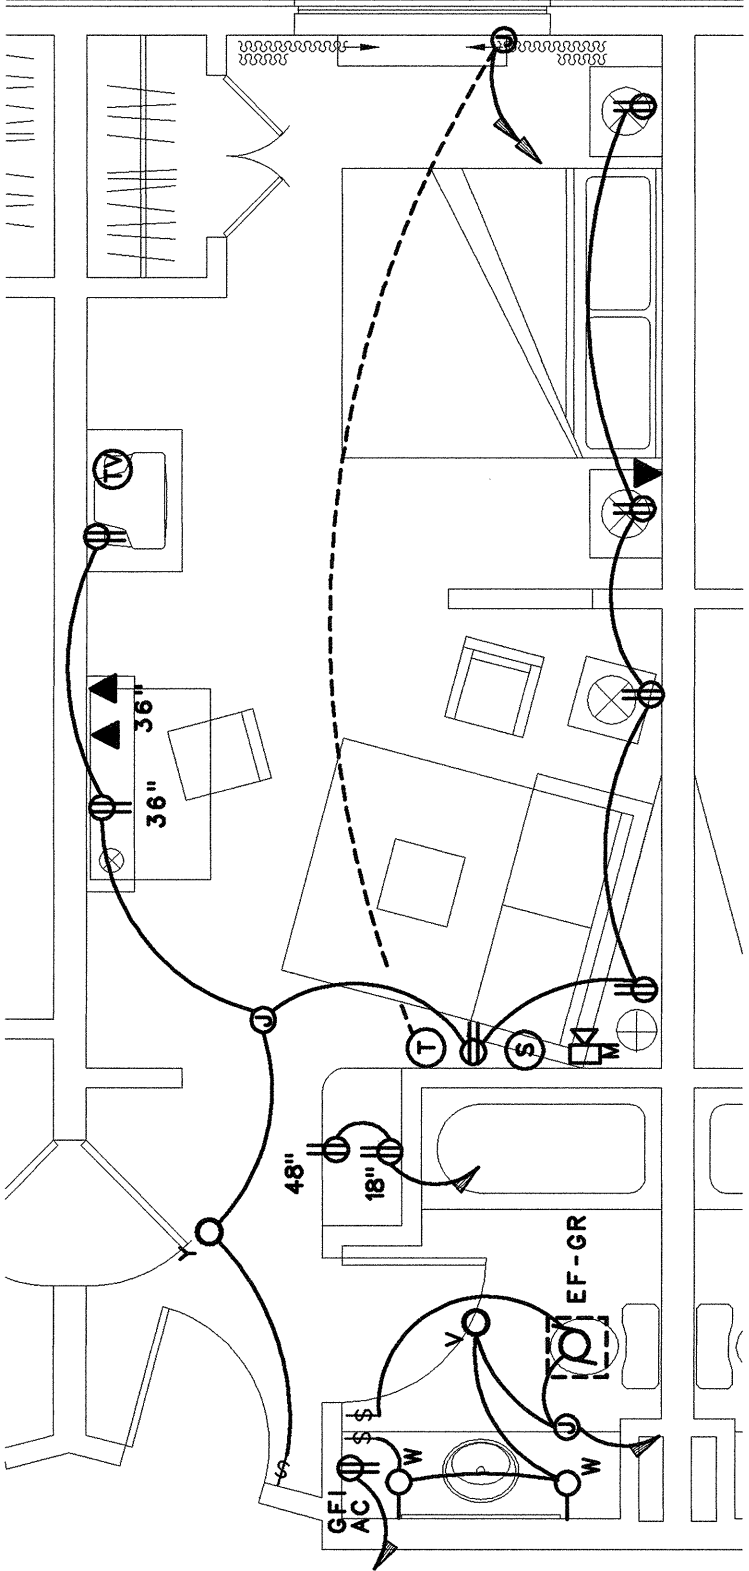


TYPICAL KING SUITE

SCALE: 1/4" = 1'-0"

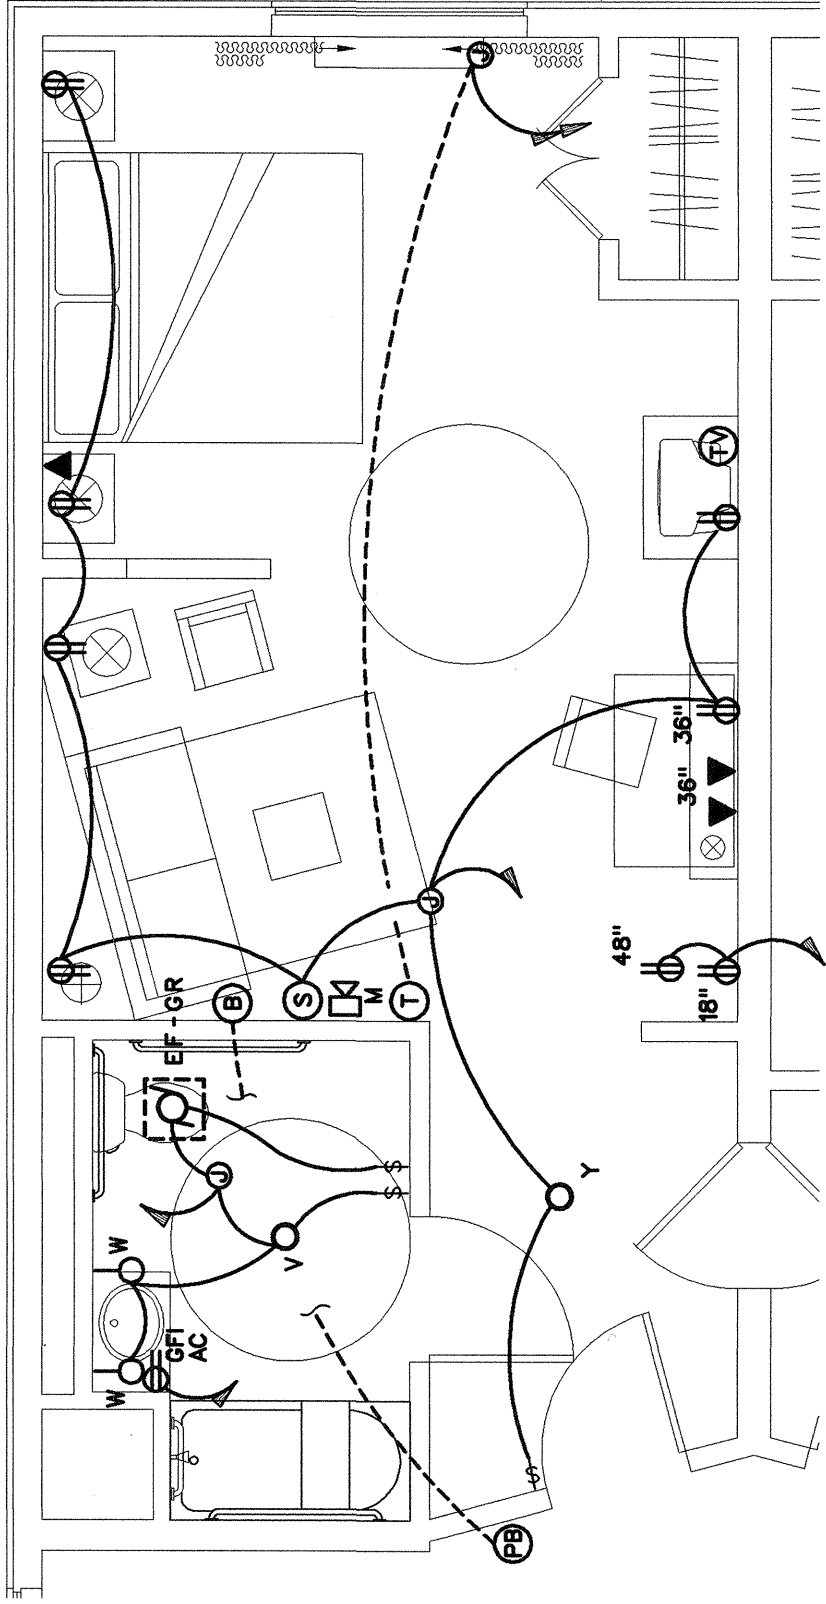


KING SUITE

SCALE: 1/4" = 1'-0"

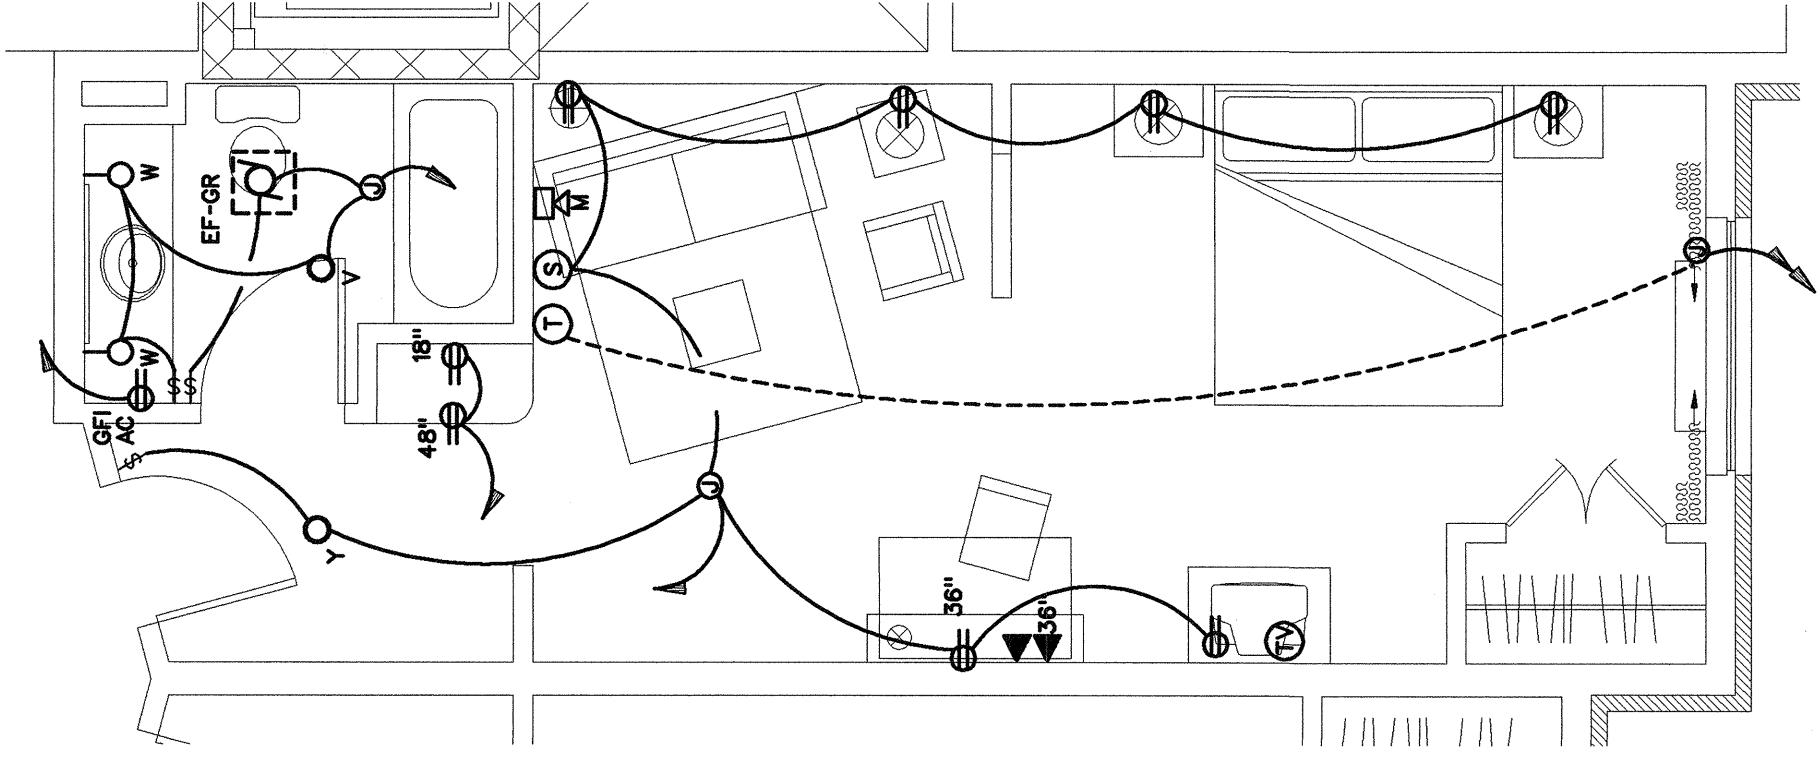


EXTENDED KING SUITE

SCALE: 1/4" = 1'-0"

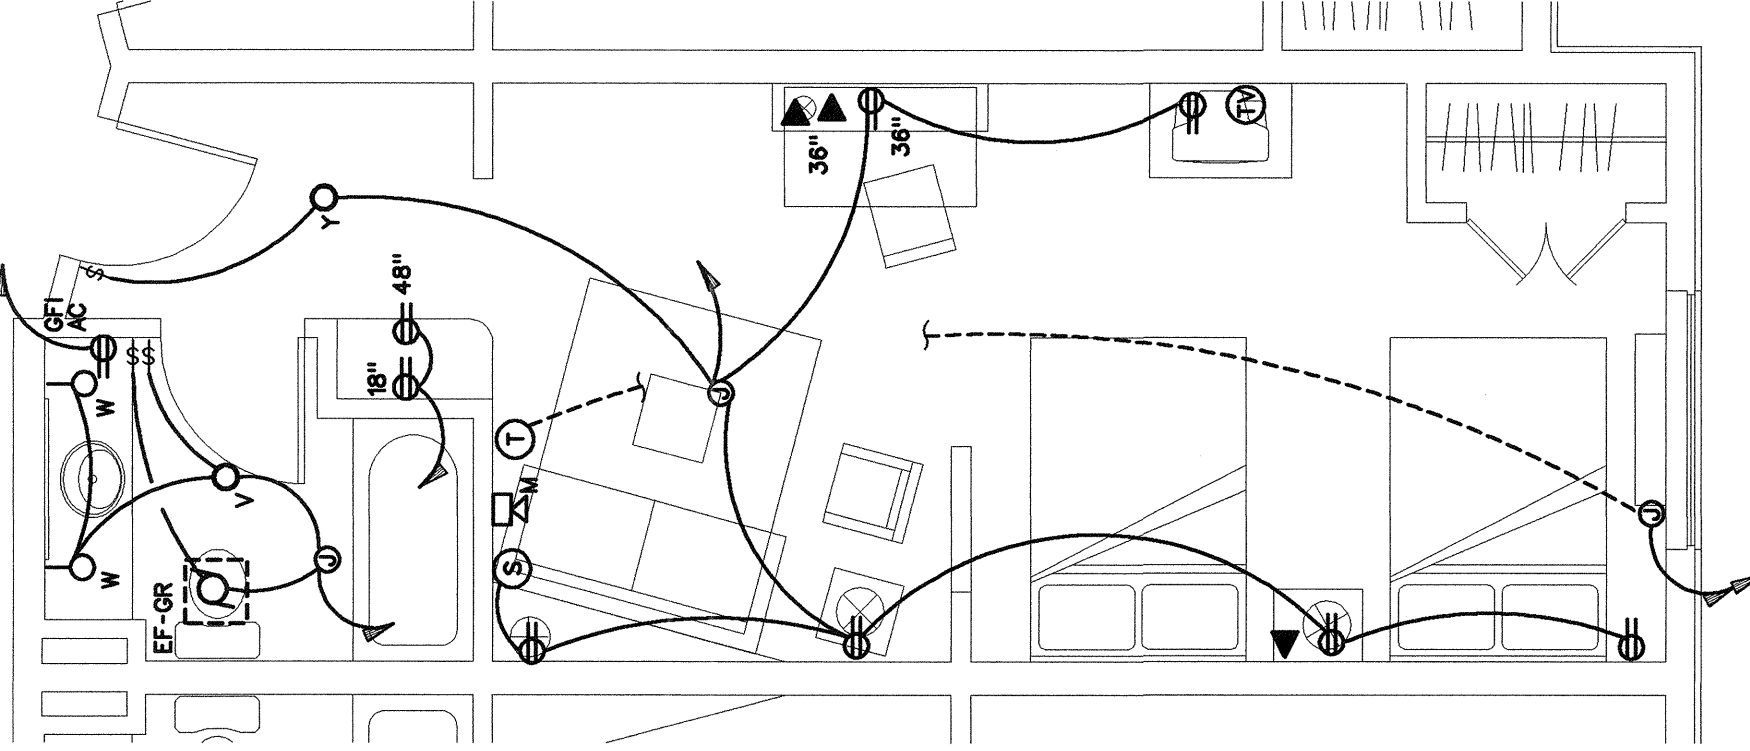


TYP. DOUBLE QUEEN SUITE

SCALE: 1/4" = 1'-0"

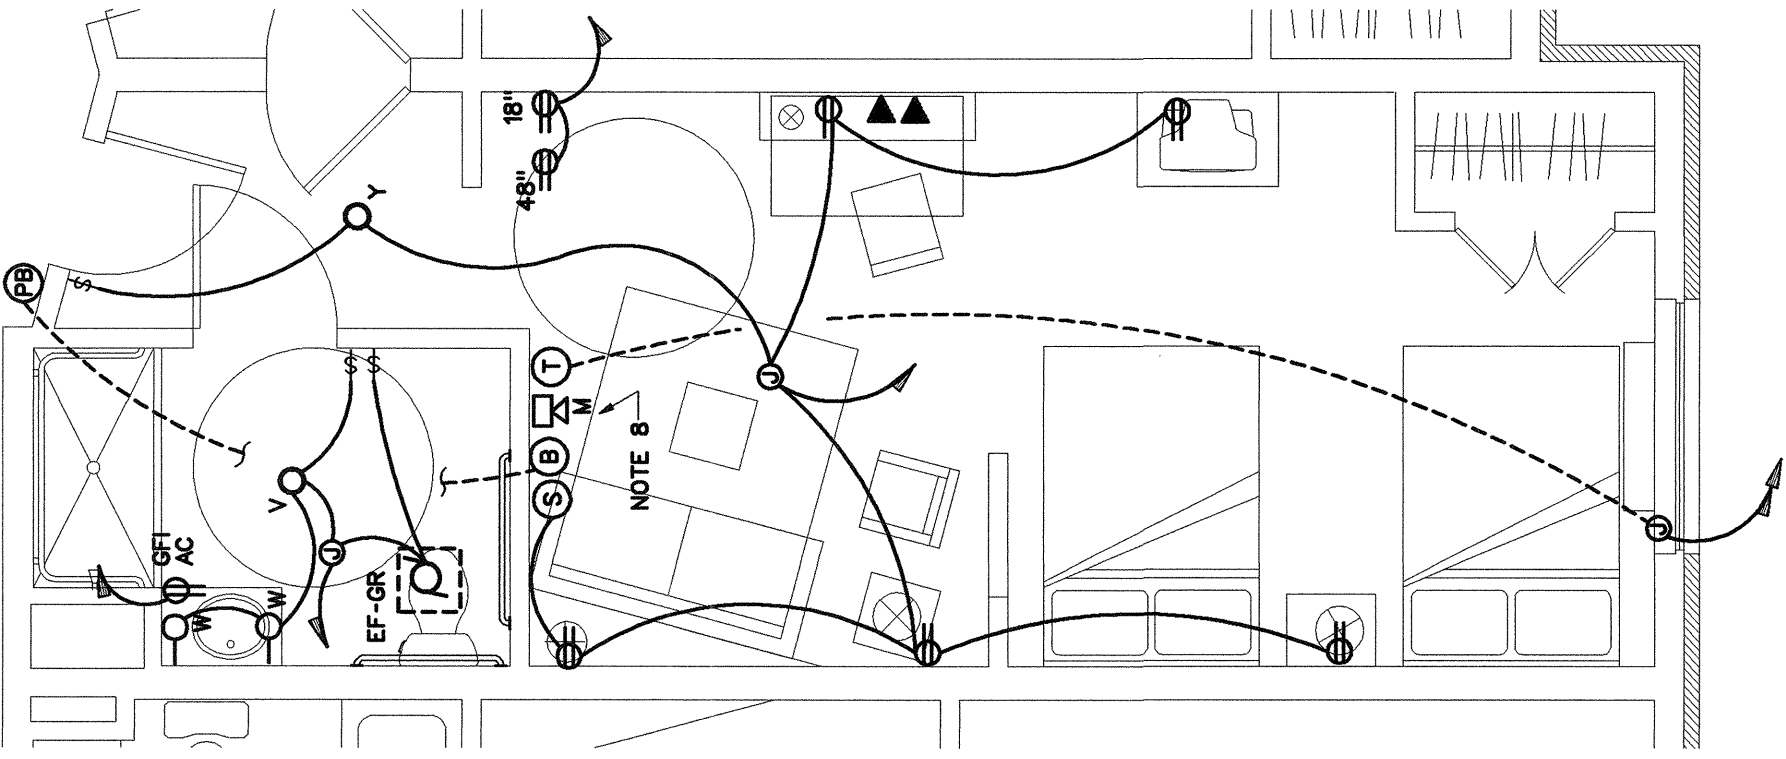


DOUBLE QUEEN SUITE

SCALE: 1/4" = 1'-0"

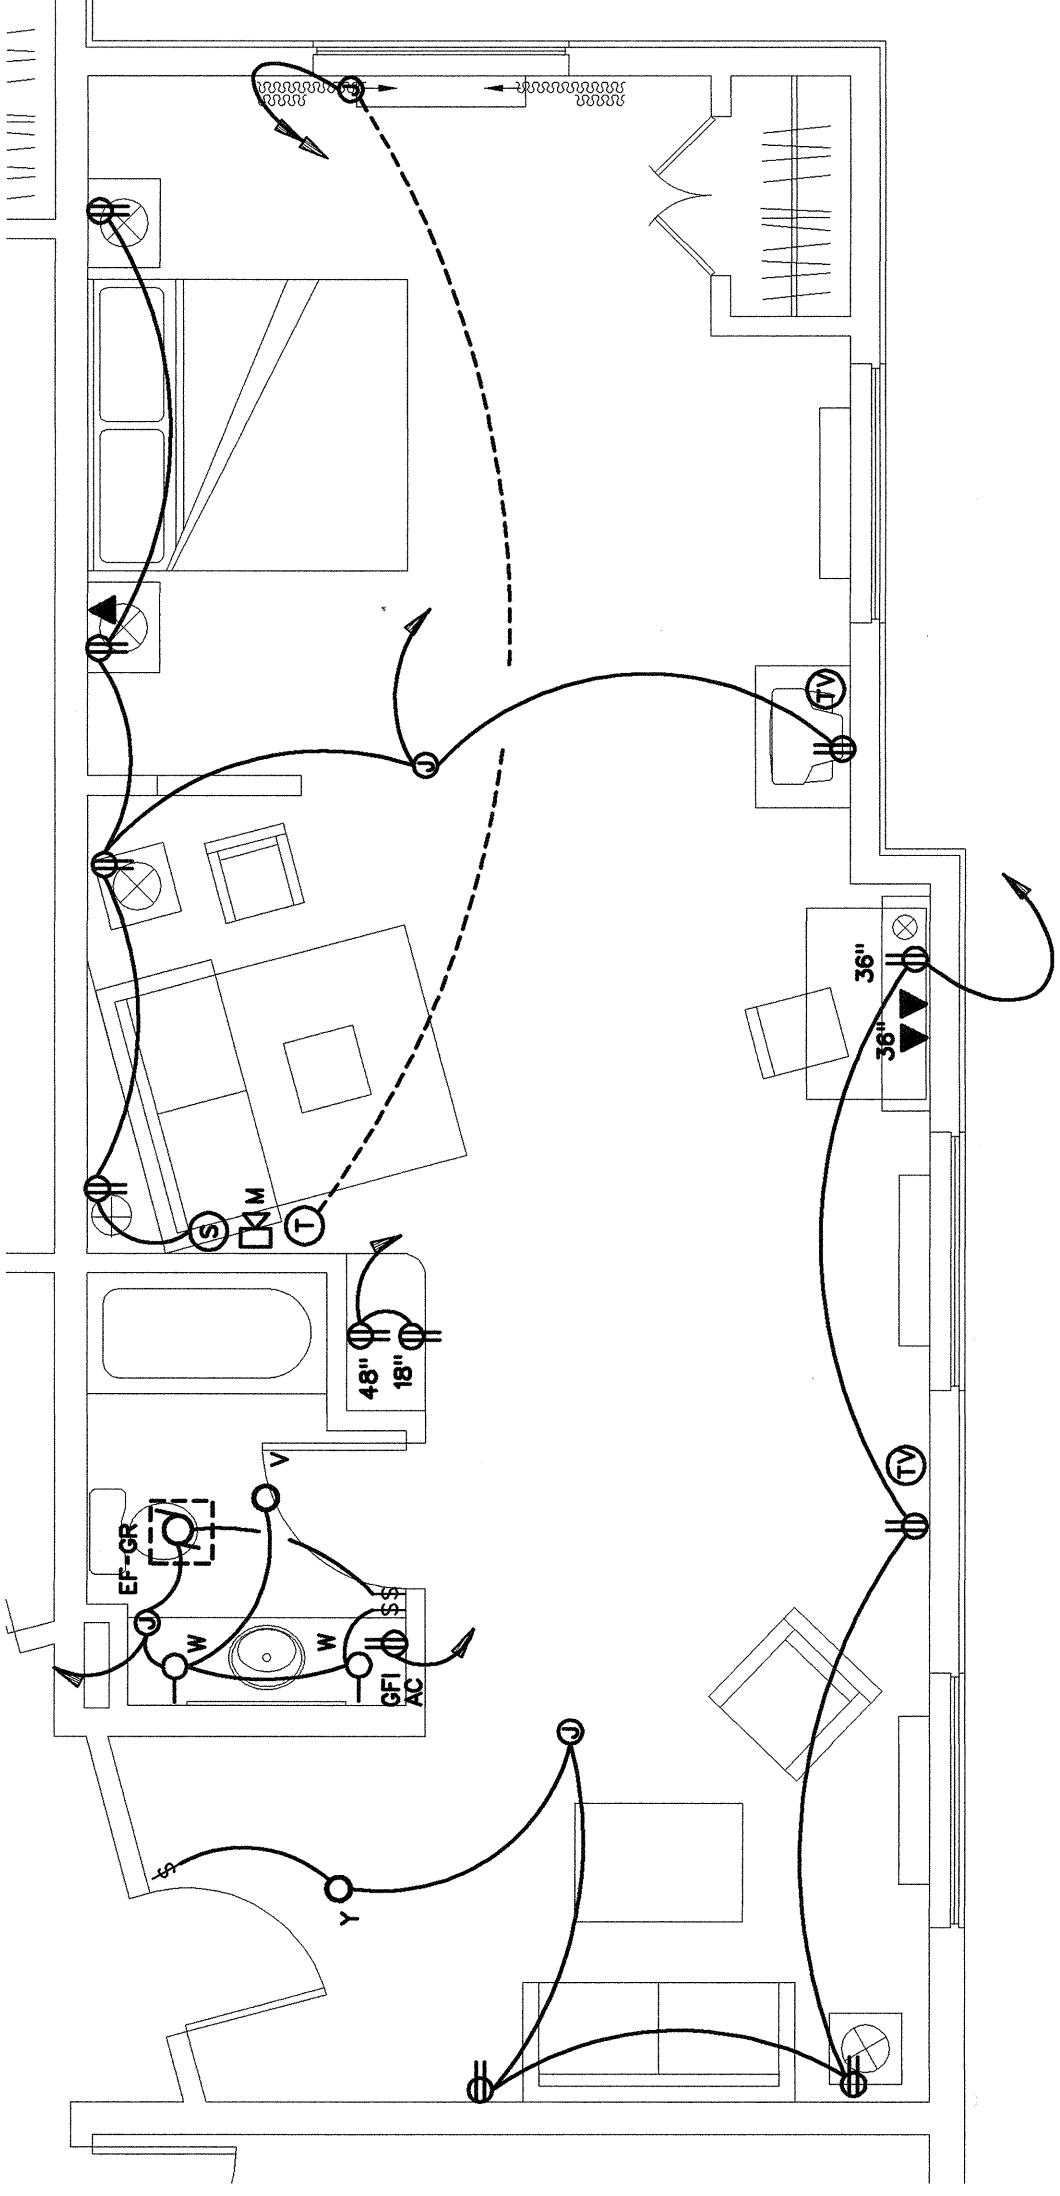


TYPE "A" KING SUITE

SCALE: 1/4" = 1'-0"

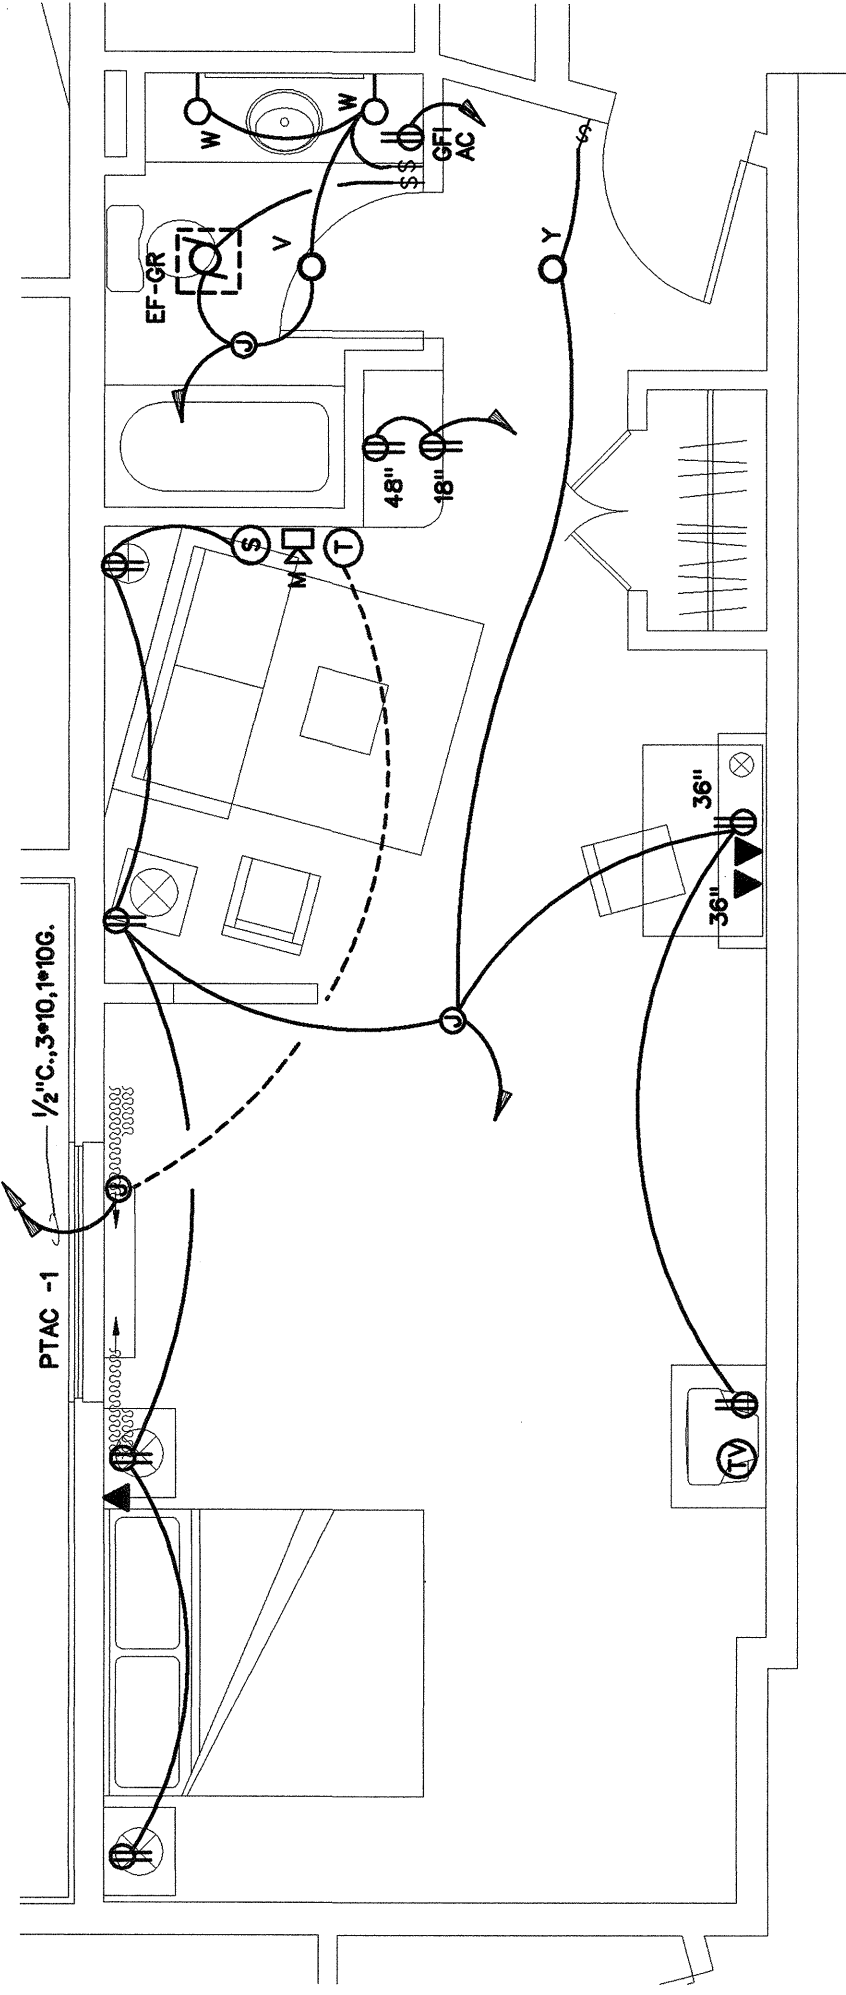

TYPE "B" KING SUITE

SCALE: 1/4" = 1'-0"

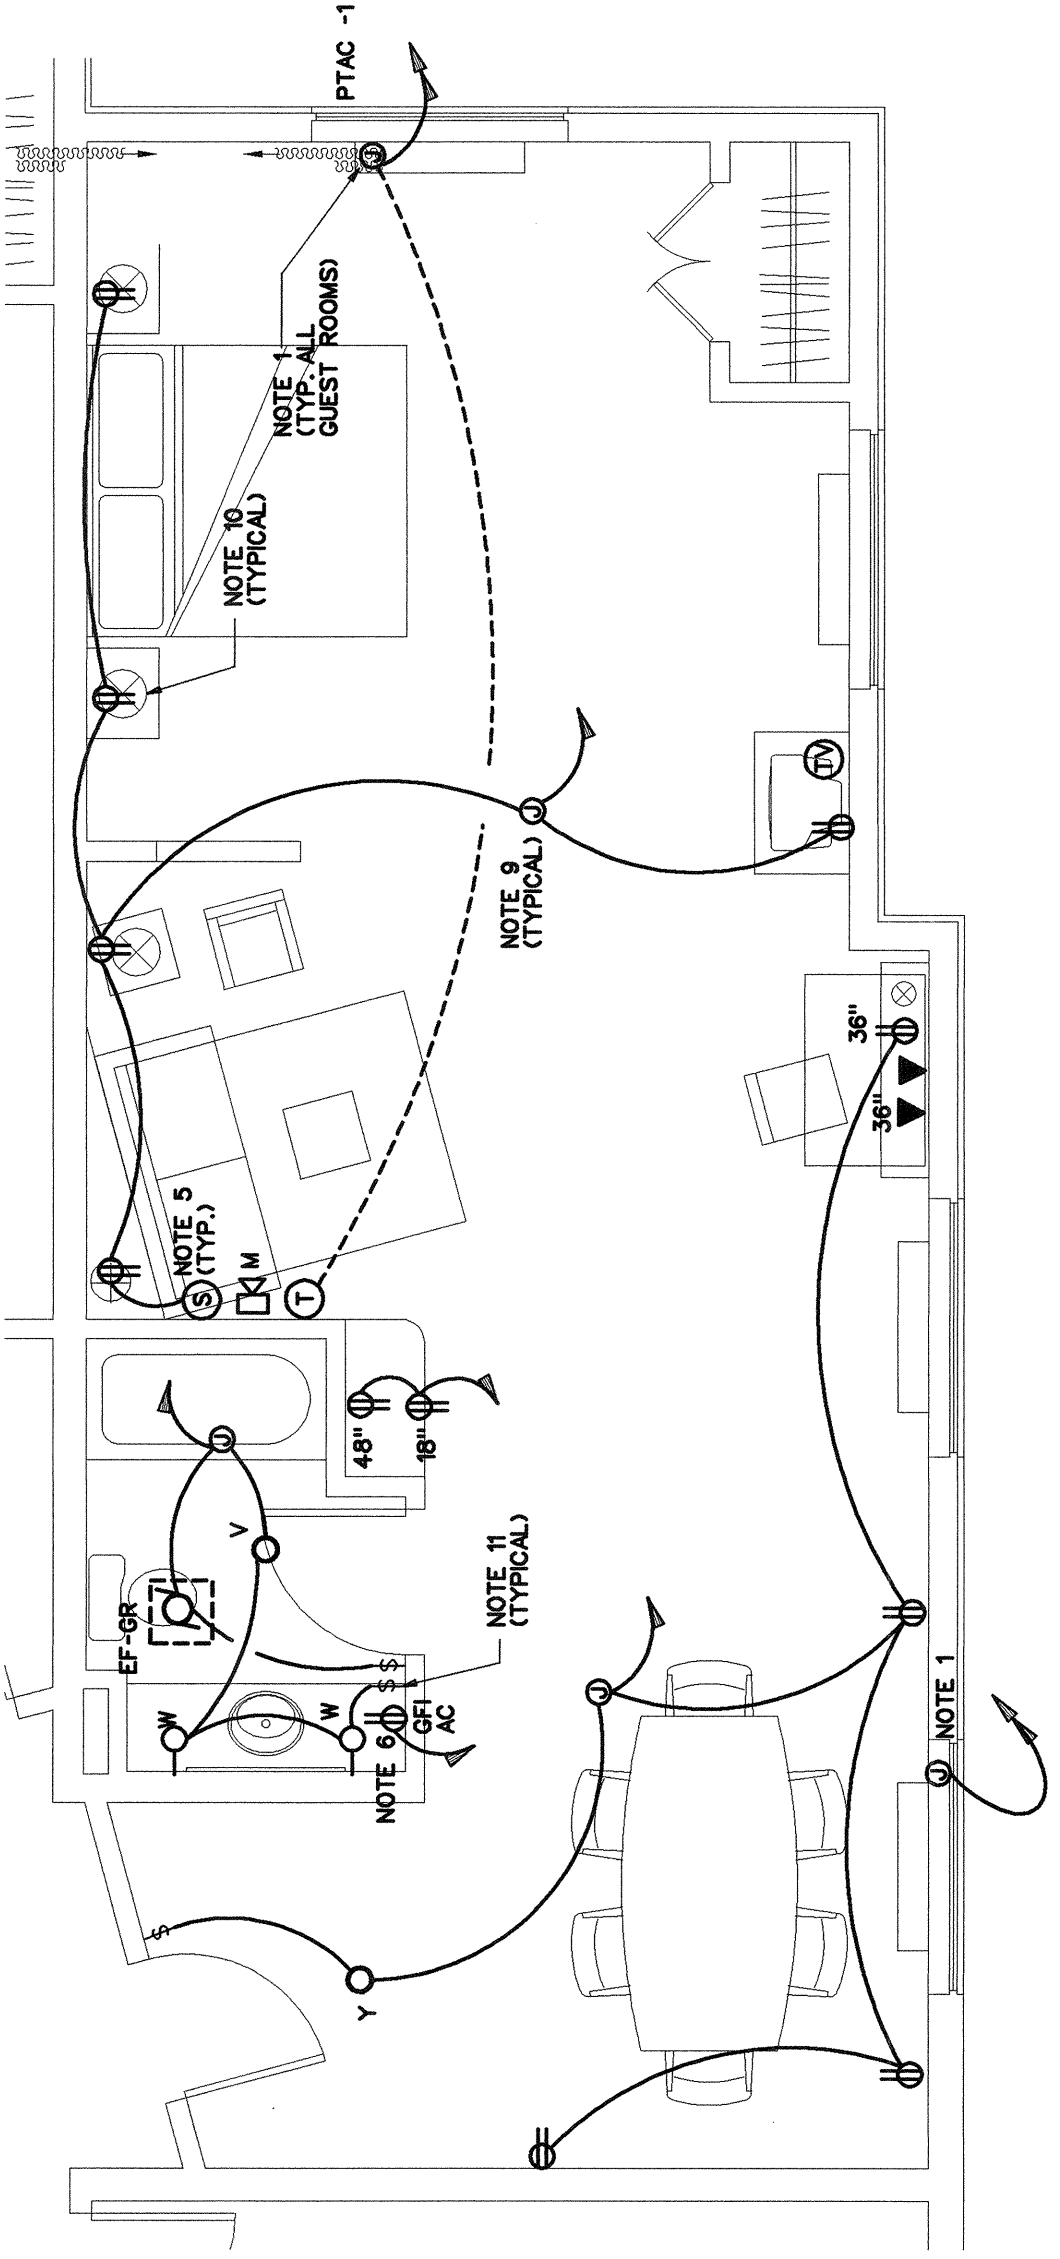


KING SUITE / BOARD ROOM #216

SCALE: 1/4" = 1'-0"

NOTES:


1. THRU-WALL-UNIT CIRCUIT 208V/2P CIRCUIT TO ELECTRICAL SUB BASE PROVIDE DISCONNECT FINAL CONNECTIONS TO PTAC.
2. ALL SWITCHES SHALL BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND THE MANUFACTURER'S INSTRUCTIONS.
3. ALL TELEPHONE DATA OUTLETS SHALL BE INSTALLED IN ACCORDANCE WITH THE NATIONAL ELECTRICAL CODE (NEC) AND THE MANUFACTURER'S INSTRUCTIONS.
4. ALL DUPLEX RECEPTACLES IN SIDE GUESTROOM SHALL BE 120V/1P, UNLESS NOTED OTHERWISE.
5. 120 VOLT GUESTROOM SMOKE DETECTOR SHALL BE MOUNTED 12" DOWN FROM THE CEILING TO THE TOP OF THE SMOKE DETECTOR.
6. GFI RECEPTACLES IN THE BATHROOM SHALL BE 120V/1P.
7. PROVIDE VISUAL SMOKE ALARMS IN ALL HANDICAPPED AND HEARING IMPAIRED ROOMS. PROVIDE VISUAL SMOKE ALARMS IN ALL HANDICAPPED AND HEARING IMPAIRED ROOMS. PROVIDE VISUAL SMOKE ALARMS IN ALL HANDICAPPED AND HEARING IMPAIRED ROOMS.
8. PROVIDE VISUAL SMOKE ALARMS IN ALL HANDICAPPED AND HEARING IMPAIRED ROOMS. PROVIDE VISUAL SMOKE ALARMS IN ALL HANDICAPPED AND HEARING IMPAIRED ROOMS.
9. ALL HOME-RUNS OVER 100 FT. IN LENGTH SHALL BE "KIDING".
10. STAGGER BOXES AND STUD WALLS 24" BETWEEN ADJACENT ROOMS.
11. ALL SWITCHES IN GUESTROOMS SHALL BE ILLUMINATED TOGGLE SWITCH.
12. ALL RECEPTACLES AND DATA OUTLETS IN GUEST ROOMS SHALL BE COORDINATED WITH OWNER PRIOR TO ROUGH-IN.

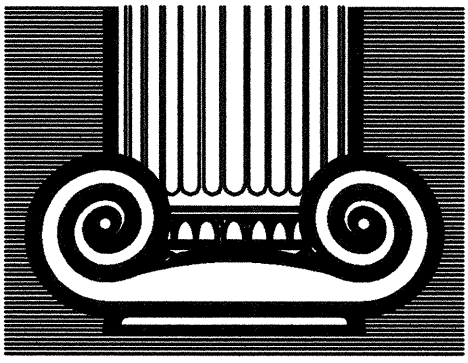

DRAWN:
APPROVED:

DATE COMMENTS
REVISIONS
JOB# 7293-1107
DATE 12-14-07

FLOWOOD, MS

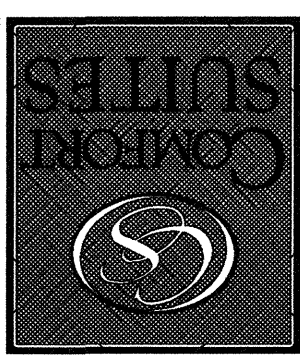

70 UNITS