


LIGHTING SCHEDULE--REFER TO LIGHTING MATRIX PROJECT MANUAL SECTION 16500 FOR MODEL NUMBERS			
PLAN MARK	LOCATION	DESCRIPTION	MOUNTING
D38	LOBBY	SCONCE - WHITE	WALL
D40	BREAKFAST COUNTER / BUSINESS LIBRARY	PENDANT - WHITE	SURFACE - CEILING
D44	GUESTROOM BATH	50" PAINTED VANITY	WALL
DLP	GUESTROOM ENTRY AND BATH	SEE SPECIFICATION BELOW	RECESSED - CEILING
F05	MIG. ROOM / GUEST LAUNDRY / EXERCISE	2x2 PARABOLIC	RECESSED - CEILING
F19	GUESTROOM PANTRY	STRIP - UNDERMOUNT	SURFACE
R26	GUESTROOM	MINI WASHER WITH FILTERS	RECESSED - SOFFIT
R26a	GUESTROOM BED LIGHT DIMMER SWITCH	DIMMER SWITCH (SLIDE)	WALL
R19	SUITE GUESTROOM / LOBBY MILLWORK	POLISHED BRASS FOR MILLWORK	MILLWORK
X01	EXIT	EXIT - SINGLE SIDED	WALL OR CEILING
X03	EMERGENCY STROBE, EGRESS LIGHT	EMERGENCY BATTERY	WALL OR CEILING

FIXTURE DLP SHALL BE LIGHTOLIER LOW PROFILE RECESSED CAN FIXTURE, FRAME-IN KIT MODEL 110271 WITH 1113TCL TRIM,
(2) 13W TWIN TUBE COMPACT FLUORESCENT LAMPS

ELECTRICAL GENERAL NOTES

- CONTRACTOR SHALL COMPLY WITH ALL REQUIREMENTS OF THE NATIONAL ELECTRICAL CODE, AND ALL STATE AND LOCAL CODES.
- ELECTRICAL RECEPTACLES WITHIN 6'-0" OF SINKS OR WATER OR ALL WITHIN BATHROOMS SHALL BE GFI TYPE.
- ALL RECEPTACLES SHALL BE 16" AFF UNLESS NOTED OTHERWISE.

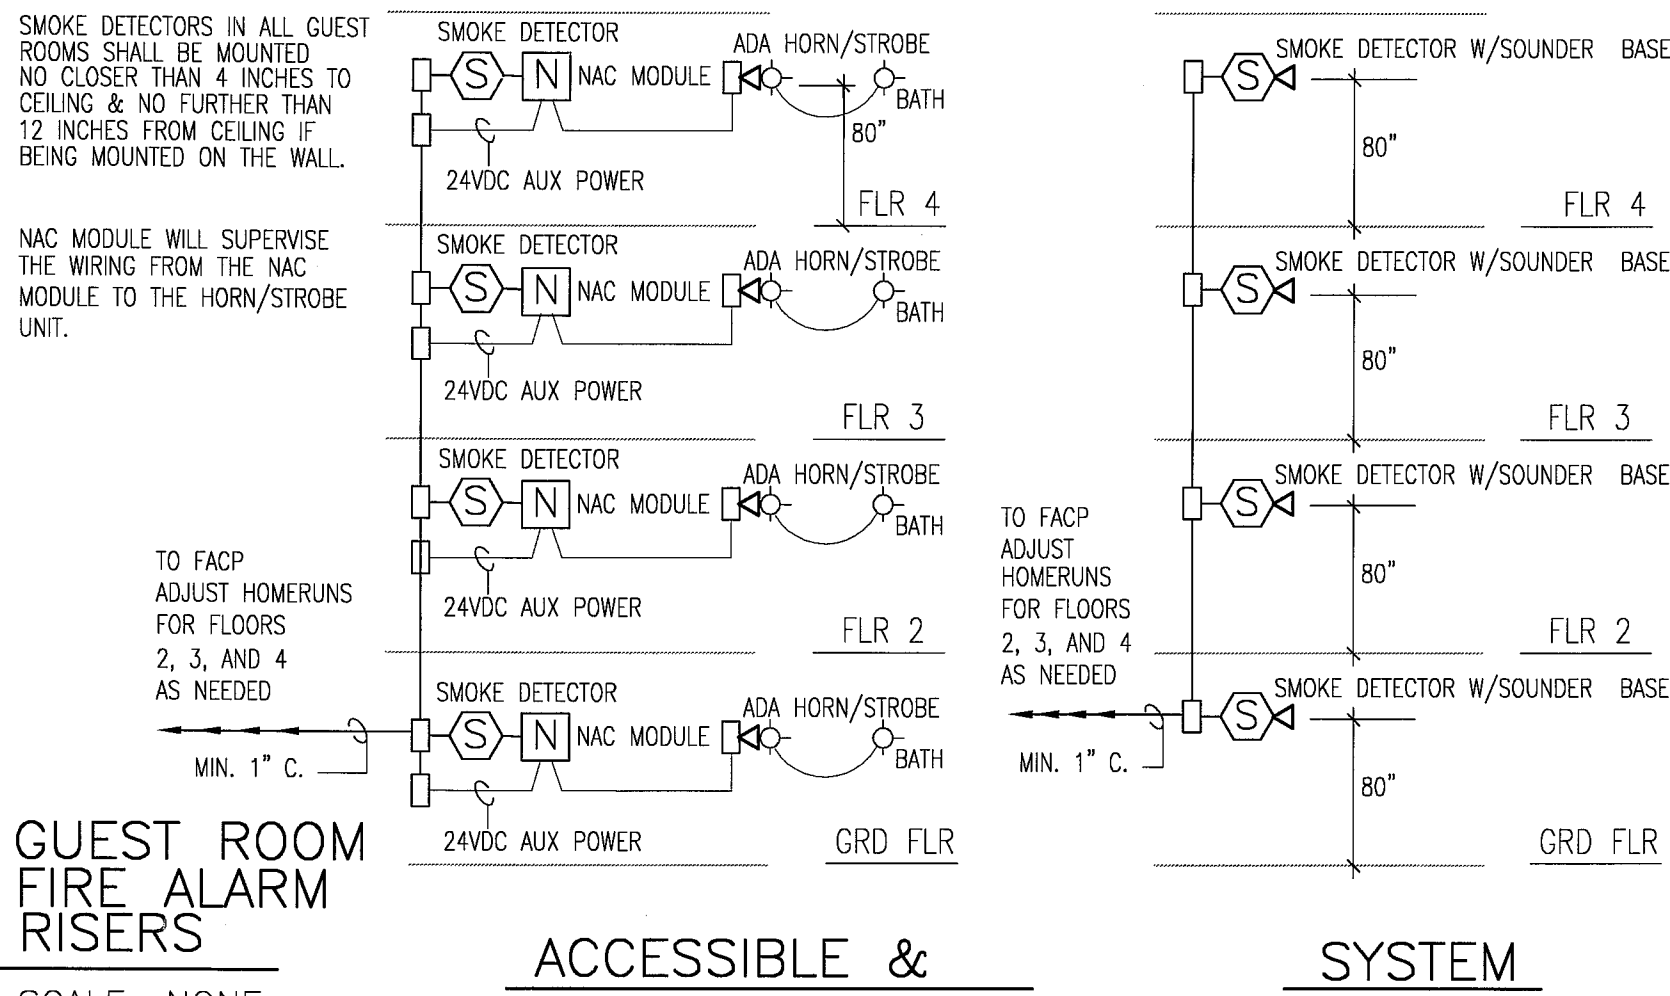

ALL STANDARD ROOMS SHALL BE PROVIDED WITH SMOKE DETECTOR WITH SOUNDER BASE CONNECTED TO MAIN FACP BOARD. HORN SHALL SOUND WHEN SMOKE DETECTOR ACTIVATES & ON GENERAL ALARM.

ALL ACCESSIBLE ROOMS SHALL BE PROVIDED WITH STANDARD SMOKE DETECTOR WITH STANDARD BASE & ADA APPROVED HORN/STROBE TO MATCH UNITS PROVIDED THROUGHOUT FACILITY. PROVIDE & CONNECT HORN/STROBE TO NAC MODULE SO HORN/STROBE ACTIVATES ON GENERAL ALARM AS WELL AS WHEN ROOM SMOKE ACTIVATES.

CONTRACTOR SHALL PROVIDE A COMPLETE, OPERATIONAL FIRE ALARM SYSTEM IN ACCORDANCE WITH ALL CODE AND MANUFACTURING REQUIREMENTS, INCLUDING DEVICES REQUIRED BY LOCAL CODE BUT NOT INDICATED HEREIN. SYSTEM SHALL INCLUDE ALL CONNECTIONS TO FLOW AND TAMPER SWITCHES AS WELL AS P.I.V. AND DUCT SMOKE DETECTORS FOR MECHANICAL UNITS.

ELECTRICAL SYMBOLS

	FLUORESCENT UNDERCOUNTER F19
	RECESSED FLUORESCENT LIGHT FIXTURE F05
	FLUORESCENT WALL MOUNT VANITY D44
	FLUORESCENT RECESSED DLP/R26
	WALL SCONCE D38
	RECESSED ADJUSTABLE DOWN LIGHT FIXTURE R17
	PENDANT LIGHT D40
	DIRECTIONAL EXIT LIGHT
	EMERGENCY LIGHT X03
	JUNCTION BOX
	RECEPTACLE, DUPLEX
	RECEPTACLE, DBL DUPLEX
	FLOOR RECEPTACLE, DUPLEX
	SWITCH, SINGLE POLE
	SWITCH, DIMMER
	EXHAUST FAN
	SWITCH, THREE WAY
	TELEVISION OUTLET
	COMBINATION VOICE/HSIA OUTLET
	VOICE OUTLET
	EXISTING GUESTROOM MINIHORN/STROBE
	FIRE ALARM CONTROL PANEL
	FIRE ALARM REMOTE ANNUNCIATOR
	EXISTING 120V SINGLE STATION SMOKE DETECTOR
	GUESTROOM SYSTEM SMOKE DETECTOR WITH SOUNDER BASE
	SMOKE DETECTOR
	HEAT DETECTOR
	CARBON MONOXIDE DETECTOR
	COMBINATION HORN/STROBE
	FIRE ALARM STROBE
	FIRE ALARM PULL STATION
	CARD READER
	HOMERUN TO ELEC PANEL

REVISED PANEL SCHEDULE						
PANEL NAME	CIRCUIT NUMBER	BREAKER SIZE	BREAKER QTY	LOAD DESCRIPTION	LOAD VA	
L1	1-31 ODD	20/1	16	GUESTROOM CKTS	15,504	
120/208V	2-40	20/1	20	GUESTROOM CKTS	-	
3 PH 4W	44-54	20/1	6	GUESTROOM CKTS	-	
225 A MLO	53,62,63,64	20/1	4	RECEPTACLES	5,000	
	22,24,26,55,56,58,59,60,61	20/1	6	LIGHTING	6,550	
	33,35,37	20/1	3	LIGHTING	3,600	
	43-51 ODD	20/1	9	SPARE	5,400	
	39,41, 42	20/1	3	RECEPTACLES	3,600	
				TOTAL	39,654	
				AMPS	110	

REVISED PANEL SCHEDULE						
PANEL NAME	CIRCUIT NUMBER	BREAKER SIZE	BREAKER QTY	LOAD DESCRIPTION	LOAD VA	
L2	1-40, 43-62	20/1	60	GUESTROOM CKTS	22,746	
120/208V	63-66	20/1	4	CORRIDOR CKTS	3,793	
3 PH 4W	67-70	40/2	2	CORRIDOR HVAC	11,648	
225 A MLO	71-81 ODD	20/1	6	M/W	4,896	
	72-80 EVEN	20/1	5	SPARE	4,080	
	82-84	20/1	2	SPARE	1,800	
	41, 42		2	SPARE		
				TOTAL	48,963	
				AMPS	136	

REVISED PANEL SCHEDULE						
PANEL NAME	CIRCUIT NUMBER	BREAKER SIZE	BREAKER QTY	LOAD DESCRIPTION	LOAD VA	
L3	1-40, 43-62	20/1	60	GUESTROOM CKTS	22,746	
120/208V	63-66	20/1	4	CORRIDOR CKTS	3,793	
3 PH 4W	67-70	40/2	2	CORRIDOR HVAC	11,648	
225 A MLO	71-81 ODD	20/1	6	M/W	4,896	
	72-80 EVEN	20/1	5	SPARE	4,080	
	82-84	20/1	2	SPARE	1,800	
	41, 42		2	SPARE		
				TOTAL	48,963	
				AMPS	136	




▲ revisions:

▲ seal:



▲ title:
SCHEDULES
AND DETAILS

▲ date: 10-08-04
▲ Job: 1504
▲ file:
▲ scale: as noted
▲ drawn by: chs

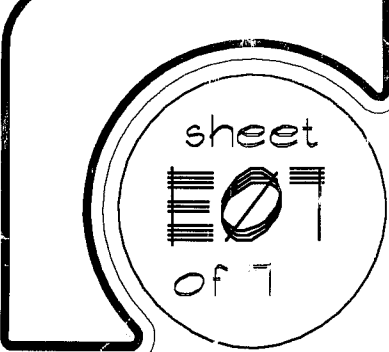

COPYRIGHT BY LLW ARCHITECTS, INC. WARNING: UNAUTHORIZED COPYING VIOLATES U.S. COPYRIGHT LAWS AND WILL SUBJECT THE VIOLATOR TO LEGAL PROSECUTION