



6800 S Creek Rd, Charlotte, NC 28277
Ph: (704) 625-6554 Fax: (704) 919-5822
EMAIL: ashish@mishraarch.com
WEB: www.mishraarch.com

Civil:
David Lane Beard & Associates, Inc.
105 Commercial Parkway
West Monroe, LA 71294
Phone: (318) 388-3227
Email:fgadberry@dbengineering.com


STRUCTURAL:
WGPM, Inc.
11220 Elm Lane, Suite 201
Charlotte, NC 28277
Phone: (704) 542-7199
Fax: (704) 542-7195
Email: lwright@wgpminc.com

ELECTRICAL:
R. Shane Ritter, PE
1043 Arroyo Vista Lane
Matthew, NC 28014
Phone: (704) 516-0385
Email: shane@rittereng.com
Project Number: 12015

Shultz Engineering Group, P.C.
212 North McDowell St., Suite 204
Charlotte, NC 28204
Phone: (704) 334-7363
Fax: (704) 347-0093
Email: don@shultzeg.com

[illegible]

Information contained on this drawing and in all digital files associated is authorized for use on the project named herein only and is the property of MISHKA ARCHITECTURE PLLC and may not be reproduced in any manner without express written or verbal permission from authorized individuals. Original drawing is 24"x36" and scales are as indicated. © 2011 MISHKA ARCHITECTURE PLLC

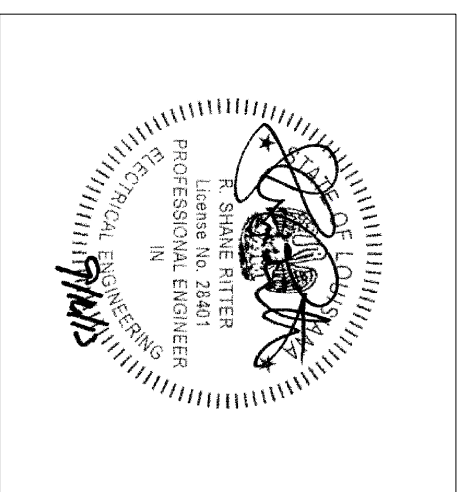

**Southern Hospitality
Services**

Hampton Inn and Suites

5400 I-20 & Frontage Rd.
Monroe, LA 71201

Second Floor Power & Communication Plan

Phase
Construction Documents

Project No.	12-111	Sheet No.
Prepared by	RSR	E2.2
Checked by	RSR	
Date	Sept. 16, 2013	

Released for
PERMIT ONLY

PLAN KEY NOTES:

- ① CIRCUITS SHOWN IN BLOCKS TO BE USED TO DEFINE CIRCUITS USED FOR EACH ROOM AS SHOWN IN TYPICAL ROOM LAYOUTS SHOWN ON E3.1 AND E3.2 (TYPICAL).
- ② TWO (2) 4'X8'X3/4" PAINTED BACKBOARD FOR TELECOM AND CATV (SEE COMMUNICATION RISER DIAGRAM).

GENERAL NOTES:

1. ELECTRICAL LAYOUT AND MATERIALS FOR ALL DEVICES AND FIXTURES TO BE IN COMPLIANCE WITH FRANCHISE STANDARDS AND GUIDELINES, WHICH TAKE PRECEDENCE OVER THESE ENGINEERING DRAWINGS.
2. FRANCHISE DESIGN GUIDELINES, STANDARDS, SPECIFICATIONS, AND MATERIALS TO BE PROVIDED ON-LINE OR FROM THE ARCHITECT FOR THE CONTRACTORS USE.
3. ALL BREAKERS FEEDING 120V 20A CIRCUITS IN ALL GUESTROOMS, DWELLING SPACES, AND APARTMENTS SHALL BE ARC FAULT TYPE BREAKERS.

SECOND FLOOR POWER & COMMUNICATION PLAN

SCALE: 1/8" = 1'

