



E6.4 SCALE: NO SCALE

SCALE: NO SCALE

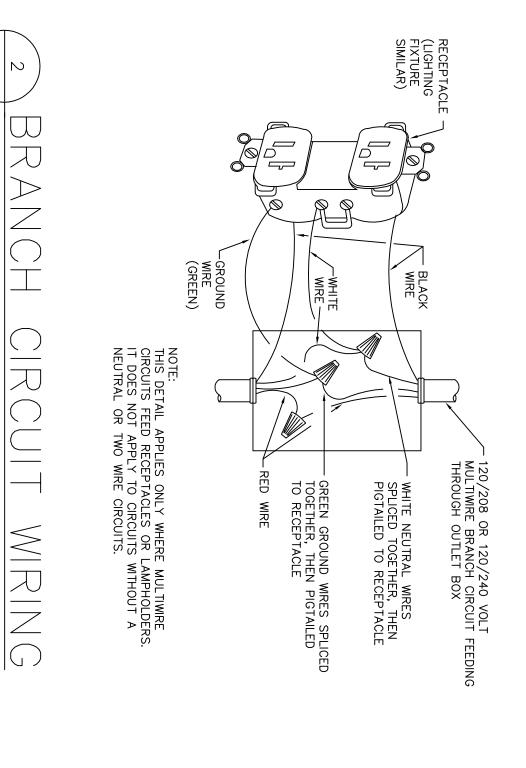

SCALE: NO SCALE $\bar{\mathcal{J}}$

(1) 1" POKE THROUGH FOR DATA TERMINATION

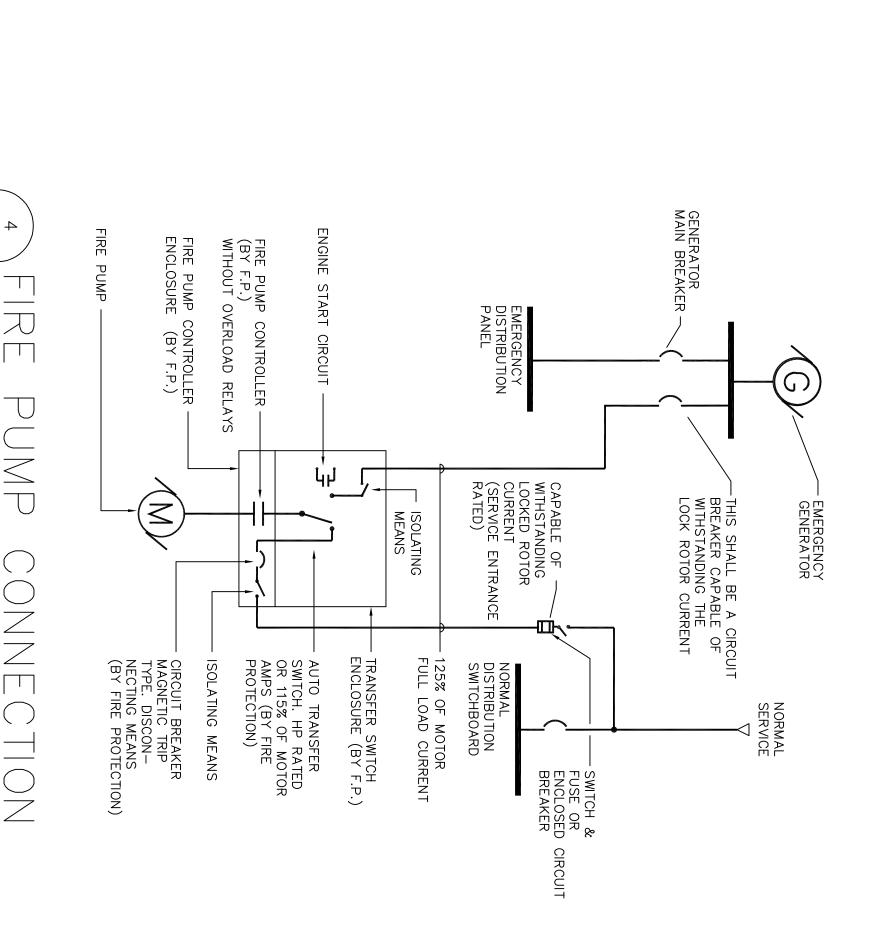

E6.4 SCALE: NO SCALE YP C HANGING

SUSPENDED PIPE HANGER

\BEAM CLAMP - THREADED ROD

STRAP OR ROD

— SUSPENDED PIPE HANGER

STRAPS LOCATED THE BEFORE POURING OR GROUTING

- HEAVY DUTY HANGER ROD

CONDUIT STRAP—


-STEEL PLATES AS REQUIRED

BAR JOIST-

THREADED ROD ————

VOID WASHER

SUSPENDED PIPE HANGER



ARCHITECTURE PLLC A

6800 S Creek Rd, Charlotte, NC 28277 Ph:(704) 625-6554 Fax:(704) 919-5822 EMAIL:ashish@mishraarch.com WEB: www.mishraarch.com

CIVIL:
David Lane Beaird & Associates, Inc.
105 Commercial Parkway
West Monroe, LA 71294
Phone: (318) 388-3227
Email:fgadberry@dlbengineering.com STRUCTURAL:
WGPM, Inc.
11220 Elm Lane, Suite 201
Charlotte, NC 28277
Phone: (704) 542-7199
Fax: (704) 542-7195
Email: lwright@wgpminc.con

ELECTRICAL:
R. Shane Ritter, PE
1043 Arroyo Vista Lane
Matthew, NC 28014
Phone: (704) 516-0385
Email: shane@rittereng.com
Project Number: 13015

—(1) 1" EMT CONDUIT FOR FUTURE PROJECTOR CONNECTION

MECHANICAL:
Shultz Engineering Group, P.C.
212 North McDowell St., Suite 204
Charlotte, NC 28204
Phone: (704) 334-7363
Fax:(704) 347-0093
Email: don@shultzeg.com

Date REVISIONS ate Description

Information contained on this drawing and in all digital files associated is authorized for use on the project named herein only and is the property of MISHRA ARCHITECTURE PLLC and may not be reproduced in any manner without express written or verbal permission from authorized individuals. Original drawing is 24"x36" and scales are as indicated. 2011 MISHRA ARCHITECTURE PLLC

Edfales

KEY PLAN

Southern Hospitality Services

Hampton Inn and Suites

5400 I-20 & Frontage Rd. Monroe, LA 71201

Electrical Miscellaneous Details

Phase
Construction Documents

SCALE: NO

SCALE

Project No.
Prepared by
Checked by red by RSR (ed by RSR Sept. 16, 2013 E6.4 Hamnton Inn and Suites

Released for PERMIT ONLY