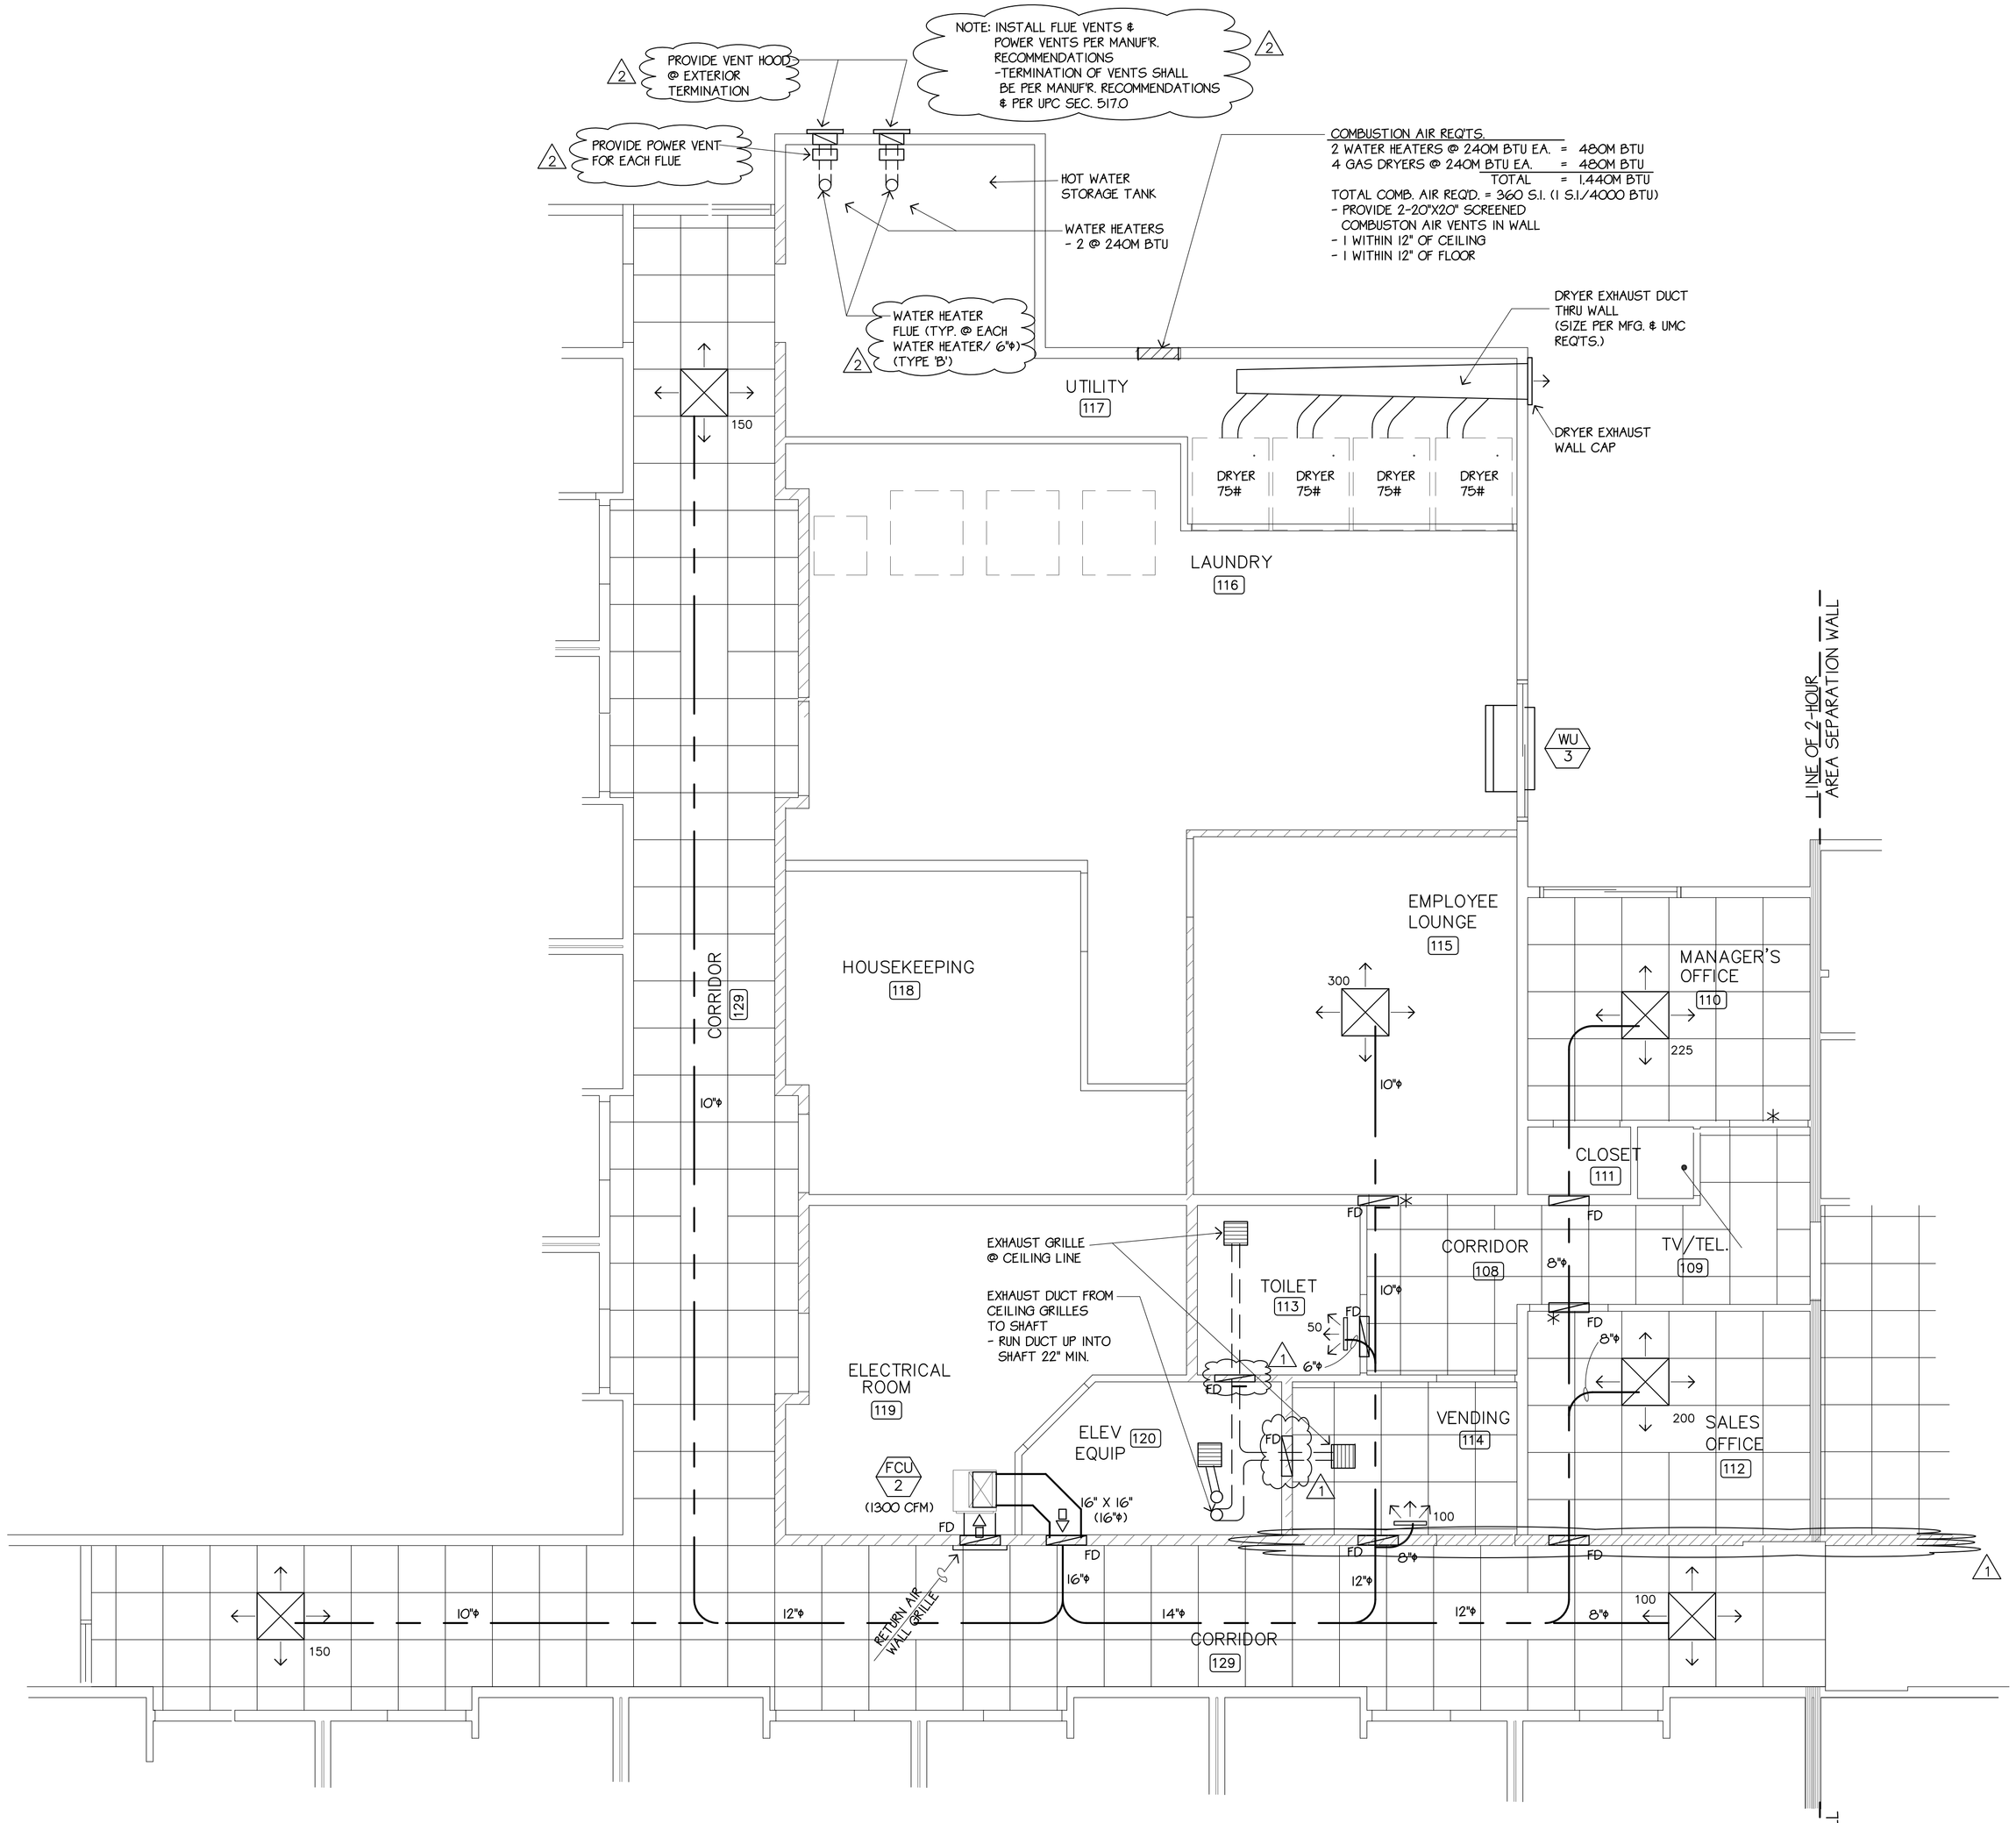

NOTE:
CROSS-HATCHED WALLS AND ENTIRE FLOOR/CEILING ASSEMBLIES OF LAUNDRY ROOM, STOR. ROOMS, & 2ND FLOOR SERVICE ROOM SHALL BE OF 1-HR. FIRE RESISTIVE CONSTRUCTION FOR OCCUPANCY SEPARATION PURPOSES. (2-HR. @ ELEVATOR SHAFT, STAIRWAY ENCLOSURES & LINEN CHUTE SHAFT)

NOTE:
1. ALL DUCTWORK RUN BETWEEN JOISTS WHERE POSSIBLE.
   - DUCTS SHALL BE RUN WITHIN SOFFIT FRAMING WHERE POSSIBLE
2. OPENINGS FOR DUCTWORK RUN THRU JOISTS SHALL BE COORDINATED WITH STRUCTURAL FRAMING SYSTEM (DEPTH LIMITS MAY REQUIRE ALTERNATE ROUTING.)
3. FD = FIRE/SMOKE DAMPER
4. * INDICATES DOOR TO BE UNDERCUT 1" FOR RETURN AIR PURPOSES
5. PROVIDE SMOKE DETECTOR ACTIVATED SHUT-OFF CONTROL IN MAIN SUPPLY AIR DUCT OF MECH UNIT FCU-1.
6. REFER TO MECHANICAL EQUIPMENT LIST ON SHEET M5 FOR ALL HVAC EQUIPMENT

ENLARGED LAUNDRY AREA MECHANICAL FLOOR PLAN

SCALE: 1/4"=1'-0"

2 REVISIONS PER FIELD REVISIONS 3/10/99

1 REVISIONS PER CITY OF SOUTH SAN FRANCISCO 2/5/98

LEE GAGE C-6718

© LEE GAGE & ASSOC.

lee gage & associates
architects • engineers • planners
7636 n. ingram suite 107 fresno, california 93711 phone (209) 439-2222

THESE DRAWINGS, DESIGNS, SKETCHES, PLANS & ARRANGEMENTS HEREIN ARE THE EXCLUSIVE PROPERTY OF LEE GAGE & ASSOCIATES, AND WERE CREATED AND DEVELOPED BY AND FOR THE ARCHITECT'S USE AND EMPLOYMENT SOLELY WITH THE ARCHITECT'S WORK. NOTHING CONTAINED BY REPRODUCED TO ANY PERSON OR CORPORATION FOR ANY PURPOSE WITHOUT EXPRESSED WRITTEN CONSENT OF LEE GAGE & ASSOCIATES.

PROPOSED:
HAMPTON INN
CORPORATE DRIVE
SOUTH SAN FRANCISCO, CALIFORNIA

by date
drawn
checked
revised
revised
project no.

M3B
sheet SET NO.