



803 S. MOUNT MORAH
SUITE 100B
MEMPHIS, TN 38117
(901) 683-7175 P.
(901) 583-2365 F.
lhw@lwarchitects.com

NO.	ISSUED	DATE
1	ISSUED	10/26/07

NO.	REVISIONS	DATE
-----	-----------	------

COPYRIGHT BY LW ARCHITECTS, INC.
ALL RIGHTS RESERVED.
U.S. COPYRIGHT LAWS WILL PROTECT THE
DRAWING FROM REPRODUCTION
WITHOUT WRITTEN PERMISSION.


CONSULTANTS

STRUCTURAL:
SK INTERNATIONAL, INC.,
130 SOUTH MAIN STREET
HUNTSVILLE, AL 35811
(256) 882-2098

MECHANICAL:
CRABTREE ENGINEERING
726 S. MT. MORAH
MEMPHIS, TN 38117
(901) 767-9898

PLUMBING:
CRABTREE ENGINEERING
726 S. MT. MORAH
MEMPHIS, TN 38117
(901) 767-9898


ELECTRICAL:
CHS ENGINEERING
726 S. MT. MORAH
MEMPHIS, TN 38117
(901) 767-2557

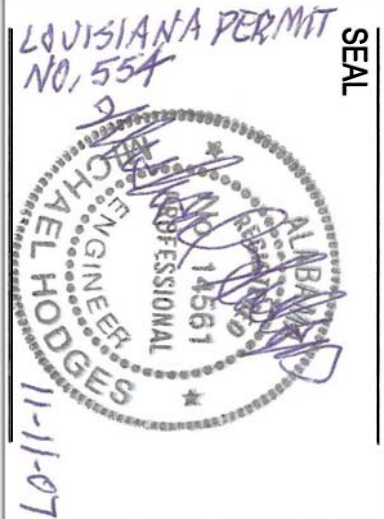

Holiday Dwyer
BOSSIER CITY,
LOUISIANA
WILLENNUM

SHEET NAME
4th FLOOR FRAMING
PLAN & WALL/HEADER
FOR 3rd FLOOR
PLAN

DATE	10/26/07
DRAWN BY	RDR
CHECKED BY	MCP
FILE NAME	1507-STPL
SCALE	AS NOTED
PROJECT NO.	1507

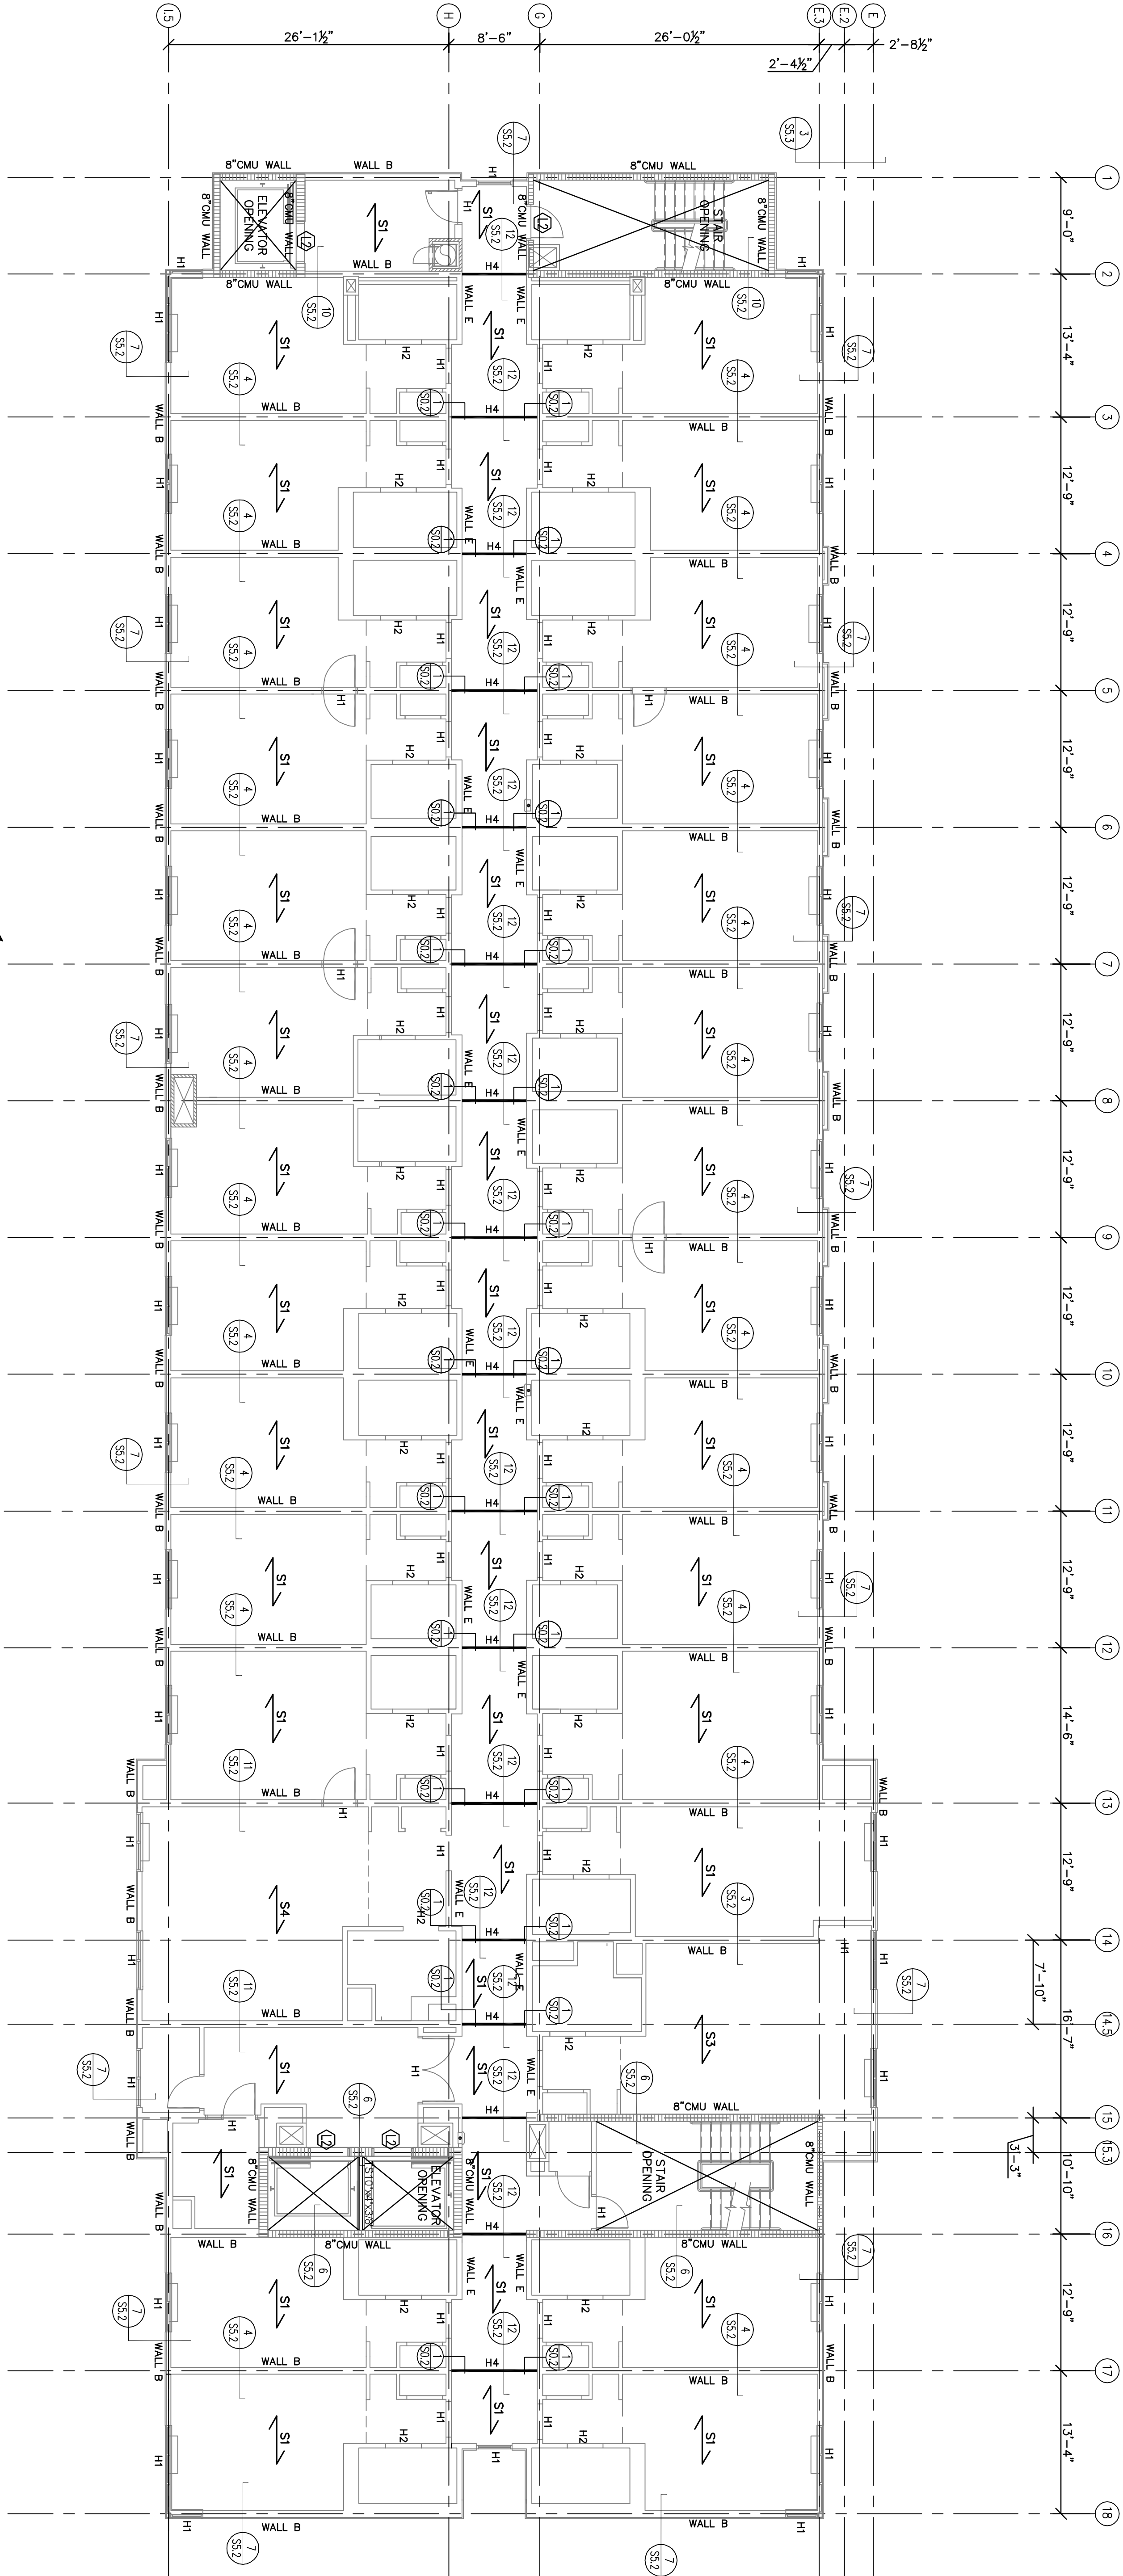

4th FLOOR FRAMING PLAN & WALL/HEADER FOR 3rd FLOOR PLAN

SCALE: 1/8"=1'-0"

COLUMN LEGEND	STEEL CONNECT LEGEND	WALL TYPE SCHEDULE
1. HSS 6"x6"x1/2" COLUMN	1. A/S5.3 2. C/S5.3 3. E/S5.3 4. G/S5.3	WALL A 600S162-97-50 @ 16" O.C.
2. HSS 5"x5"x5/16" COLUMN	5. B/S5.3 6. D/S5.3 7. F/S5.3 8. H/S5.3	WALL B 600S162-68-50 @ 16" O.C.
3. HSS 7"x7"x1/2" COLUMN		WALL C 600S162-54-50 @ 16" O.C.

NOTE: THE ENTIRE EXTERIOR WALL IS TO BE SHEATHED W/7/16" OSB W/FASTENER SPACING @ 6" ON EDGES AND 12" MAX INTERMEDIATELY

METAL STUD DESIGN	HEADER SCHEDULE	METAL DECK SCHEDULE
600S162-43-33	H1 (2)-600S162-54-50	S1 2x16 (1"x3") TT=d"
600S162-43-33	H2 (2)-600S162-43-33	S2 3x18 (NO CONCRETE)
600S162-43-33	H3 (2)-600S162-33-33	S3 2x16 (1"x3") TT=d"
600S162-43-33	H4 (2)-600S162-48-50	S4 2x16 (1"x4") TT=d"

ALL TRACKS = SAME GAGE AS STUD W/1/2" FLANGE

WALL A 600S162-97-50 @ 16" O.C.	WALL B 600S162-68-50 @ 16" O.C.	WALL C 600S162-54-50 @ 16" O.C.	WALL D 600S162-43-33 @ 16" O.C.	WALL E 600S162-33-33 @ 16" O.C.
---------------------------------	---------------------------------	---------------------------------	---------------------------------	---------------------------------

1. SHEAR WALL FROM FLOOR TO BOTTOM OF FLOOR ABOVE W/7/16" OSB PANELS W/FASTENERS @ 7" ON EDGES AND 12" MAX INTERMEDIATELY IN FIELD. 7/16" OSB REQUIRED BOTH SIDES OF EXTERIOR WALLS. ANCHORS = 3/8" A325 GROUTED BOLTS @ 32" O.C. W/1/2" MIN EMBED.

GENERAL NOTE:
1. SEE SHEET S0.2 FOR FRAME OPENING.
2. DOUBLE BAR JOIST AT ALL MECH. RTU UNITS.

S2.3