ELECTRICAL POWER NOTES:

1. COORDINATE LOCATION OF ALL EQUIPMENT IN ELEVATOR EQUIPMENT ROOMS WITH ELEVATOR VENDOR. EQUIPMENT LOCATION SHALL BE IN COMPLIANCE WITH ALL NATIONAL AND LOCAL CODES.
2. PROVIDE ALL ASSOCIATED ELECTRICAL REQUIRED FOR FIREMAN'S ELEVATOR RECALL.
3. CONTRACTOR SHALL PROVIDE A COMPLETE, OPERATIONAL FIRE ALARM SYSTEM IN ACCORDANCE WITH ALL CODE, INTERCONTINENTAL HOTELS, INC. (FRANCHISE), AND MANUFACTURER'S REQUIREMENTS, INCLUDING DEVICES REQUIRED BY LOCAL CODE BUT NOT INDICATED HEREIN. SYSTEM SHALL INCLUDE ALL CONNECTIONS TO FLOW AND TAMPER SWITCHES AS WELL AS P.I.V. AND DUCT SMOKE DETECTORS FOR MECHANICAL UNITS. PROVIDE CARBON MONOXIDE DETECTORS IN ALL AREAS OF GAS FIRED APPLIANCES.
4. REFER TO MECHANICAL PLANS FOR EXACT LOCATION OF EQUIPMENT.
5. LAUNDRY CHUTE DOOR INTERLOCK TO TIE CIRCUIT LDY-37. TYPICAL EACH FLOOR.
6. PROVIDE REMOTE ON/OFF SWITCH FOR FIREPLACE PILOT LIGHT, LOCATE ON SIDEWALL OF FRONT DESK.
7. CONTRACTOR TO COORDINATE EXACT LOCATIONS OF ALL FLOOR MOUNTED RECEPTACLES AND TV POWER AND CABLE CONNECTIONS WITH INTERIOR DESIGNER AND FINAL FURNITURE LAYOUT PRIOR TO BEGINNING INSTALLATION.
8. HOUSE PHONE AT +48" ONLY WITH AUTOMATIC DIAL TO FRONT DESK.
9. CARD READERS INSTALLED PER MANUFACTURERS INSTRUCTIONS.
   (CR) CARD READER HARD WIRE CONNECTION
10. CONTRACTOR SHALL PROVIDE A COMPLETE, OPERATIONAL FIRE ALARM SYSTEM IN ACCORDANCE WITH ALL CODE AND MANUFACTURING REQUIREMENTS, INCLUDING DEVICES REQUIRED BY LOCAL CODE BUT NOT INDICATED HEREIN. SYSTEM SHALL INCLUDE ALL CONNECTIONS TO FLOW AND TAMPER SWITCHES AS WELL AS P.I.V., AND DUCT SMOKE DETECTORS FOR MECHANICAL UNITS.
11. EMERGENCY PANIC BUTTON AT 36" MAX. A.F.F. W/ ANNUNCIATION BELL LOCATED AT FRONT DESK.
12. CONTRACTOR SHALL PROVIDE 120V POWER, CONNECT TO CIRCUIT HM-20 FOR BUILDING ALARM SYSTEM INSTALLATION BY OTHERS. COORDINATE EXACT LOCATION OF PANEL WITHIN OFFICE AREA WITH ALARM VENDOR.
13. ALL WP/GFCI RECEPTACLES TO HAVE IN-USE COVERS.
14. FIRE ALARM CONTRACTOR SHALL ENSURE THAT FINAL PLACEMENT OF CEILING MOUNTED FIXTURES DO NOT CONFLICT WITH OTHER CEILING MOUNTED EQUIPMENT (e.g. LIGHTS, DIFFUSERS).

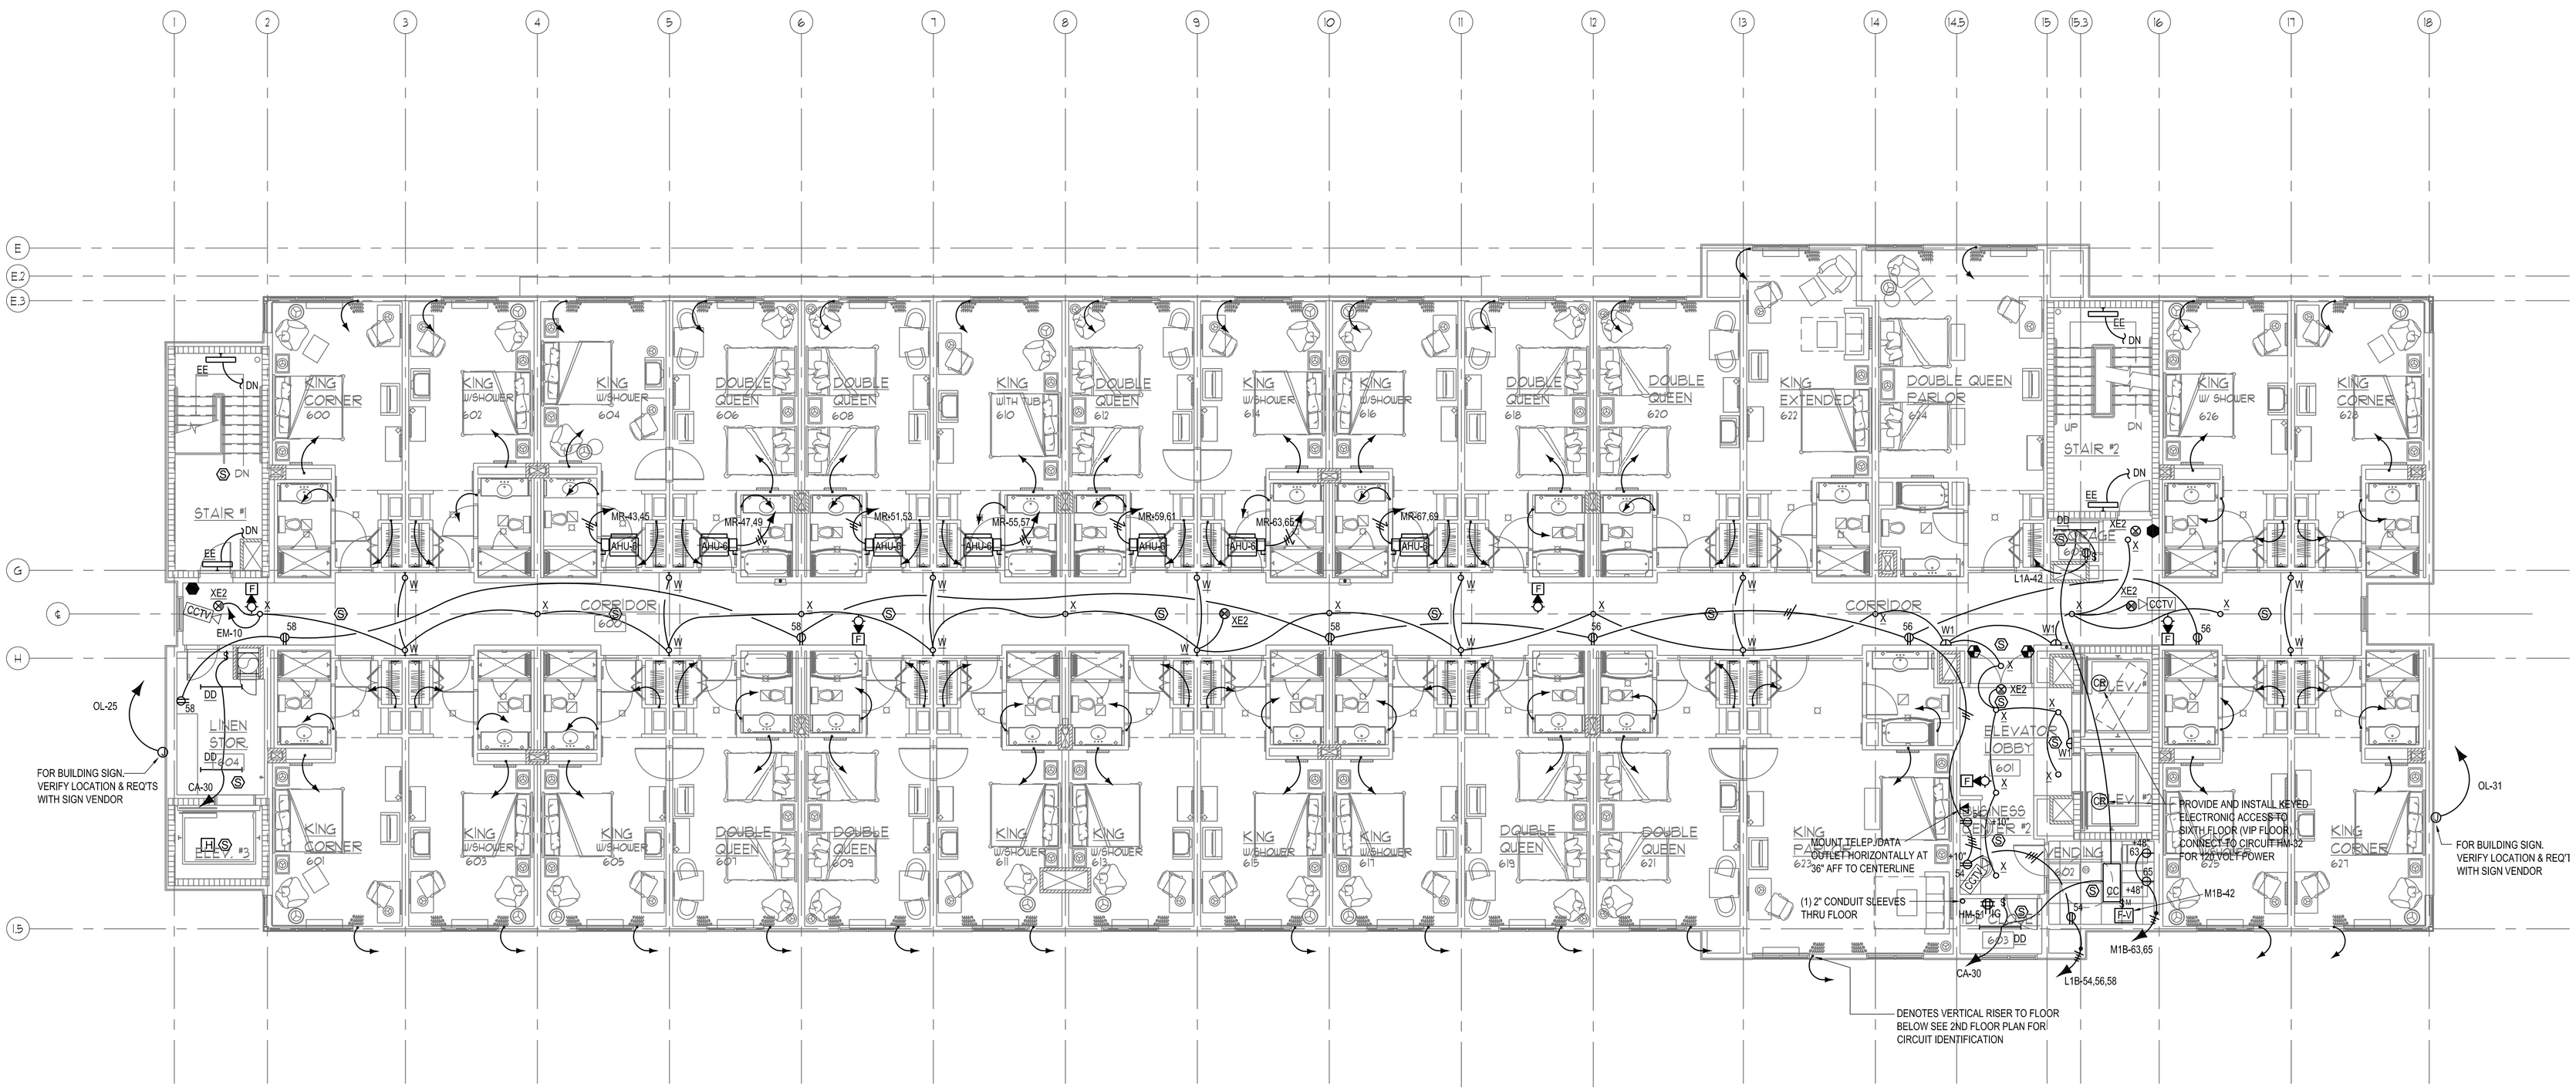

SIXTH FLOOR PLAN - ELECTRICAL

SCALE: 1/8" = 1'-0"

CALL NORTH

LLW ARCHITECTS

803 S. MOUNT MORIAH
SUITE 100B
MEMPHIS, TN 38117
(901) 683-7175 p.
(901) 683-2385 f.
llw@llwarchitects.com

NO.	ISSUED	DATE
1	ISSUED	10/26/07

NO.	REVISIONS	DATE

COPYRIGHT BY LLW ARCHITECTS, INC
WARNING: UNAUTHORIZED COPYING VIOLATES U.S. COPYRIGHT LAWS AND WILL SUBJECT THE VIOLATOR TO LEGAL PROSECUTION.

CONSULTANTS

STRUCTURAL:
SK INTERNATIONAL, INC.
130 SOUTH MAIN STREET
HUNTSVILLE, AL 35811
(256) 852-3098

MECHANICAL:
CRABTREE ENGINEERING
726 S. MT. MORIAH
MEMPHIS, TN 38117
(901) 767-9898

PLUMBING:
CRABTREE ENGINEERING
726 S. MT. MORIAH
MEMPHIS, TN 38117
(901) 767-9898

ELECTRICAL:
CHS ENGINEERING
726 S. MT. MORIAH
MEMPHIS, TN 38117
(901) 767-2557

SEAL

STATE OF LOUISIANA
Constance H. Scott
No. 26527
REGISTERED PROFESSIONAL ENGINEER IN ELECTRICAL ENGINEERING

Holiday Inn MILLENNIUM

BOSSIER CITY, LOUISIANA

SHEET NAME
SIXTH FLOOR ELECTRICAL PLAN

DATE 10/26/07

DRAWN BY JSH

CHECKED BY CHS

FILE NAME

SCALE AS NOTED

PROJECT NO. 1507

DRAWING

E07