



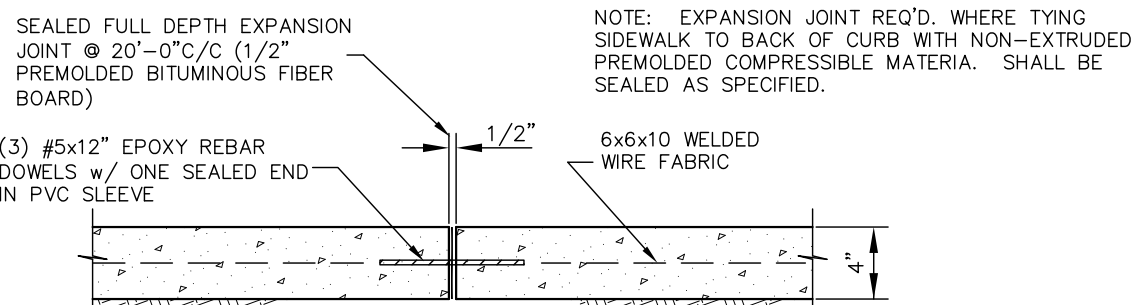


GRADE AND COMPACT SUBGRADE PER SPECIFICATIONS AND TYPICAL SECTION

SIDEWALK EXPANSION JOINT DETAIL

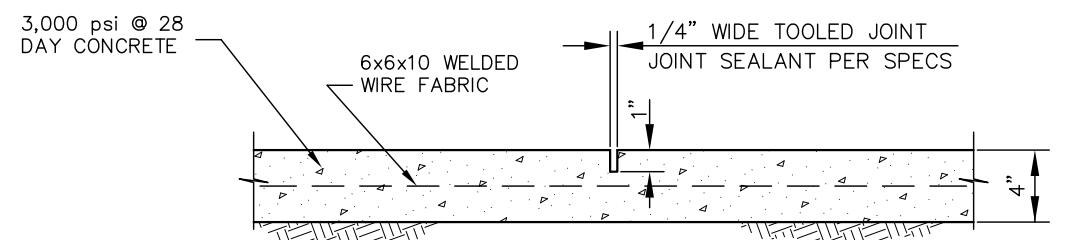

GRADE AND COMPACT SUBGRADE PER SPECIFICATIONS AND TYPICAL SECTION


SIDEWALK CONTRACTION JOINT DETAIL

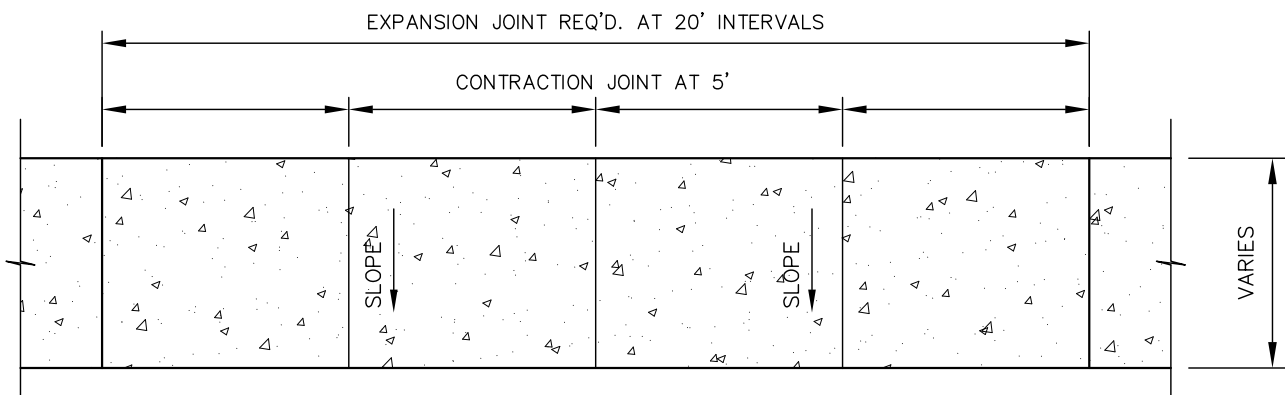


NOTES:

1. SIDEWALK TO BE SLOPED TO BACK OF CURB AT 2% UNLESS NOTED OTHERWISE
2. SIDEWALK SHALL BE BROOM FINISHED PERPENDICULAR TO ROADWAY CENTERLINE
3. ALL EXPANSION JOINTS SHALL BE SEALED WITH ELASTOMERIC SEALER WITHIN 1/4" OF THE FINISHED SURFACE PER ADA REQUIREMENTS.
4. EXPANSION JOINT WITH SEALER REQUIRED ANY WHERE SIDEWALK ABUTS ANOTHER CONCRETE OR SOLID SURFACE (I.E. INLET TOP, CURB, ASPHALT, SIGNAL POLE, ETC.)

SIDEWALK JOINT LAYOUT DETAIL

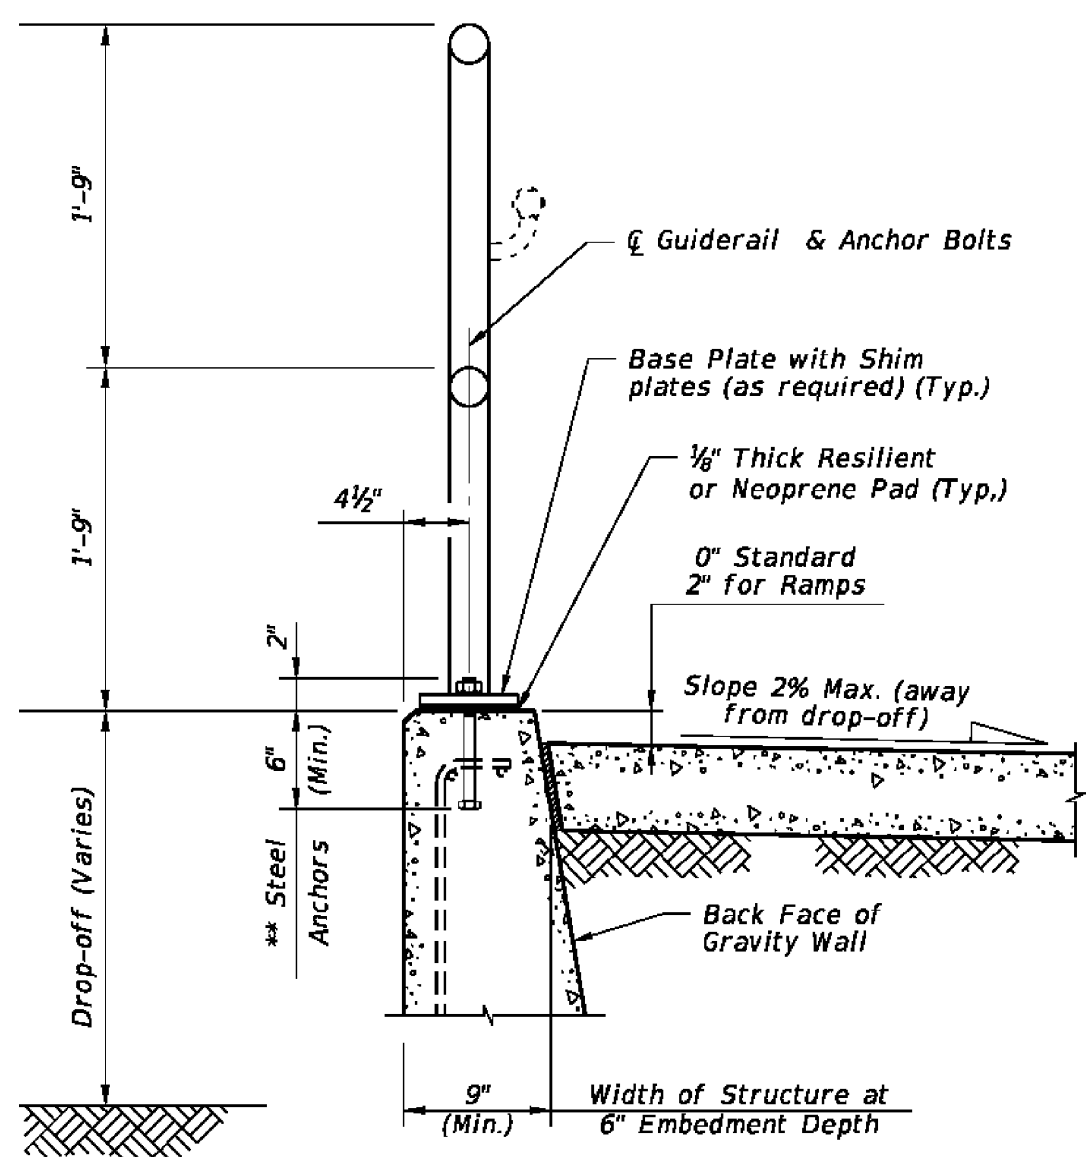


TYPICAL SECTION ON GRAVITY WALL
(Other Retaining Walls Similar)

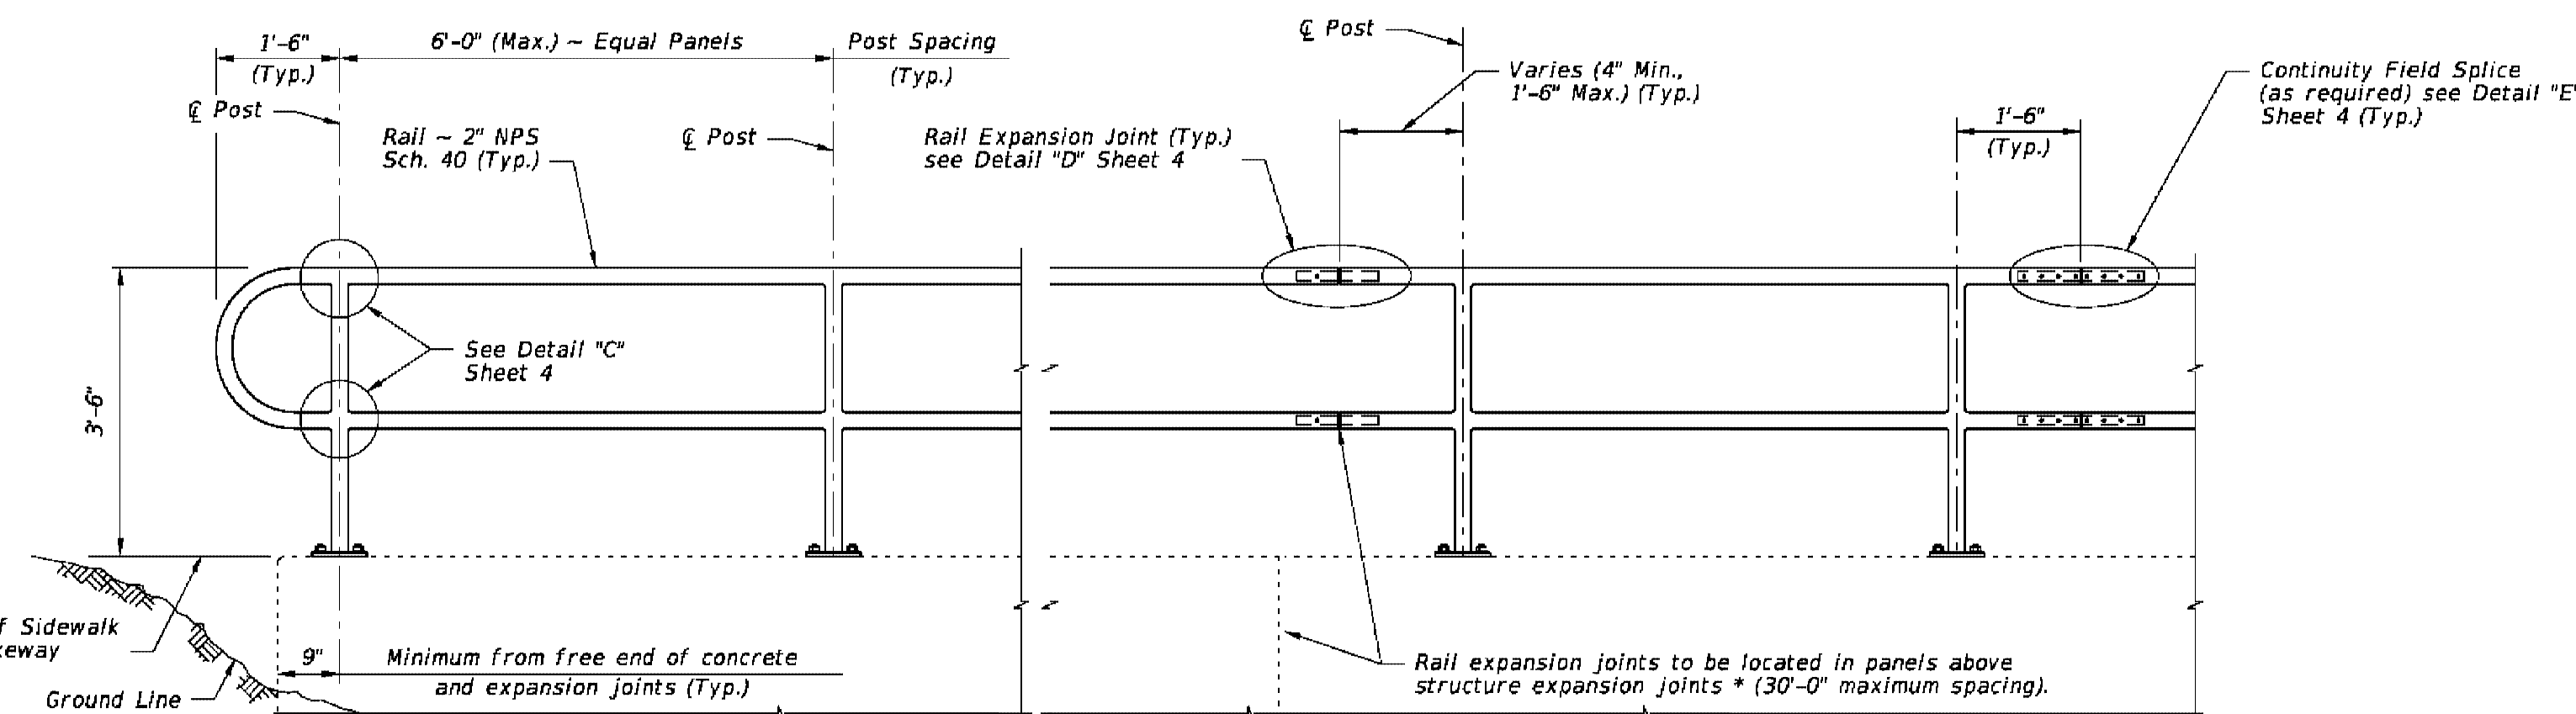


ELEVATION

TYPICAL RAILING DETAILS & RAILINGS ON GRADES 0% TO 5%

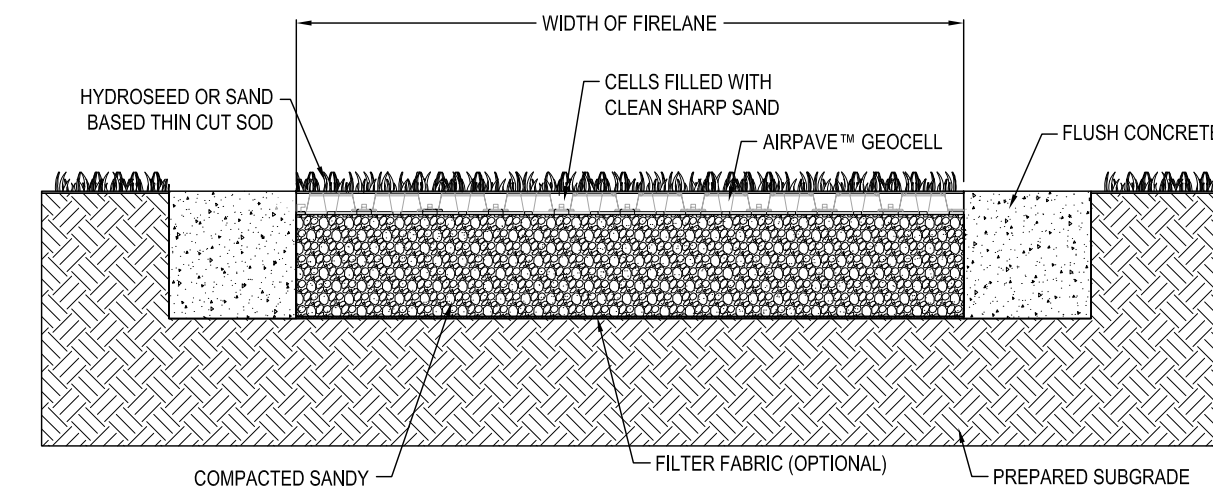


NOTE: INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURERS SPECIFICATIONS.

AIRPAVE GEOCELL GRASS PAVING DETAIL

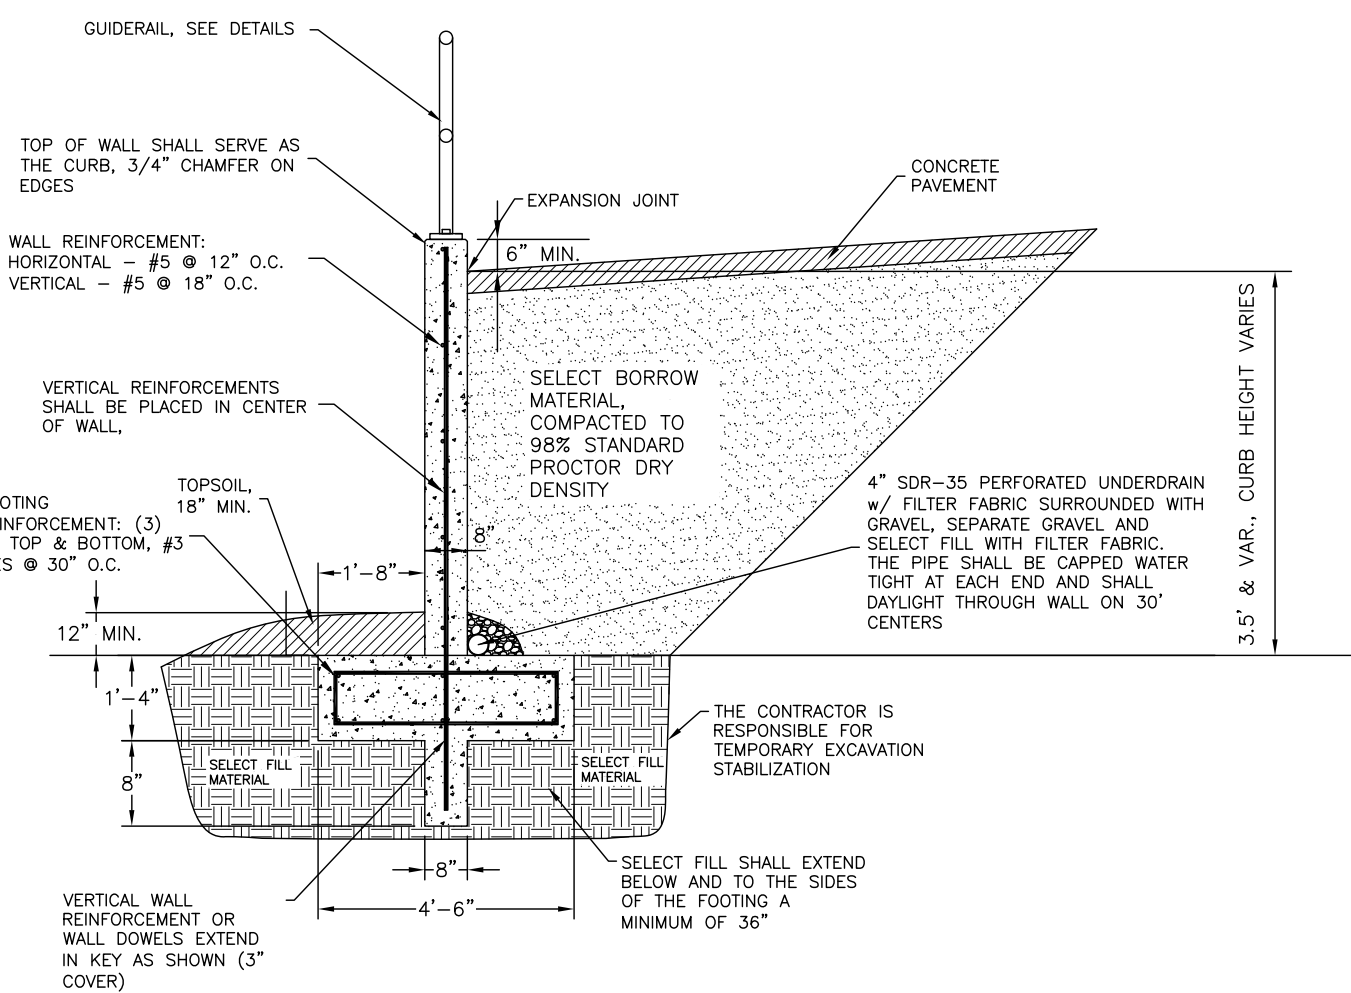


RETAINING WALL SECTION

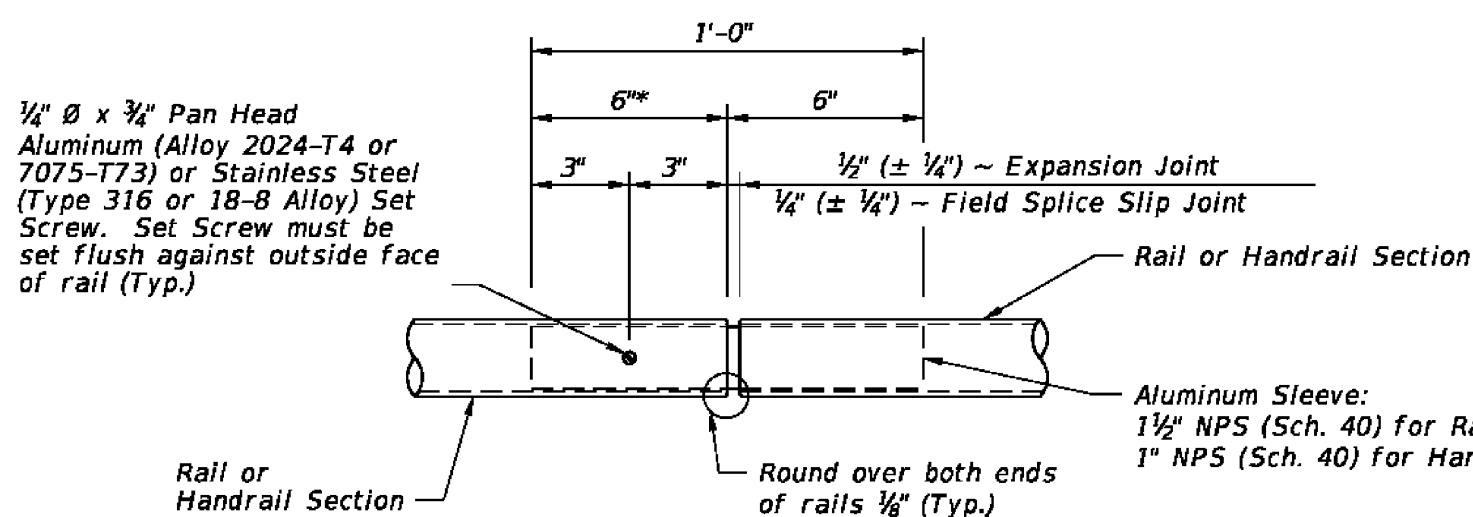

DETAIL "D" - EXPANSION JOINT
(FIELD SPLICE SLIP JOINT SIMILAR)

* At the Contractor's option, embedded length may be 4" when a 3/4" Ø plug weld is substituted for the 1/4" Ø set screw.

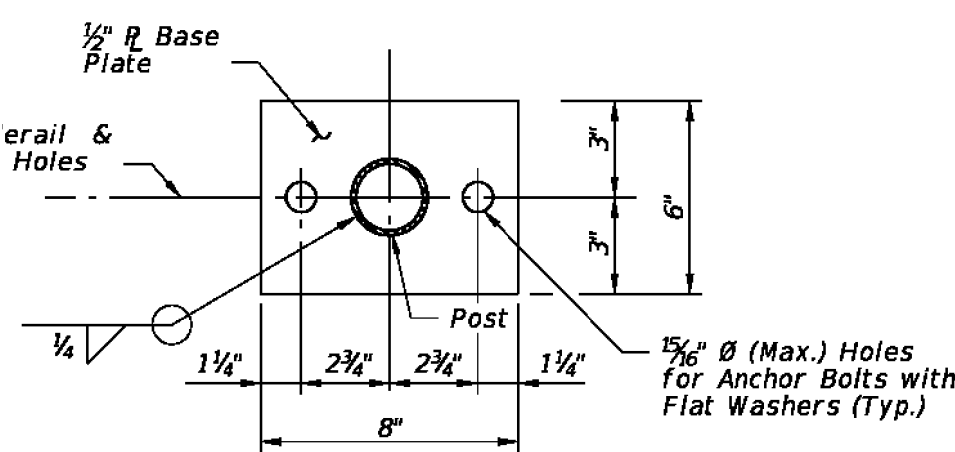


SECTION C-C
BASE PLATE DETAIL

NOTES:

1. ALL BOLTS AND WASHERS SHALL BE STAINLESS STEEL
2. COLOR OF RAILING TO BE COORDINATED WITH ARCHITECT.

GUARDRAIL DETAILS

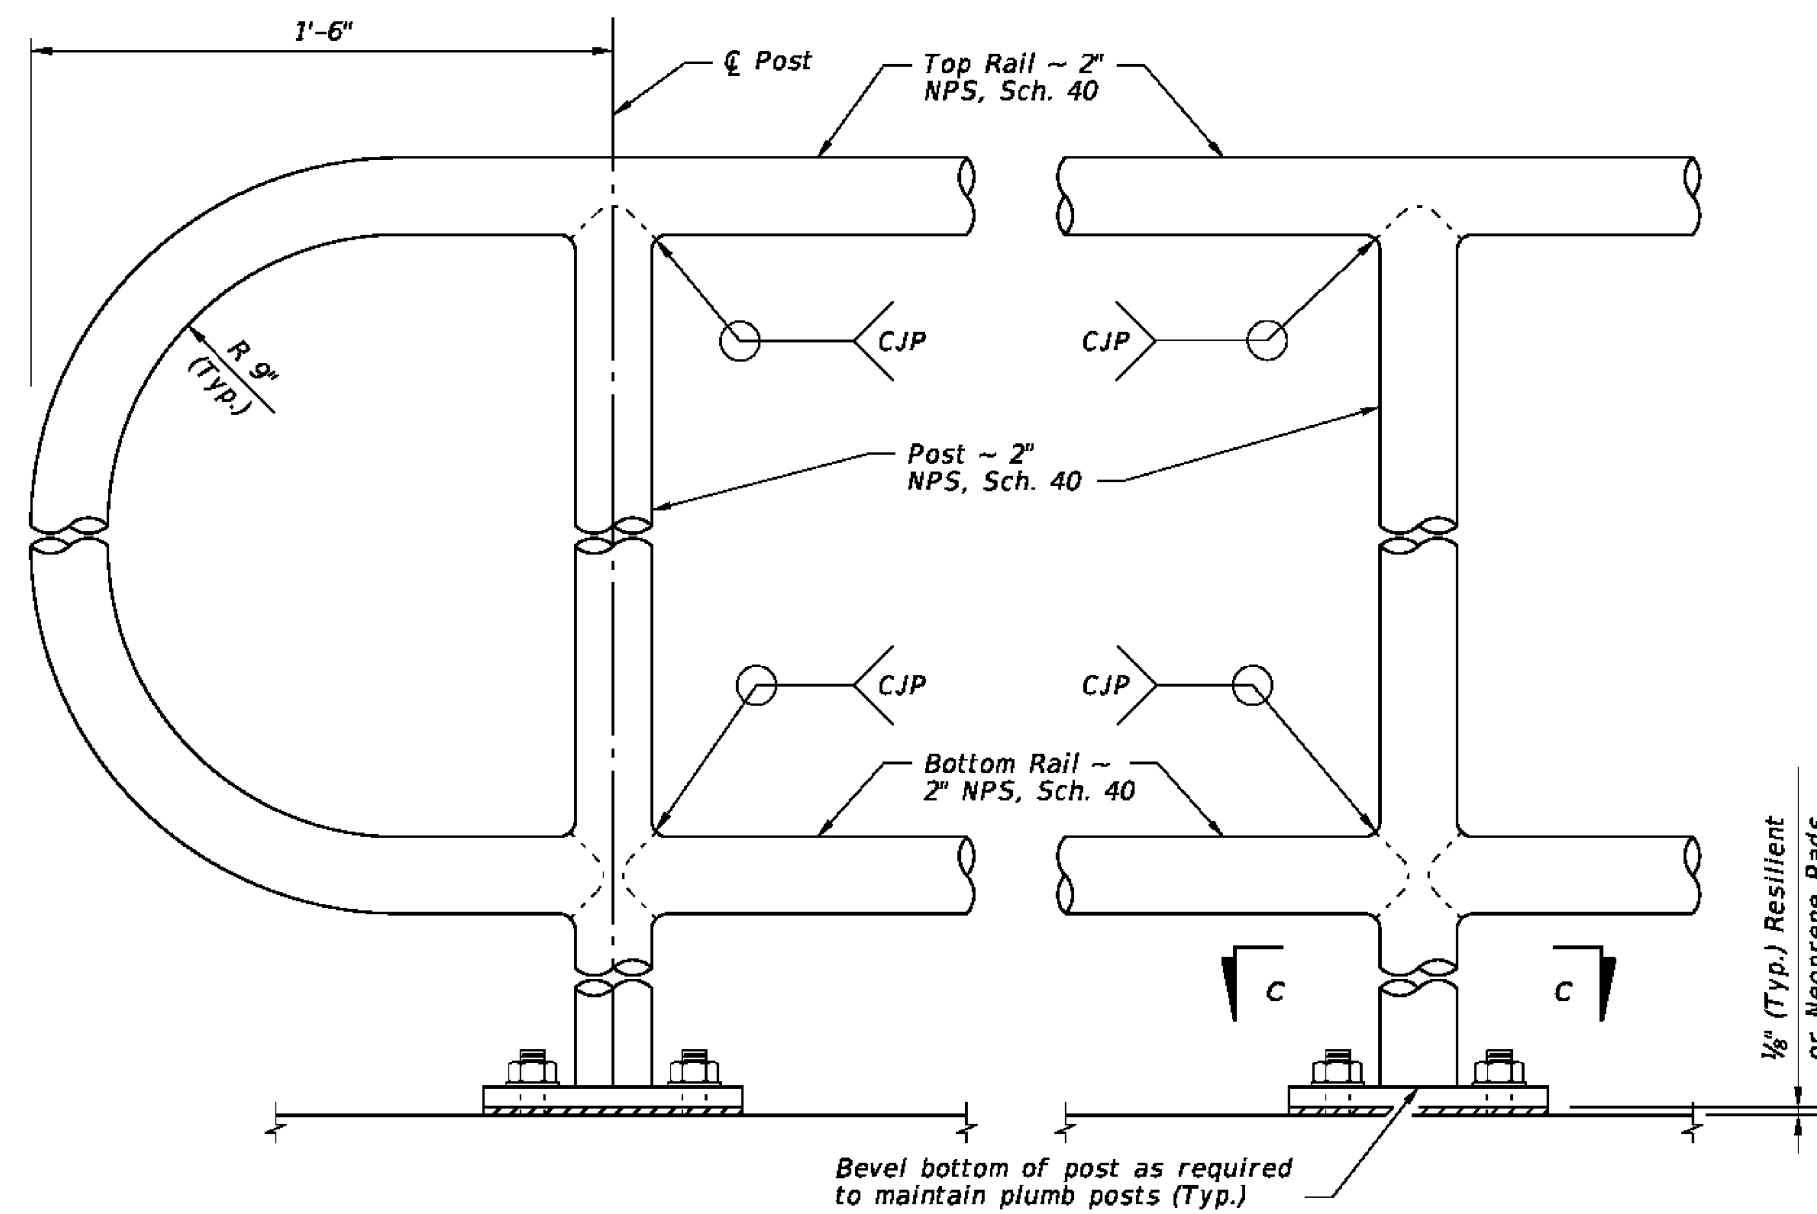

DETAIL "C" - RAIL CONNECTIONS
(Handrail Not Shown)

