
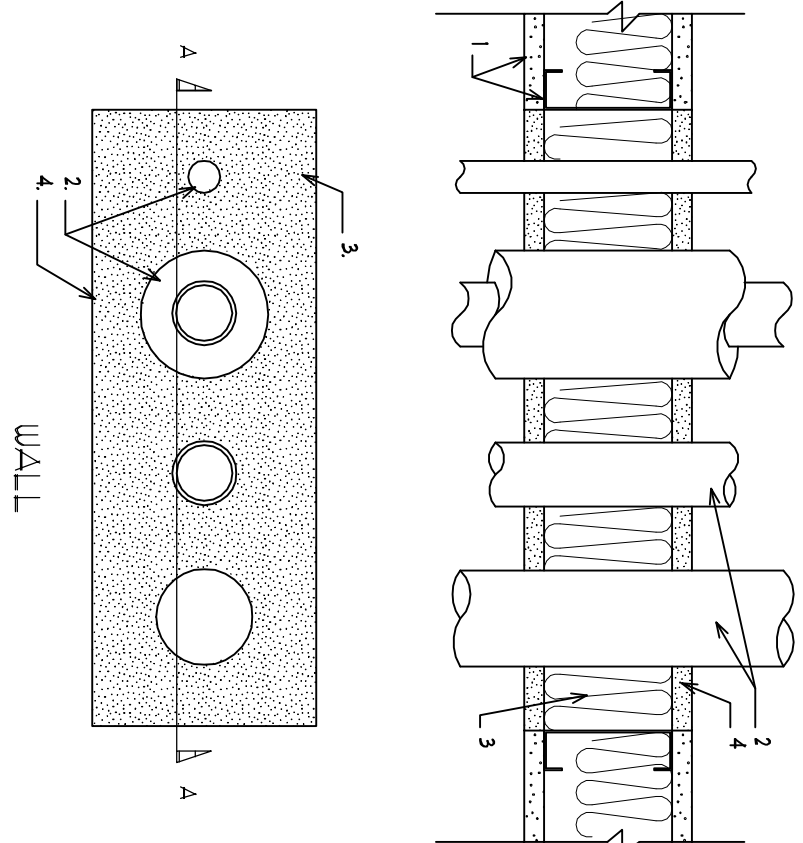
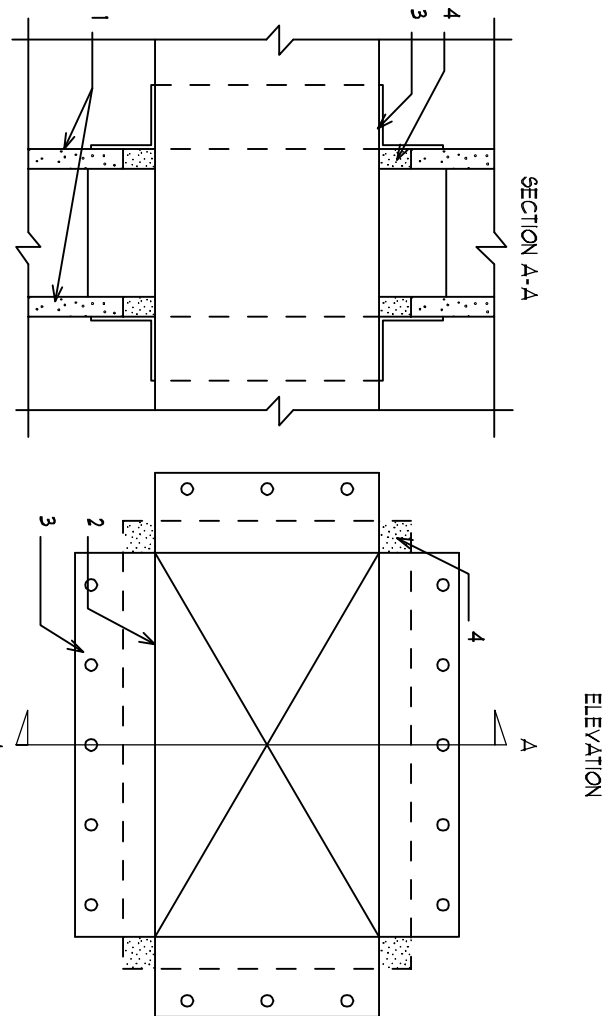
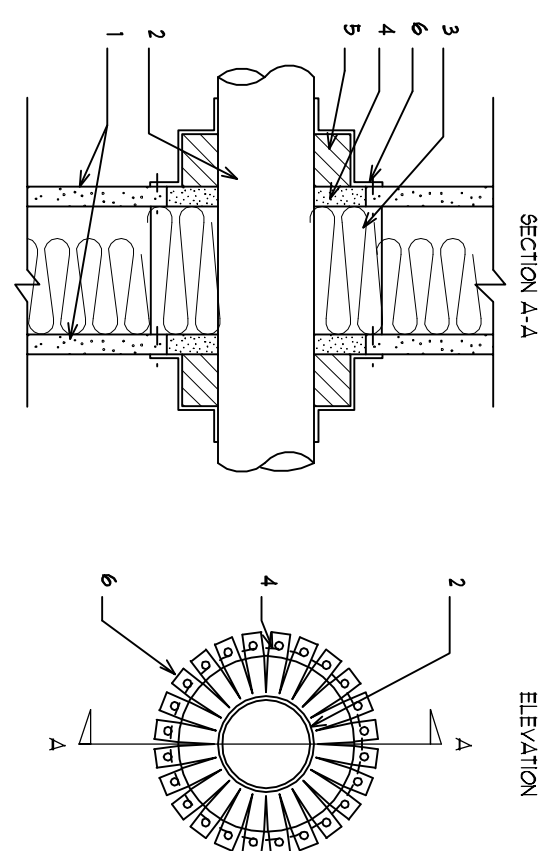


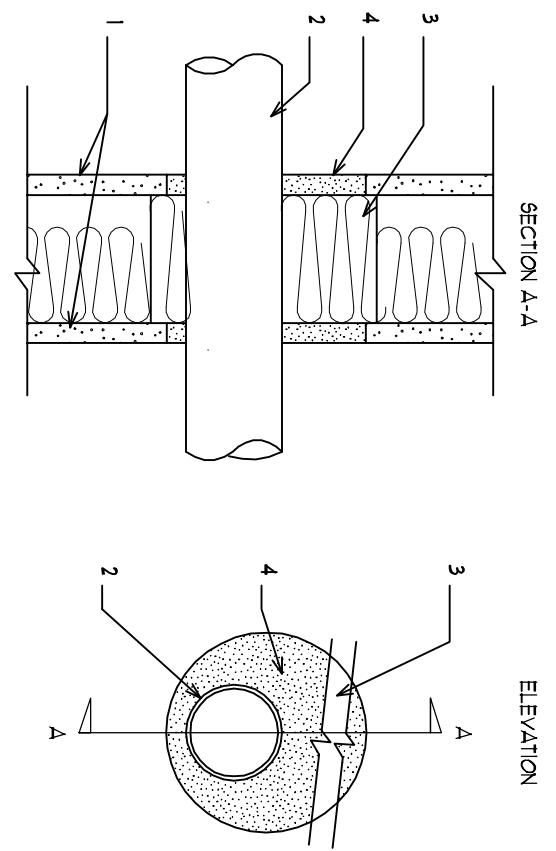

- WALL ASSEMBLY TO FORM PANEL WALL ASSEMBLY AS SPECIFIED IN THE INDIVIDUAL U200 OR U400 SERIES WALL AND PARTITION DESIGNS IN UL FIRE RESISTANCE DIRECTORY.
- NON-METALLIC PIPE (FOR SULLERED METAL TRIM) AND PERIPHERY OF OPENING SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FORMING MATERIAL, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FILL VOID OR CAVITY MATERIAL.
- UL CLASSIFIED FIRESTOPPING SEALANT COMPOUND, APPLIED AROUND PERIPHERY OF OPENING AS REQUIRED.
- STEEL COLLAR, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.

- WALL ASSEMBLY TO FORM PANEL WALL ASSEMBLY AS SPECIFIED IN THE INDIVIDUAL U200 OR U400 SERIES WALL AND PARTITION DESIGNS IN UL FIRE RESISTANCE DIRECTORY.
- NON-METALLIC PIPE (FOR SULLERED METAL TRIM) AND PERIPHERY OF OPENING SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FORMING MATERIAL, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FILL VOID OR CAVITY MATERIAL.
- UL CLASSIFIED FIRESTOPPING SEALANT COMPOUND, APPLIED AROUND PERIPHERY OF OPENING AS REQUIRED.
- STEEL COLLAR, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.

- WALL ASSEMBLY TO FORM PANEL WALL ASSEMBLY AS SPECIFIED IN THE INDIVIDUAL U200 OR U400 SERIES WALL AND PARTITION DESIGNS IN UL FIRE RESISTANCE DIRECTORY.
- INSULATED AIR DUCT.
- STEEL COLLAR, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FILL VOID OR CAVITY MATERIAL.
- UL CLASSIFIED FIRESTOPPING SEALANT COMPOUND, APPLIED AROUND PERIPHERY OF OPENING AS REQUIRED.

- WALL ASSEMBLY TO FORM PANEL WALL ASSEMBLY AS SPECIFIED IN THE INDIVIDUAL U200 OR U400 SERIES WALL AND PARTITION DESIGNS IN UL FIRE RESISTANCE DIRECTORY.
- THROUGH-PENETRANTS, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FORMING MATERIAL, WHEN REQUIRED, SHALL BE AS REQUIRED BY UL THROUGH-PENETRATION FIRE-STOPPING SYSTEM.
- FILL VOID OR CAVITY MATERIAL.
- UL CLASSIFIED FIRESTOPPING SEALANT COMPOUND, APPLIED AROUND PERIPHERY OF OPENING AS REQUIRED.

METALLIC PIPE @ WALL

- 1 HOUR FIRE RATED
UL DES NO. UL1062, UL DES NO. UL1093
UL DES. UL 1062 OR APPROVED EQUAL
- 2 HOUR FIRE RATED
UL DES NO. UL1040 OR APPROVED EQUAL

NON-METALLIC PIPE @ WALL

- 1 HOUR FIRE RATED
UL DES NO. UL1202, UL DES NO. UL1203
UL DES NO. UL1203 APPROVED EQUAL
- 2 HOUR FIRE RATED
UL DES NO. UL1203 OR APPROVED EQUAL


AIR DUCT @ WALL

- 1 HOUR FIRE RATED
UL DES NO. UL1049, UL1093, UL1001 OR APPROVED EQUAL
- 2 HOUR FIRE RATED
UL DES NO. UL1093 OR APPROVED EQUAL

MULTIPLE PIPES/ PENETRATION @ WALL

- 1 HOUR FIRE RATED
UL DES NO. UL8002, OR APPROVED EQUAL
- 2 HOUR FIRE RATED
UL DES NO. UL8003, UL DES NO. UL 8001, OR APPROVED EQUAL

FIRE EXT. CABINET

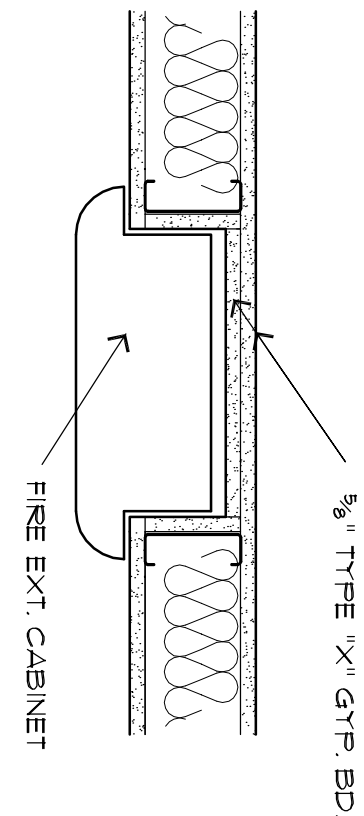

NOTE

The provisions of BIC Section 112 shall govern the materials and the methods of construction used to protect through penetrations and membrane penetrations.

- Penetrations into or through fire-resistance-rated vertical or horizontal assemblies in which openings are protected shall meet the requirements of section 112.3.
- Penetrations of a structural floor or the ceiling membrane of a roof/ceiling assembly shall meet the requirements of section 112.3 (SHAFT ENCLOSURES).
- Penetrations into or through fire-resistance-rated vertical or horizontal assemblies in which openings are protected shall meet the requirements of section 112.3.
- Penetrations of a structural floor or the ceiling membrane of a roof/ceiling assembly shall meet the requirements of section 112.3 (SHAFT ENCLOSURES).



HOMER2
SUITES BY HILTON

Old Fannin Road
Flowood, Mississippi

PROJECT NO. 13012
DRAWN BY: CHECKED BY: GC:
DATE: July 11, 2015
SHEET NUMBER: A609
REISSUED: JUNE 07, 2016