
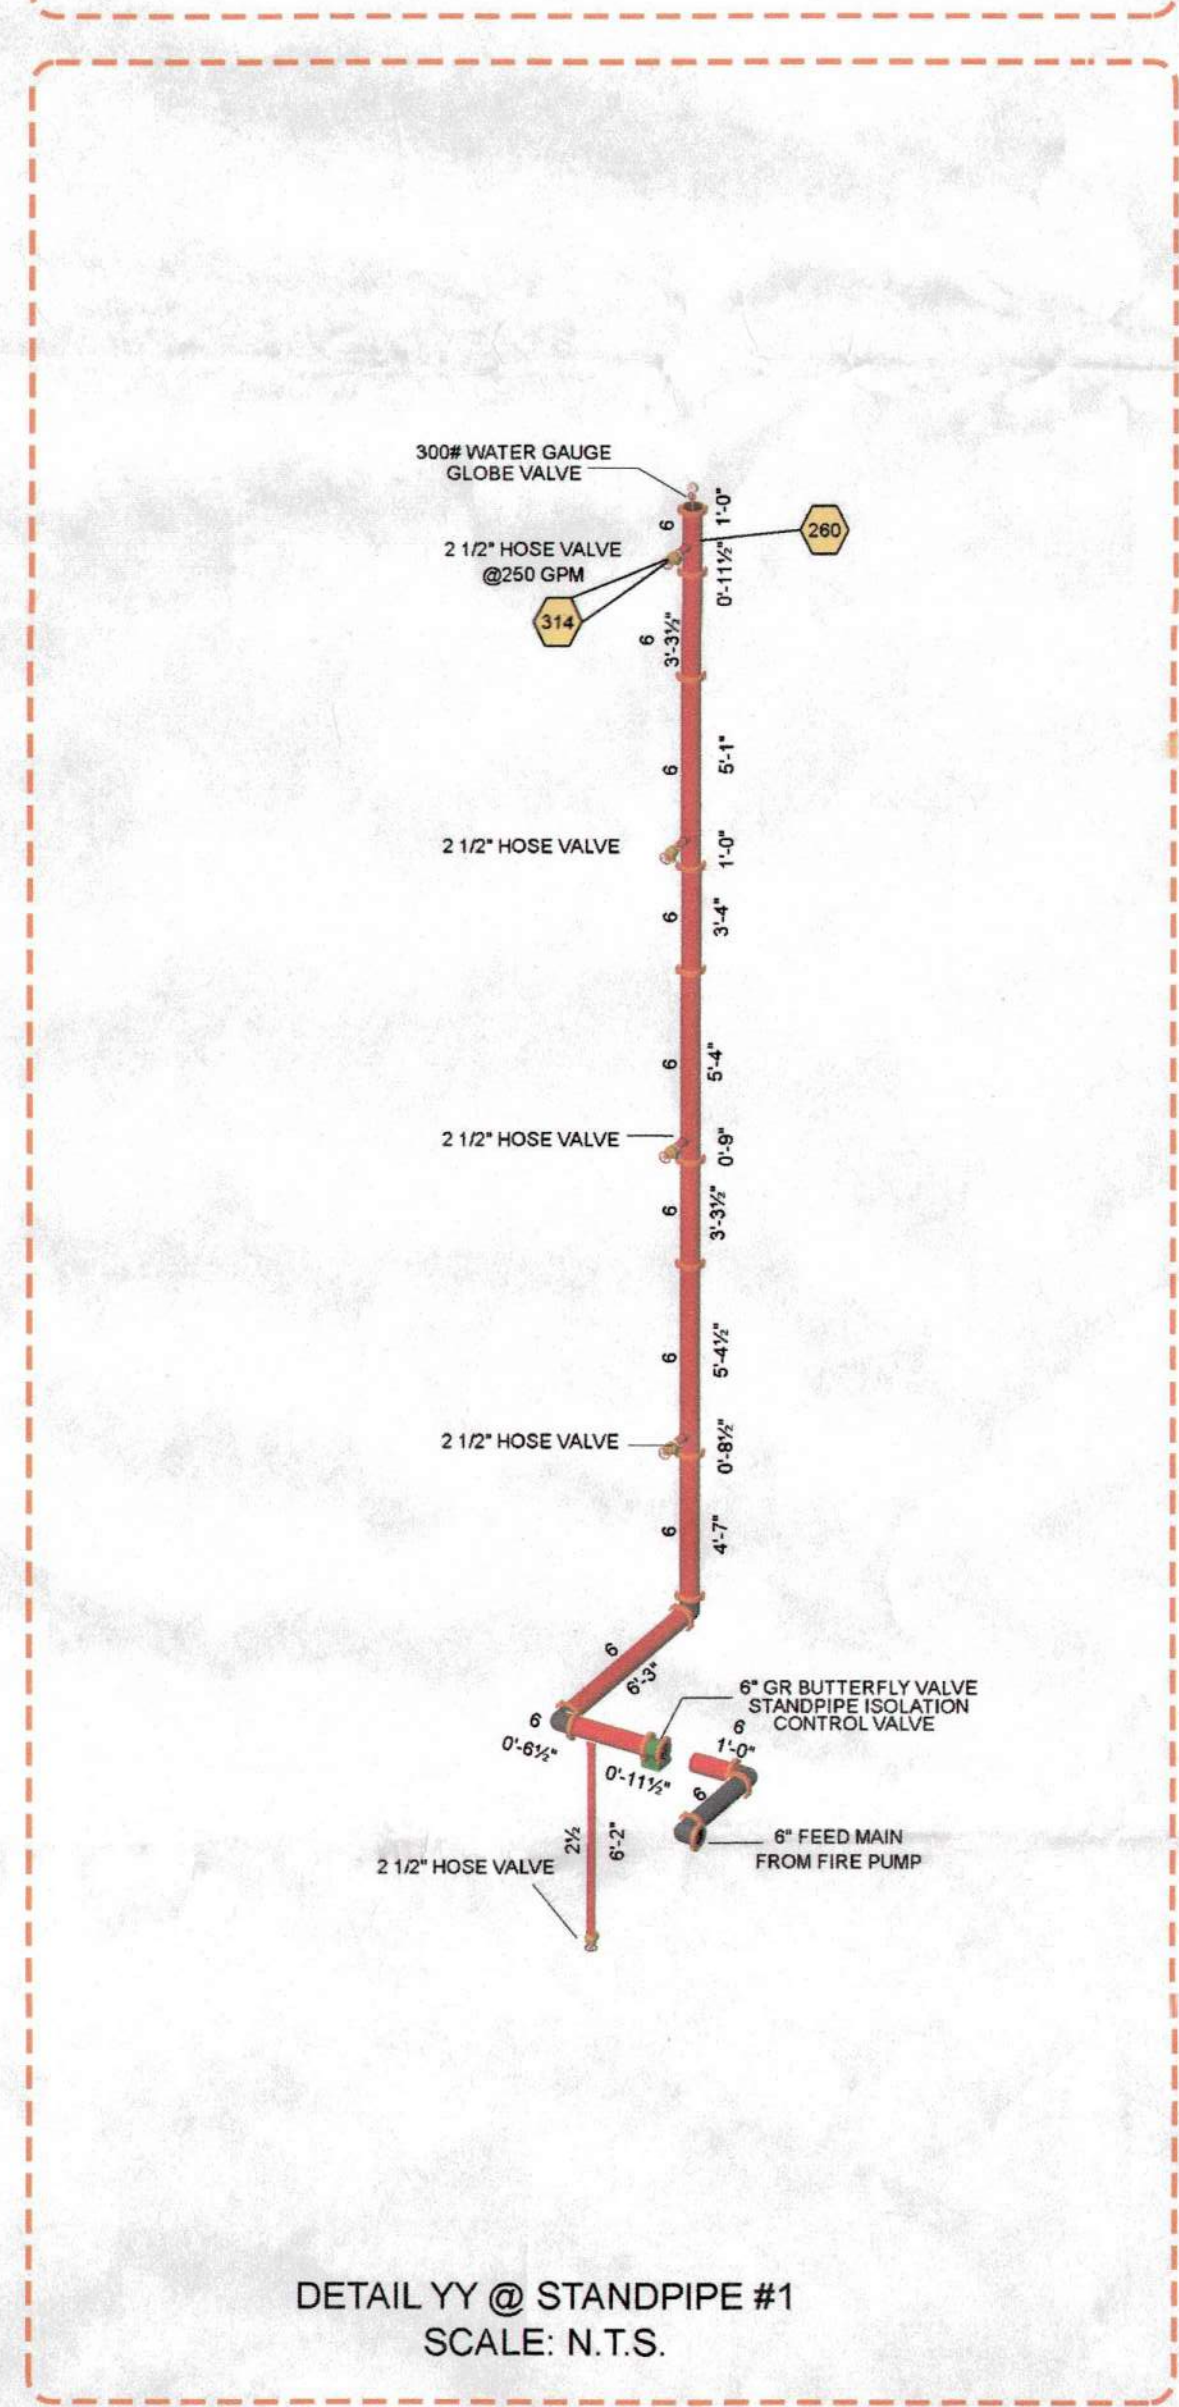
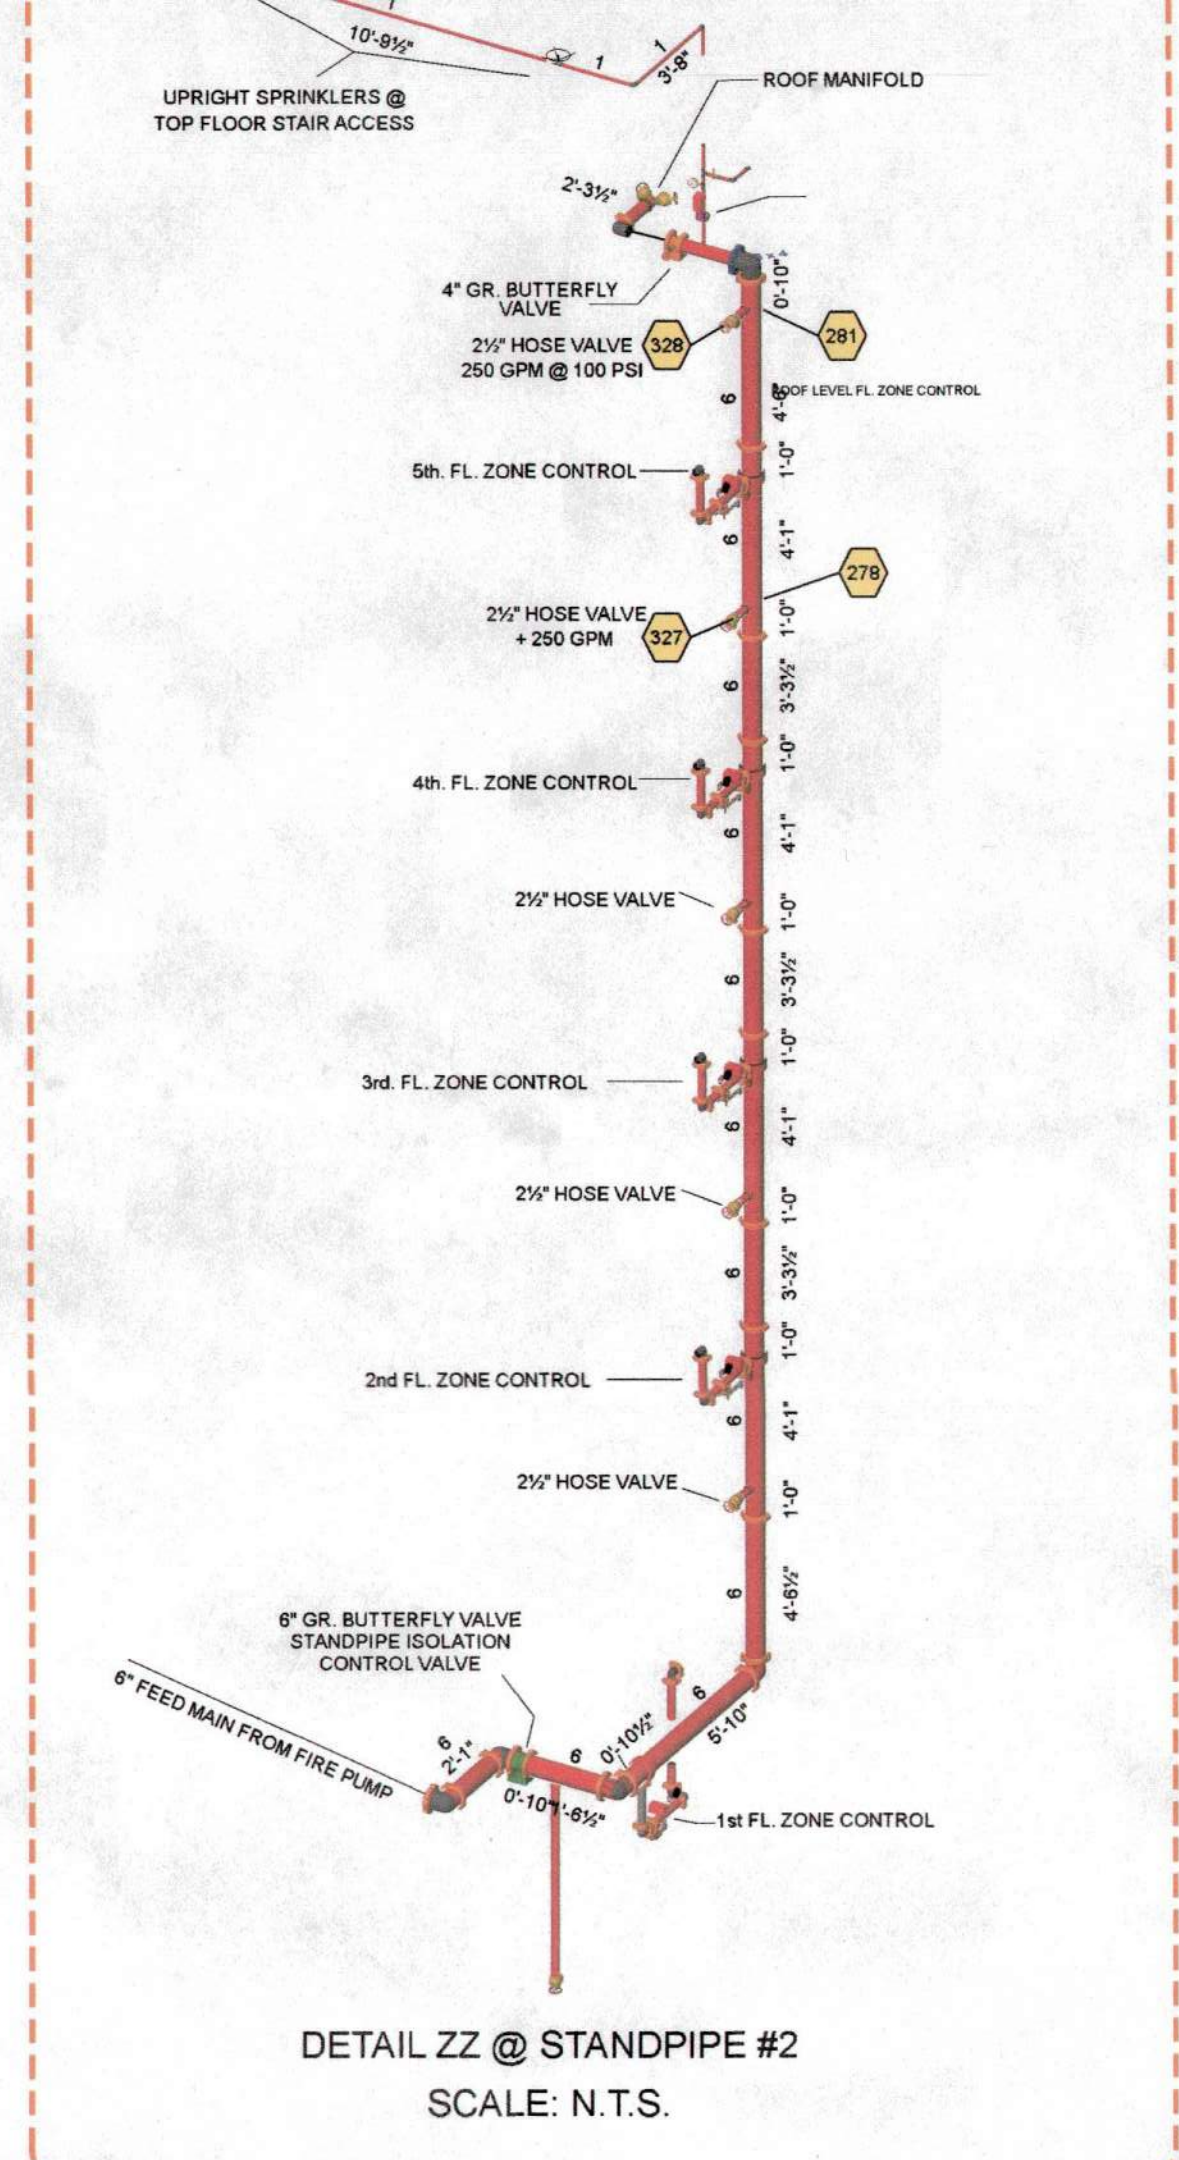
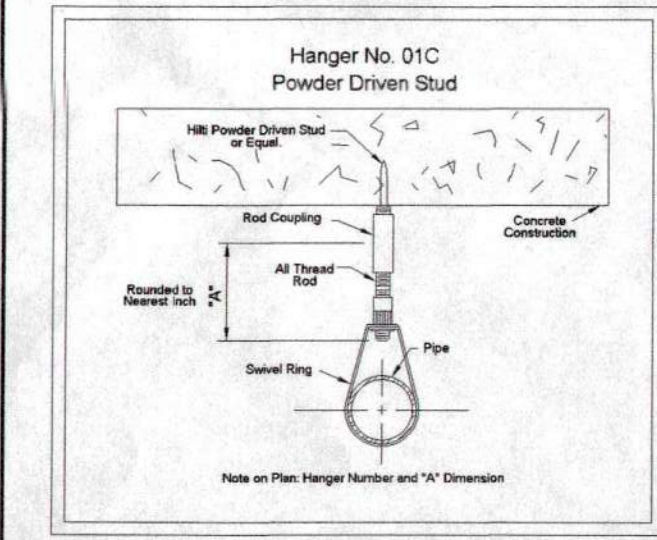


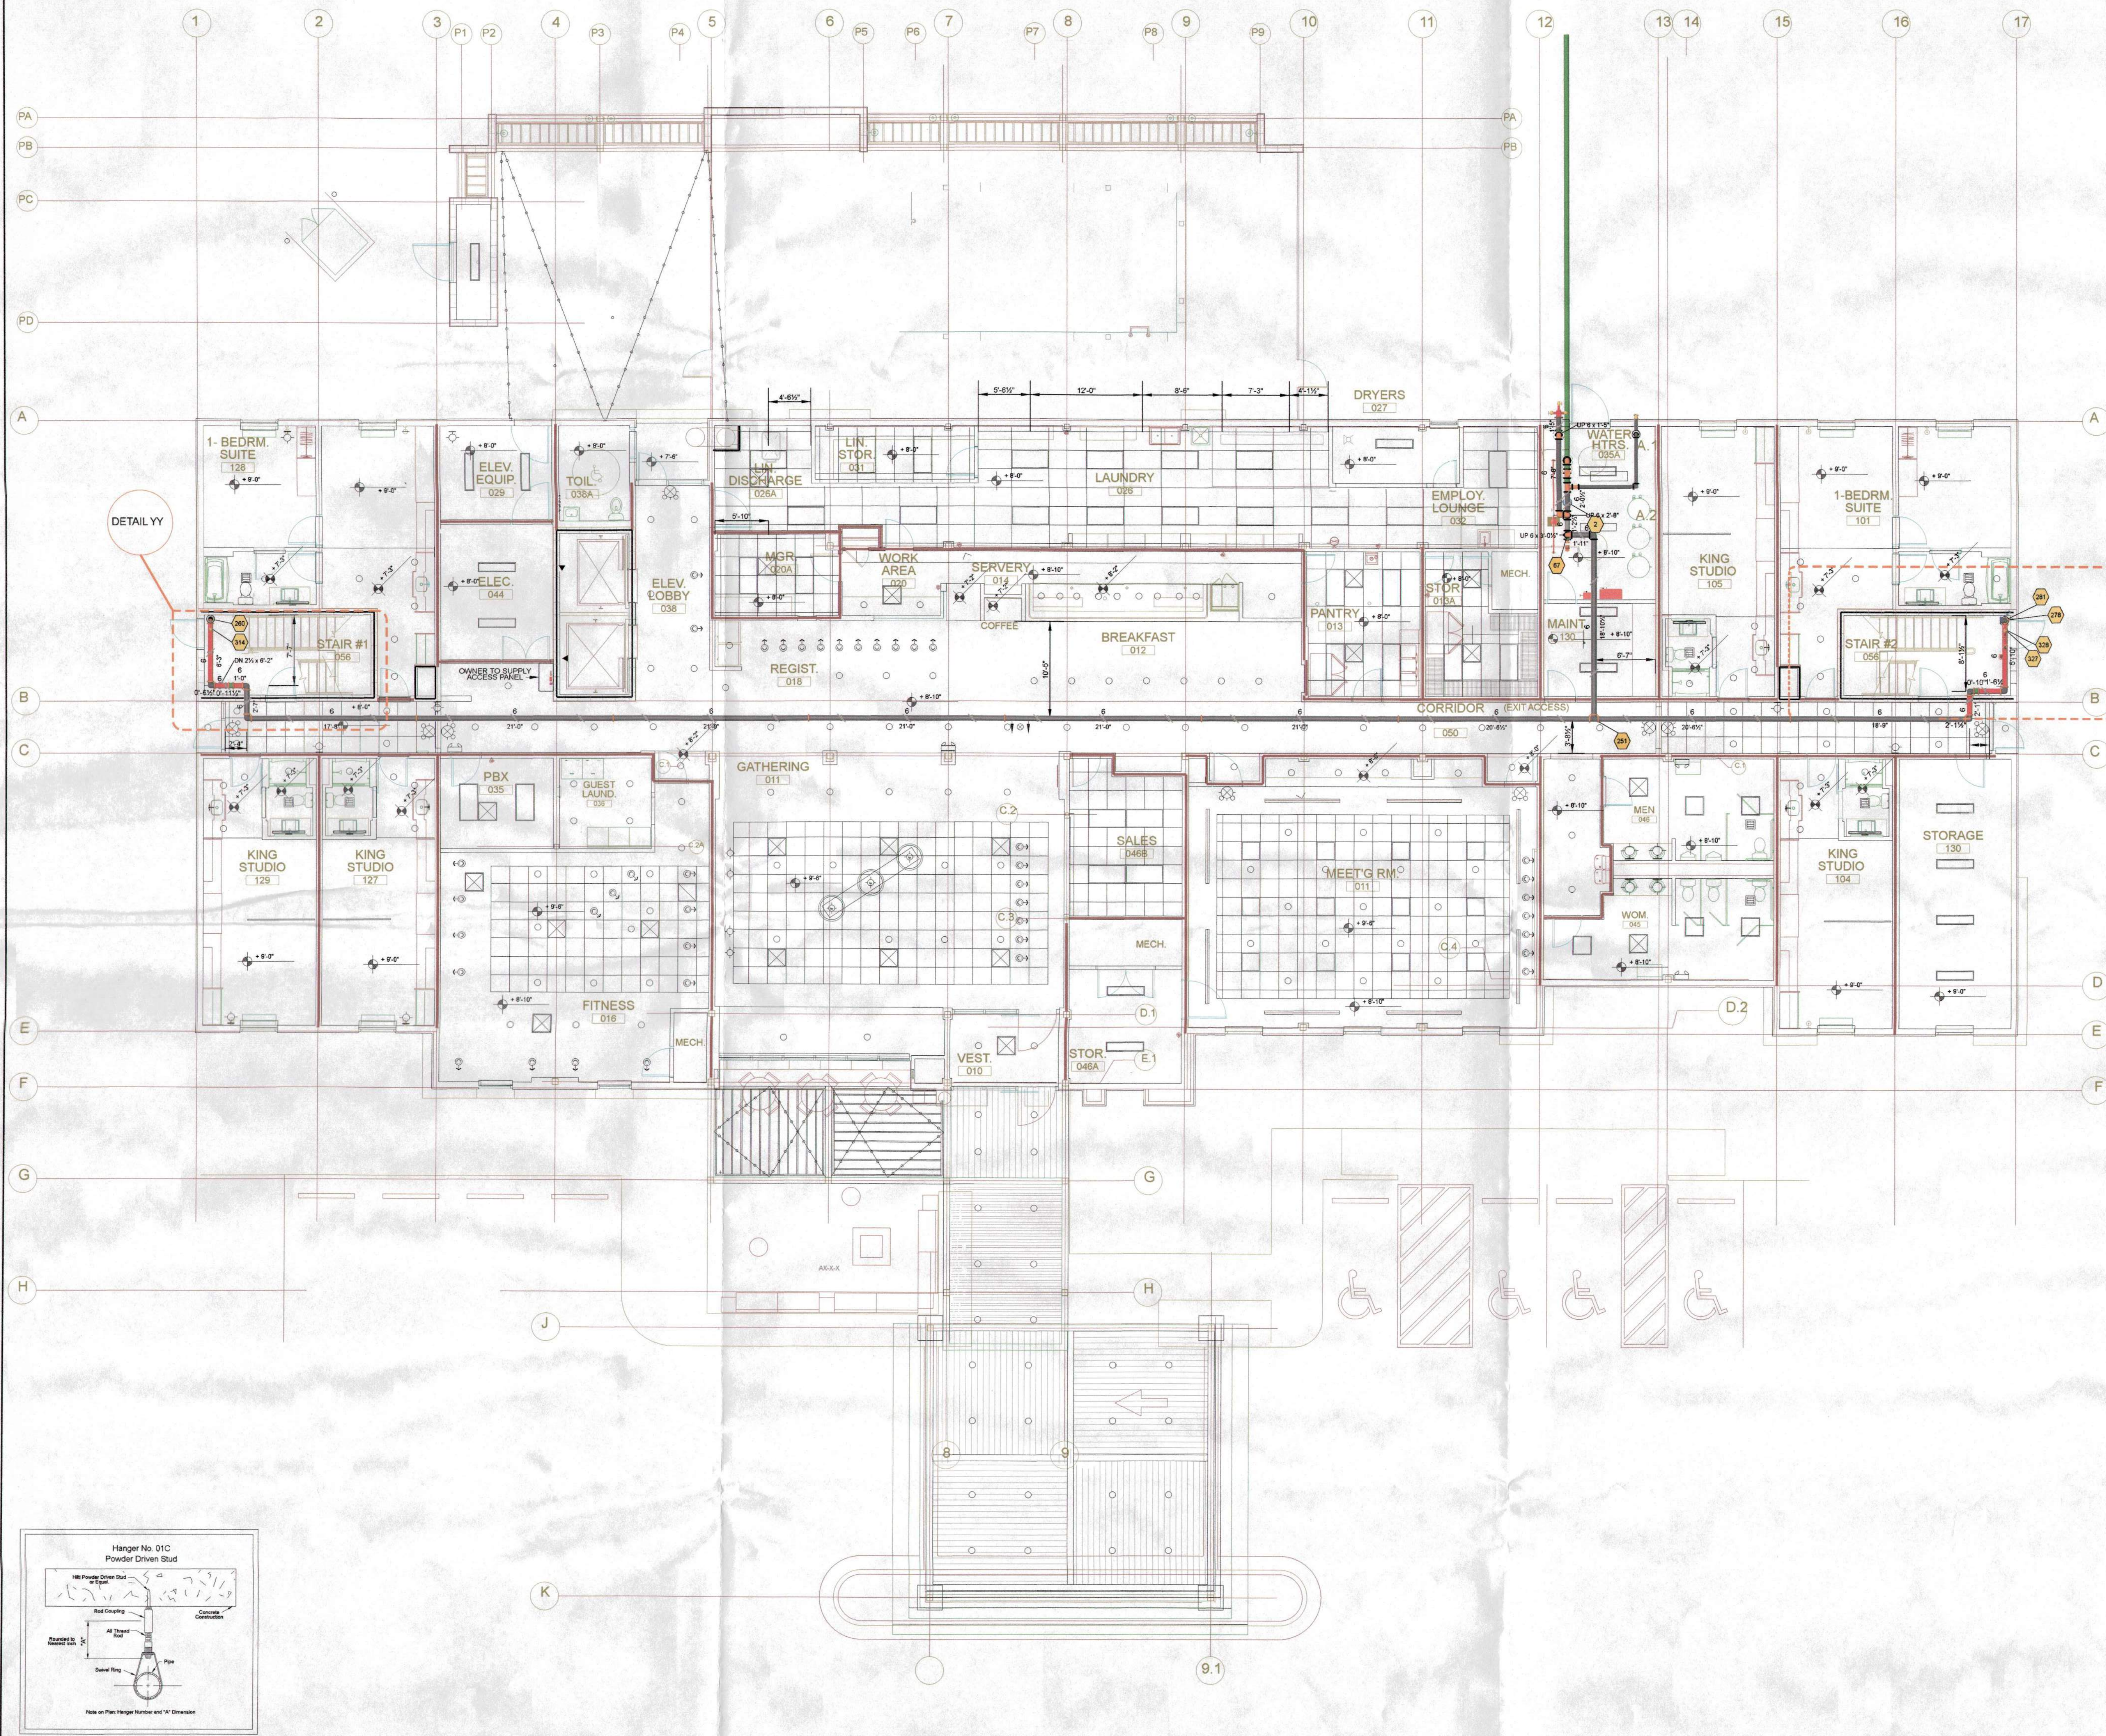

IMPORTANT


In localities subject to freezing conditions, it is the owner's responsibility to provide heat throughout wet pipe sprinkler system areas and in enclosures for dry pipe deluge and other types of valves controlling water supplies to sprinkler systems.

This drawing and the information and design application herein contained is the property of VFP Fire Systems, Inc. and is loaned upon the express condition that the same be returned to VFP upon request; all information herein shall be treated as secret and confidential; no reproduction of this drawing or any part thereof shall be made without the written consent of VFP.

PAUL M. GIFFORD
NICET LEVEL 4
Paul M. Gifford
CERTIFICATION NO. 81305

STATE OF MS.
PERMIT NO.
11749-SC

REV. NO.	DESCRIPTION	BY	DATE
1	ADDED ROOF MANFOLD TO STANDPIPE AT ROOF ACCESS LEVEL	CJ	07-20-2017

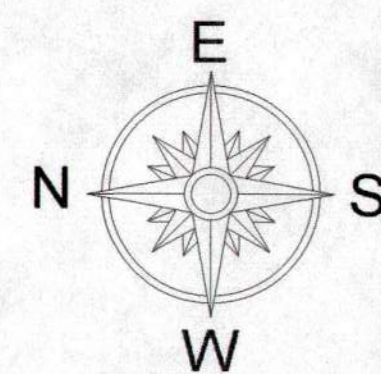

SYSTEM TYPE	
WET	6" ☒ DELUGE ☐
DRY	☐ PREACTION ☐
APPROVALS	
☐ SPM	OUT IN
☐ IRI	OUT IN
☐ FMGLOBAL	OUT IN
☒ OWNER	OUT IN
☒ CITY OF FLOWOOD	OUT IN

STANDPIPE	
SYSTEM DESIGN DATA	
HAZARD CLASSIFICATION	SYSTEM AREA
HYDRAULIC DESIGN DATA	HOSE ALLOWANCES 250 GPM
AREA OF APPLICATION	SEE HYDRAULIC NOTES
TOTAL SYSTEM REQUIREMENTS	WATER SUPPLY: STATIC PRESSURE: 155 PSI
FLOWING: 750 GPM	RESIDUAL PRESSURE: 131 PSI
LOCATION: OLD FANNIN RD @ HOSPITALITY DR	WATER SUPPLY TESTED BY: COMBINED CITY AND FIRE PUMP RATED CAPACITY
FLOWOOD, MS.	02/07/2017

CONTRACT NAME:	HOME2 SUITES BY HILTON	1/8" = 1'-0"
CONTRACT NO.:	787405	DATE: 02/02/2017
CITY:	FLOWOOD, MS	DRAWN BY: L FICKLING
CHECK BY: JD HOWARD		
DRAWING NO. FPO		
6161-F RANGELINE RD. THEODORE, AL 36682 PH: (251) 443-7234	P.O. Box 190997 MOBILE, AL 36619 Fbx (251) 443-7252	