


LIGHTNING PROTECTION SYSTEM:

THE CONTRACTOR SHALL FURNISH AND INSTALL ALL LABOR, MATERIALS, EQUIPMENT, AND SERVICES TO PROVIDE A COMPLETE LIGHTNING PROTECTION SYSTEM ON THIS BUILDING. THE SYSTEM SHALL INCLUDE ROOF MOUNTED AIR TERMINALS, INTERCONNECTING CONDUCTORS, DOWNLEADS TO GROUND,

APPROPRIATE GROUND TERMINALS, INTERCONNECTING CONDUCTORS, GROUNDING BUILDING SYSTEMS THAT WILL COMPLY WITH THE CURRENT EDITION OF THE NATIONAL FIRE PROTECTION ASSOCIATION LIGHTNING CODE NO. 78. A REPRESENTATIVE OF THE OWNER AND THE INSTALLING CONTRACTOR SHALL COMPLETE THE LIGHTNING PROTECTION INSTITUTE INSPECTION REPORT DURING CONSTRUCTION.

ANY COMPONENTS OR METHODS FOUND NOT IN COMPLIANCE WITH THIS SPECIFICATION SHALL BE REPAIRED OR REPLACED AT THE SATISFACTION OF THE OWNER'S REPRESENTATIVE BEFORE SUBMITTAL OF THE LPI INSPECTION REPORT AND DELIVERY OF THE LPI CERTIFIED SYSTEM LABEL.

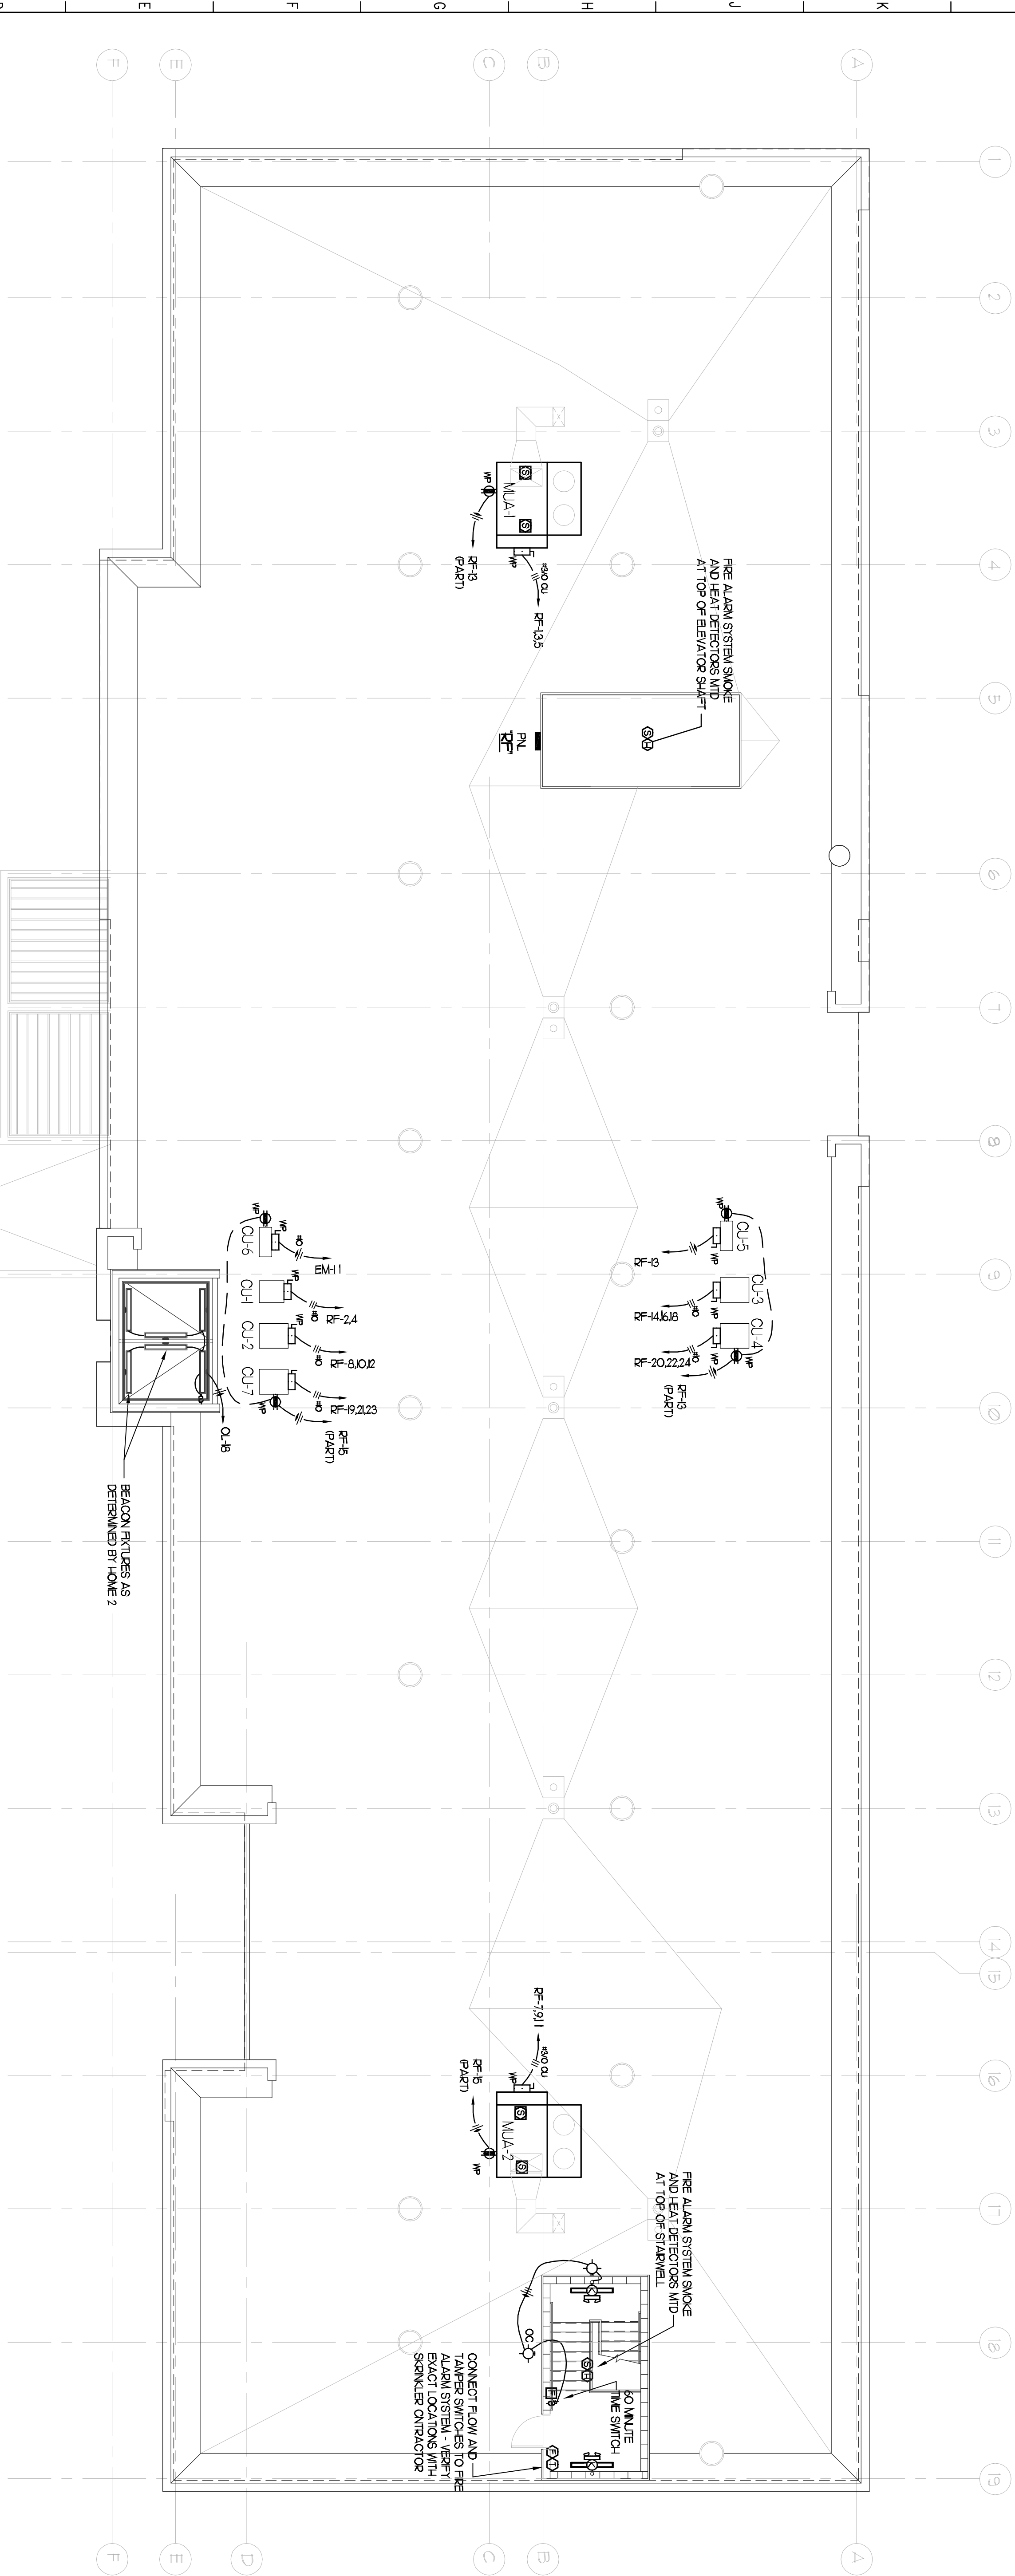


GENERAL MECHANICAL EQUIPMENT WIRING NOTES:


1. PROVIDE RECESSED J-BOX AND CONDUIT TO CEILING FOR THERMOSTATS AS REQUIRED BY MECHANICAL TRADES.
2. SEE PANELBOARD SCHEDULES FOR CIRCUIT NUMBER INFORMATION.
3. PROVIDE DISCONNECTS AS SHOWN IN SCHEDULE WITH FLEXIBLE CONNECTION TO VIBRATING EQUIPMENT; MOUNT DISCONNECT ADJACENT TO EQUIPMENT.
4. WHILE THE EQUIPMENT SHOWN IS BELIEVED TO BE ACCURATE, VERIFY WIRING AND OVERCURRENT PROTECTION REQUIREMENTS AS INDICATED BY MANUFACTURER ON ACTUAL EQUIPMENT INSTALLED. NO WORK SHALL BE DONE UNTIL ALL REQUIREMENTS HAVE BEEN ACCORDINGLY PROVIDED. PROVIDE VEHICULAR DISCONNECTS FOR ALL OUTSIDE UNITS.

ROOF ELECTRICAL PLAN

SCALE: 1/8"=1'-0"



Richard Molenaar
ARCHITECT

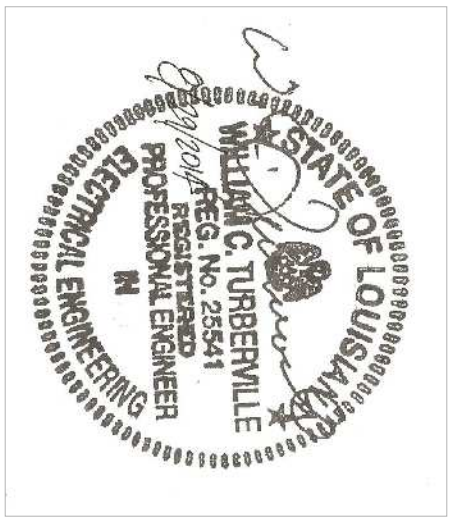

W Maine Street West Monroe, Louisiana

SHEET TITLE:
ROOF ELECTRICAL PLAN

PROJECT NO.	LATEST REVISION:
PROJ#	11-12-2014
DRAWN BY: SMJ	CHECKED BY: SMJ
DATE:	
DATE:	
	E206