

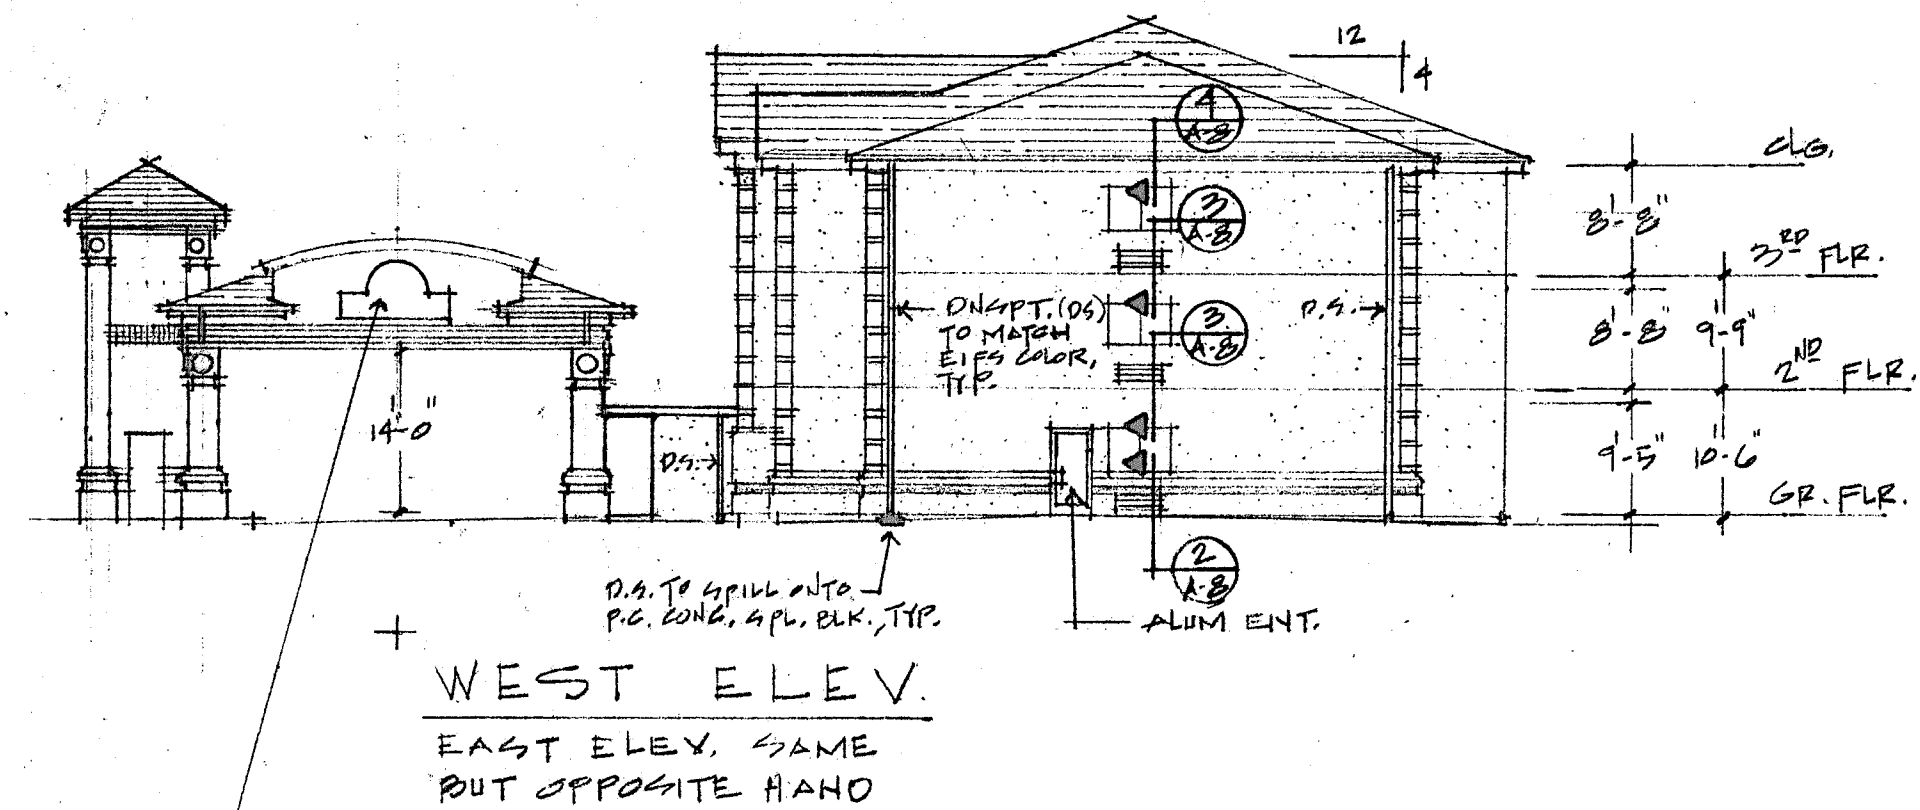
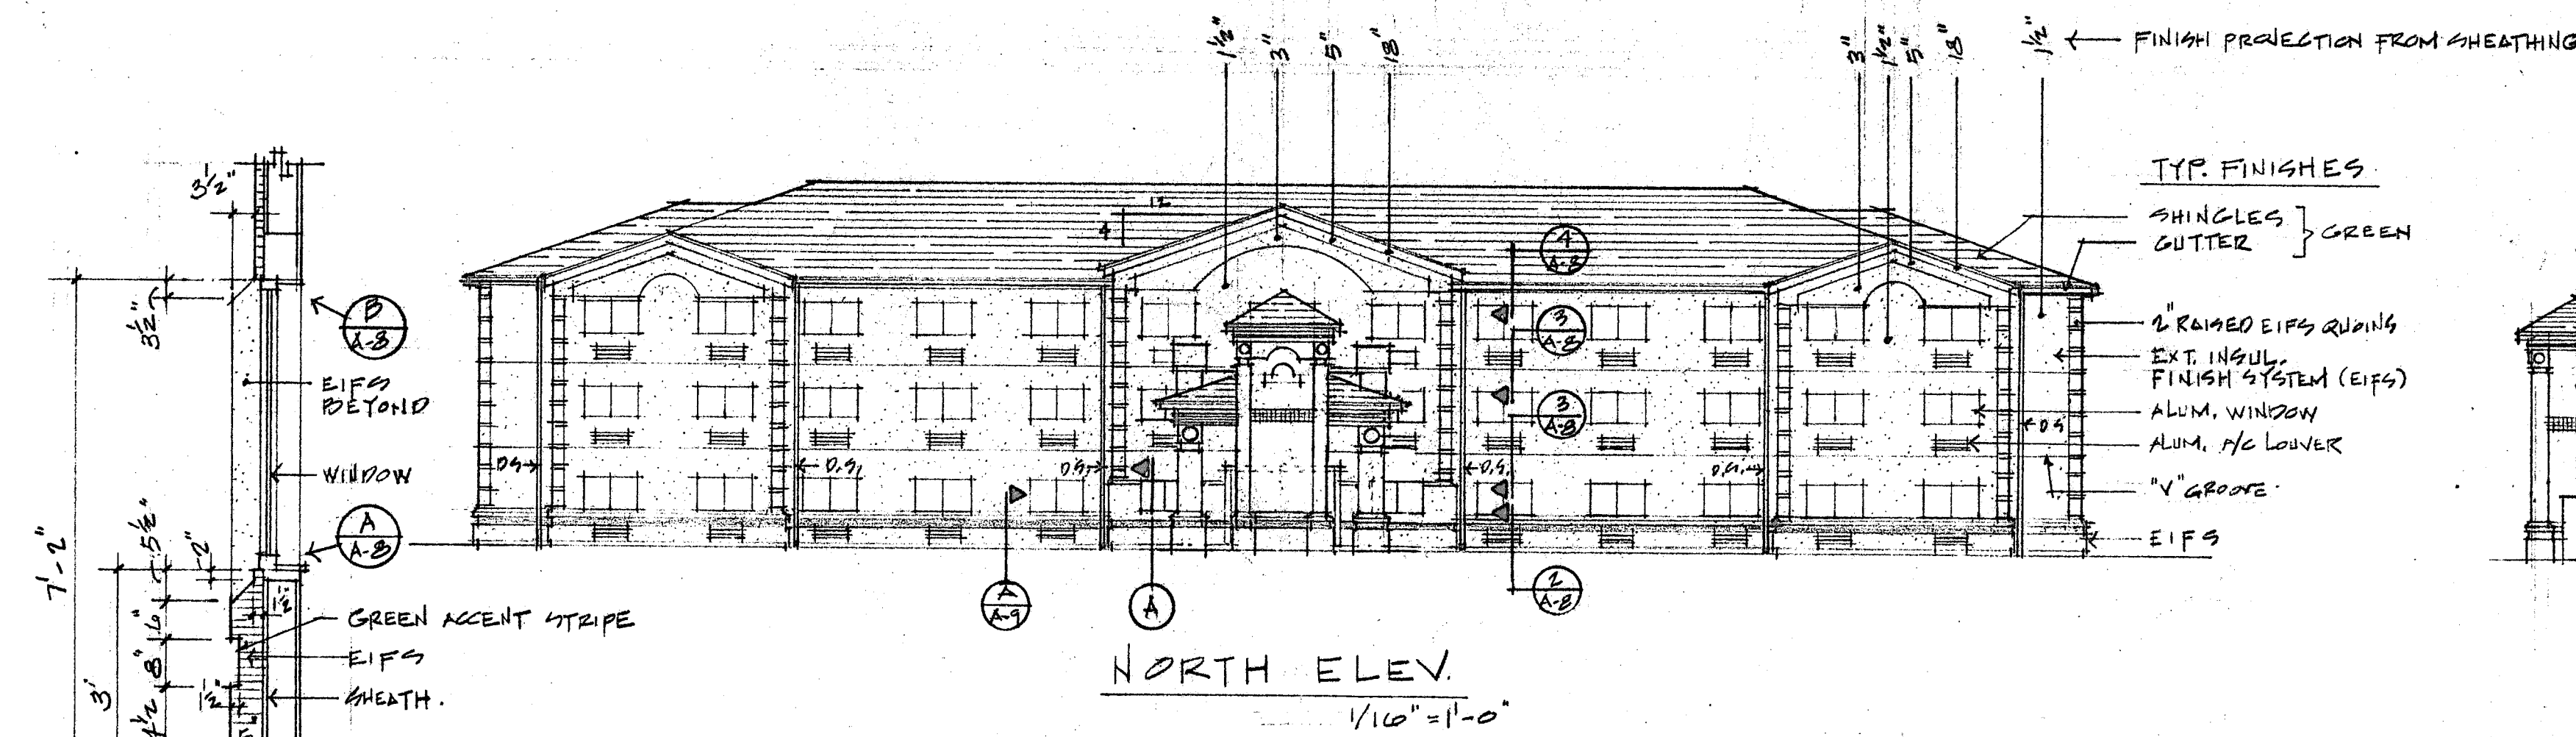
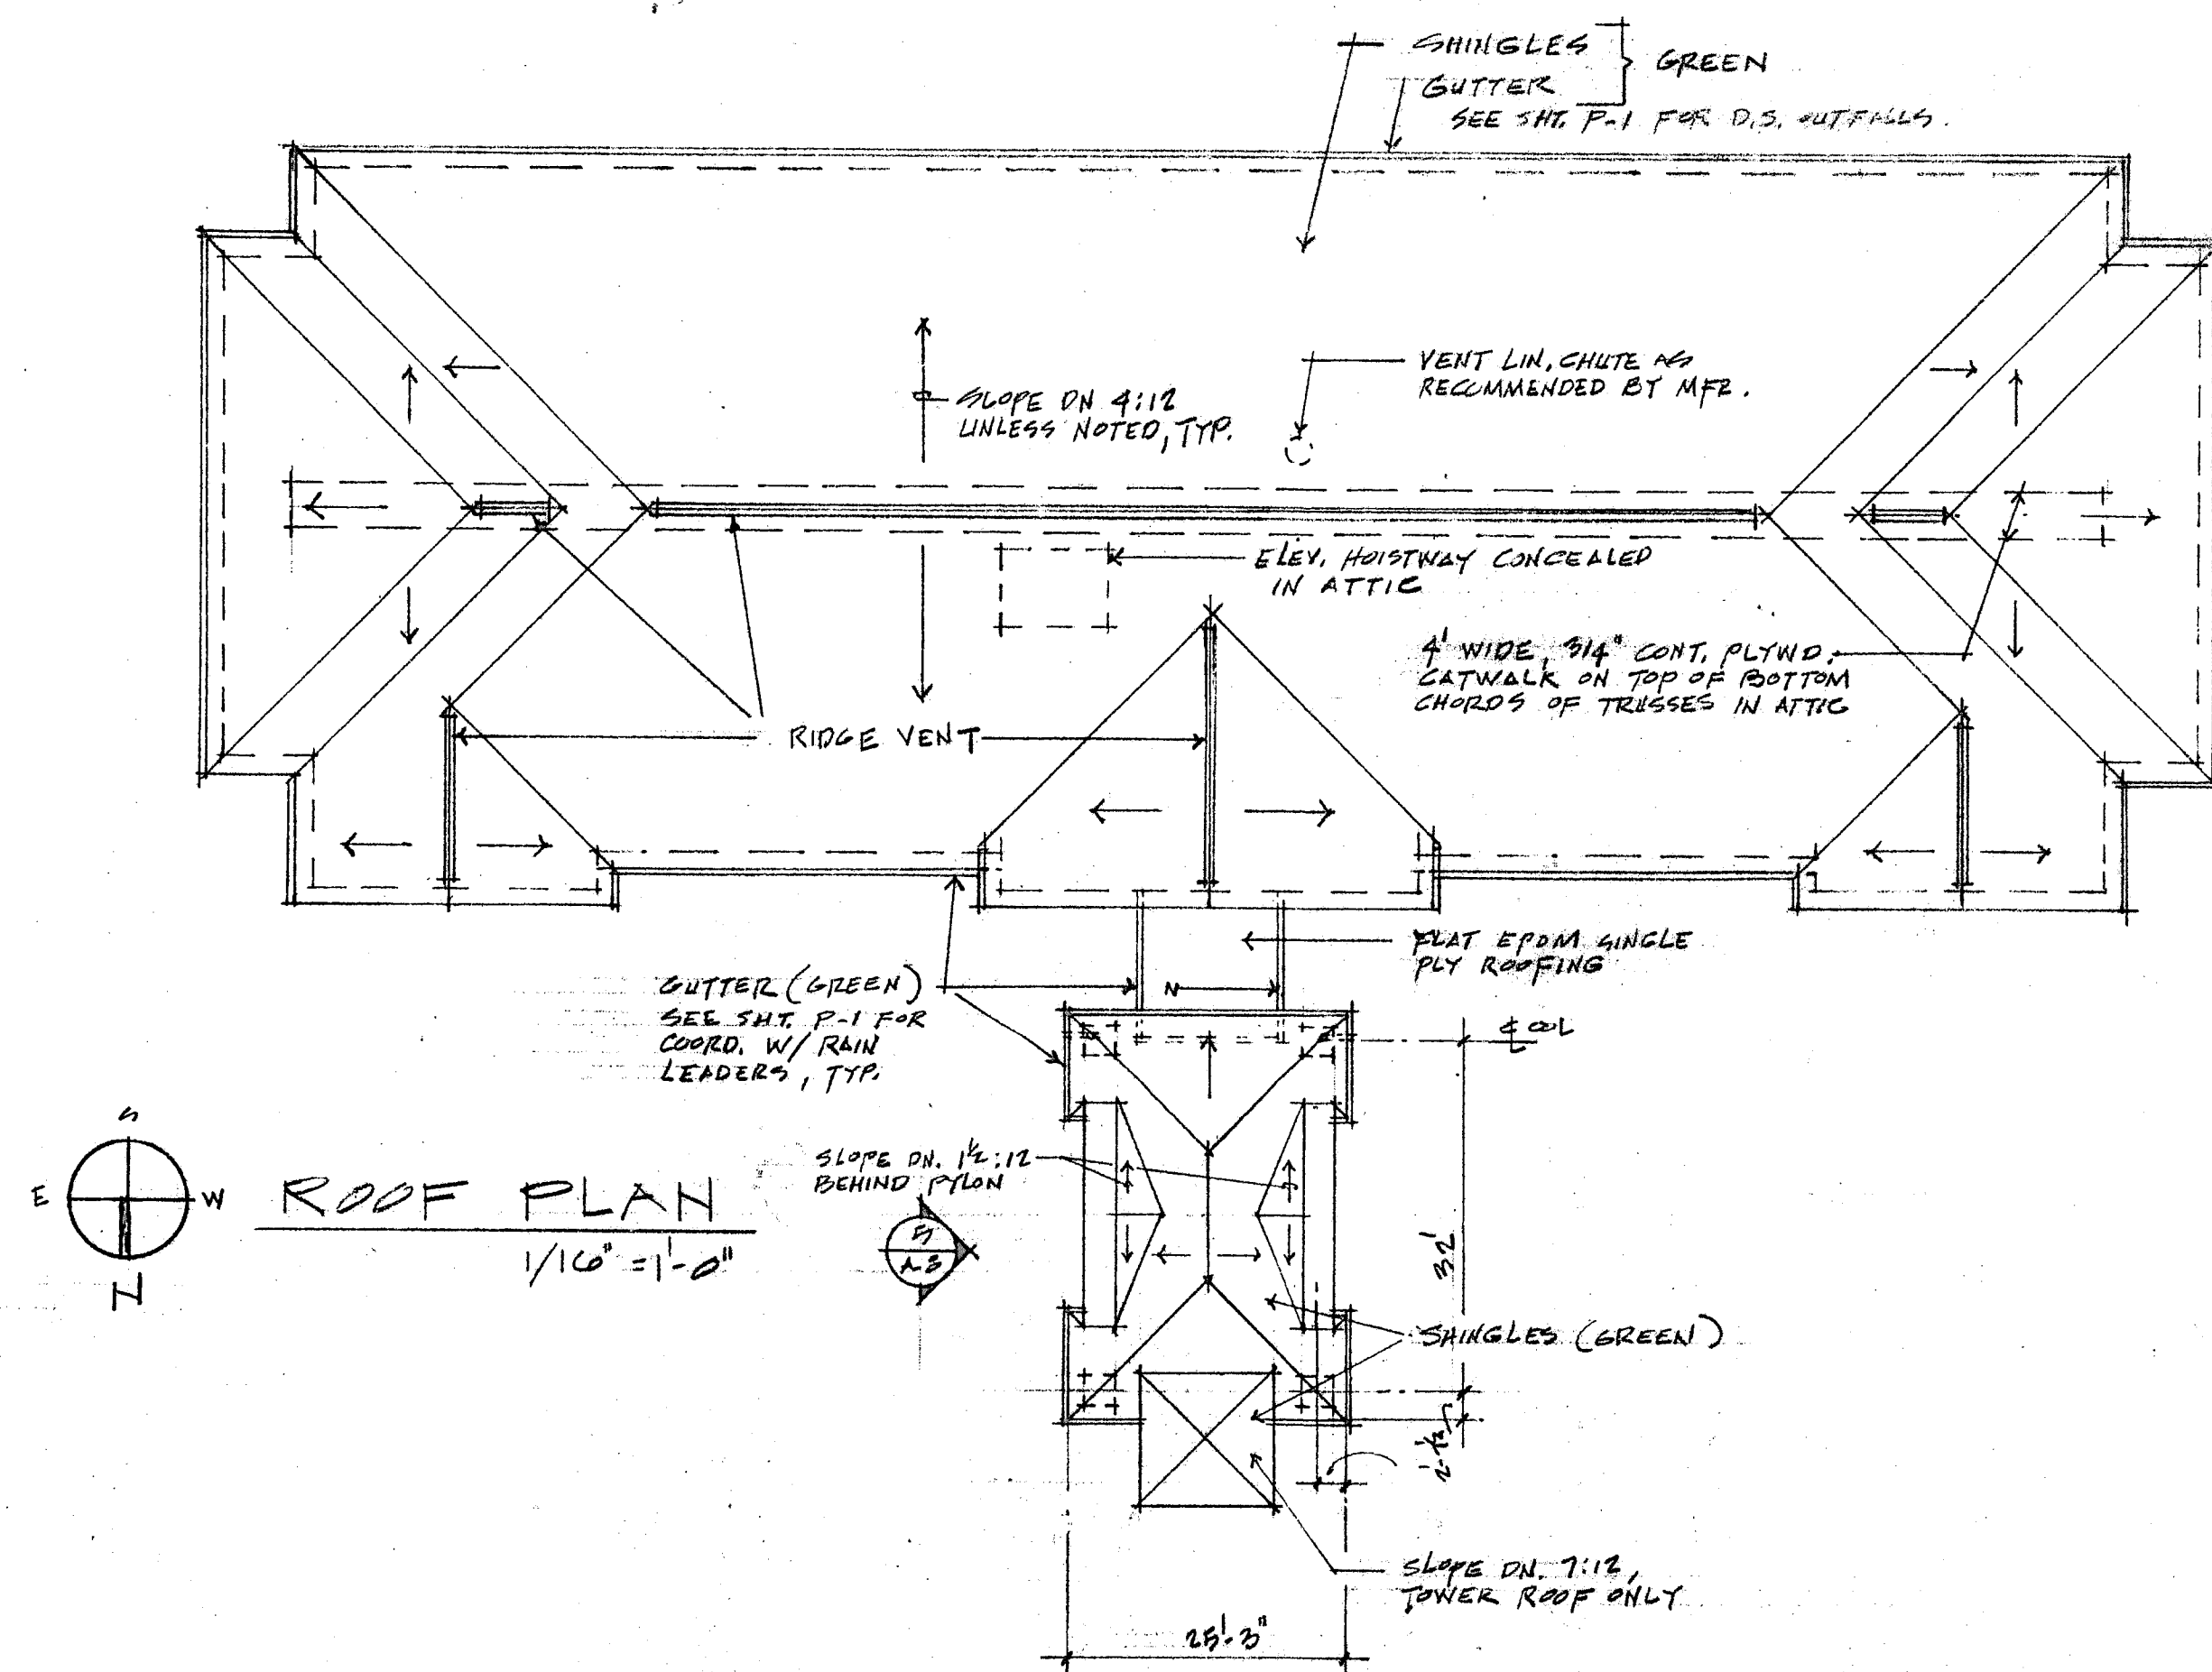


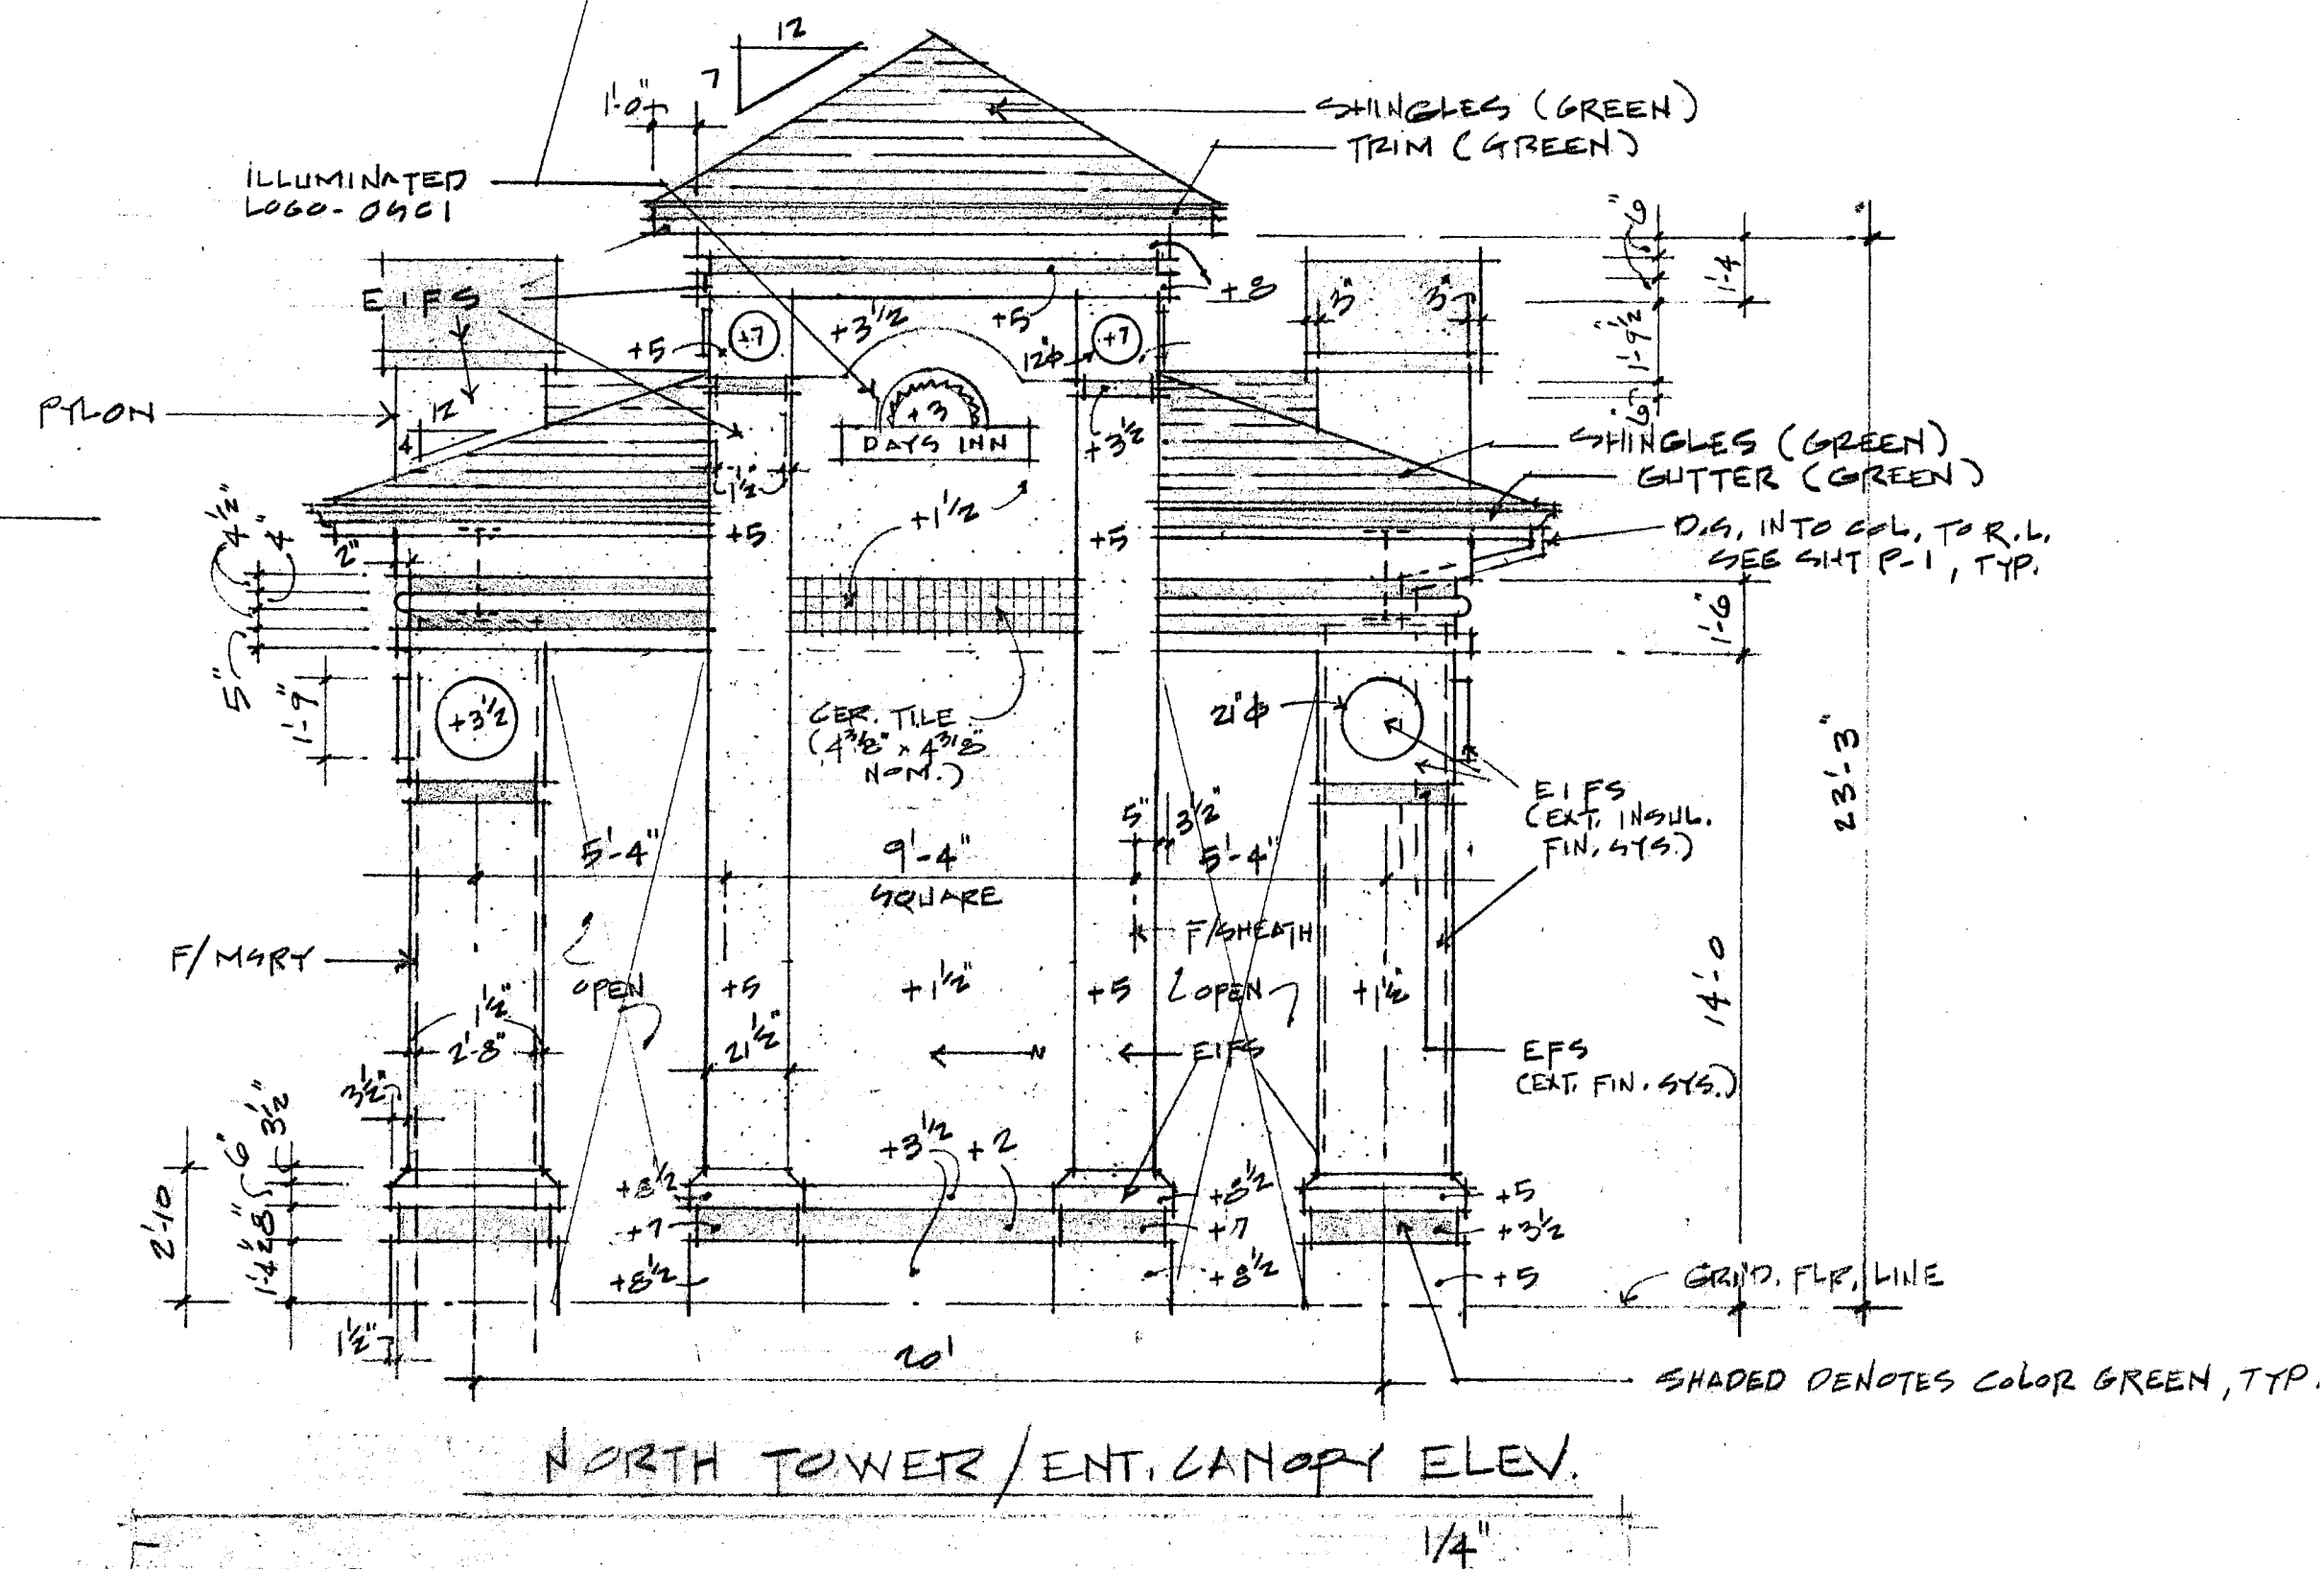

A DETAIL
1/2" = 1'-0"

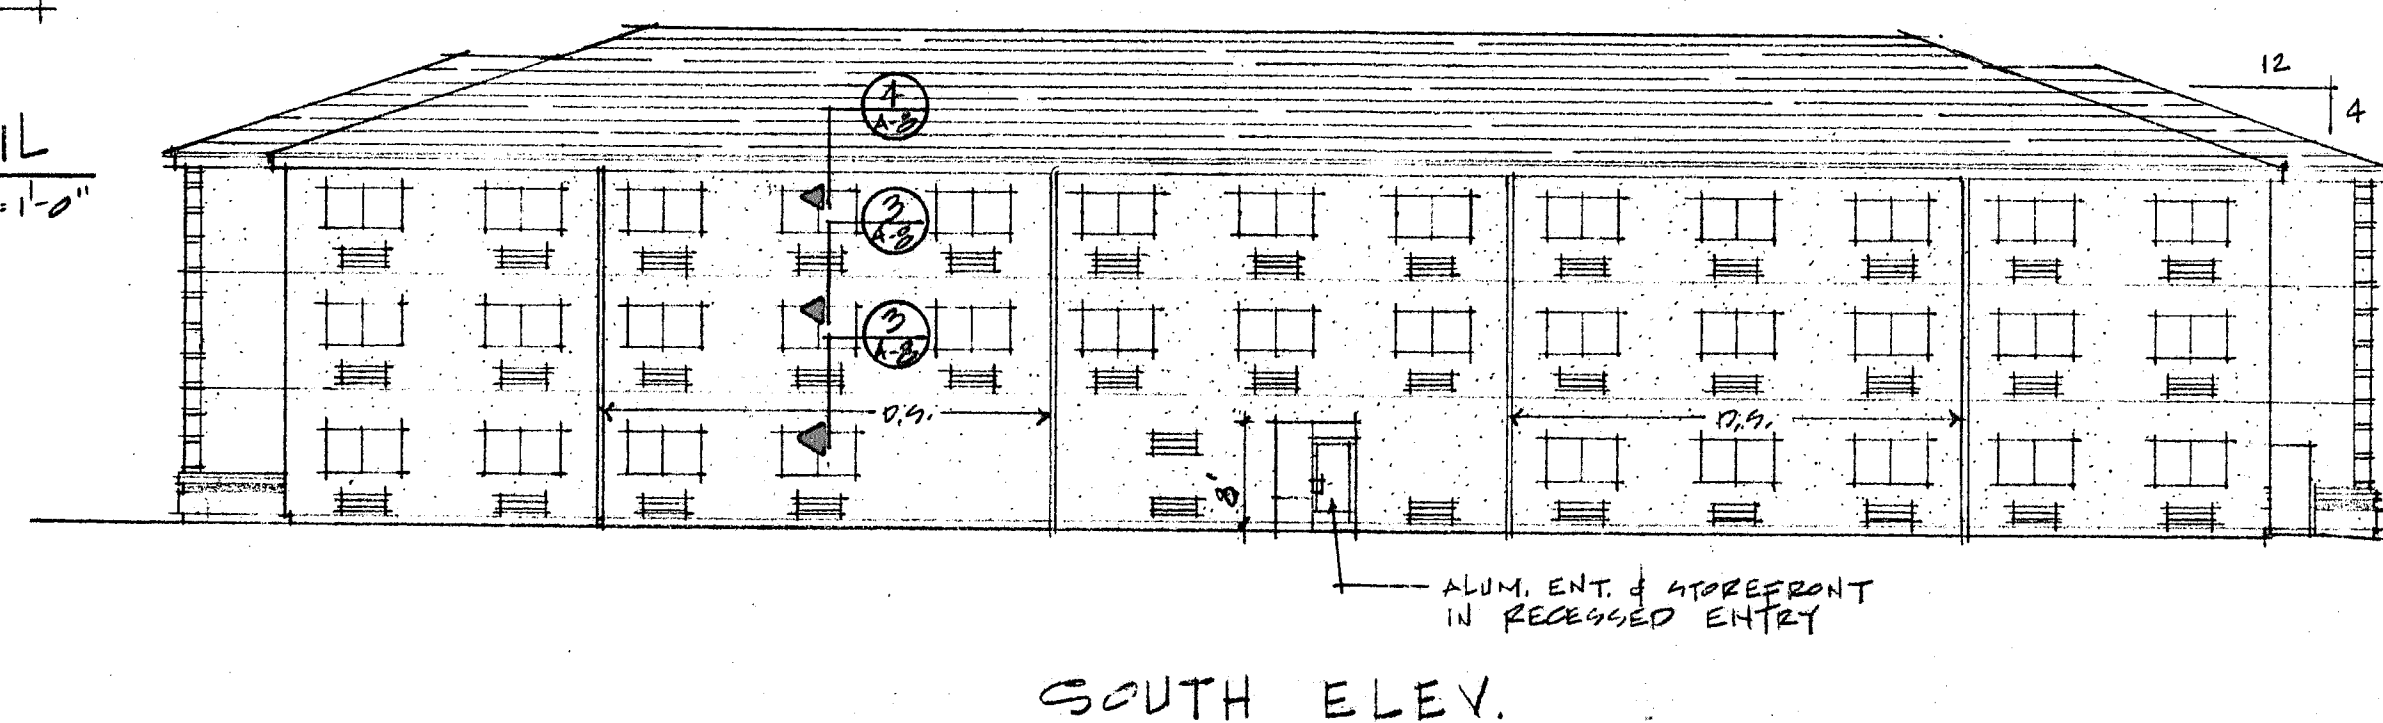

NOTES

- All finishes shall be in accordance with Days Inn standards.
Other than green accent stripe, EIFS color shall be same as that at Comfort Suites, 55 N. County Line Drive; Pearl, MS.
- Gutters and downspouts to be sizes to accommodate locale.
Provide downspouts as indicated and required to properly drain all sloped roofs.
Provide precast conc. splash block, approved for use, on grade at each downspout termination where shown on Sht. P-1.

ATTIC NOTES

- Minimum required net free ventilating area shall be 1/300 of the area of the attic. 50% of the required ventilating area shall be provided by ventilators located in the upper portion of the attic at least 3 ft. above eave vents with the balance of required ventilation provided by eave vents.
- Draftstopping in the attic above and in line with the guest room separation walls, and one of the exit access corridor walls shall be provided consisting of not less than 1/2-in. gypsum board or plywood adequately supported. Construction shall be tightly fitted around all pipes and other assemblies piercing the draftstopping. Openings in the draftstopping to afford access to each compartment shall be self-closing.

EXCEPTIONS:

- Draftstopping is not required if automatic sprinklers are installed in the building and the attic.
- Draftstopping is not required in the attic above the entrance canopy.
- The attic above conditioned space shall be capable of being entered from below by means of a readily-accessible 1-hr B-label panel not less than 22" x 36".



RICHARD MOLENAAR
ARCHITECT

DAYS INN

PEARL, MS.

ELEVATIONS &
ROOF PLAN
1/16" = 1'-0"

97006
3-25-99
A-4