
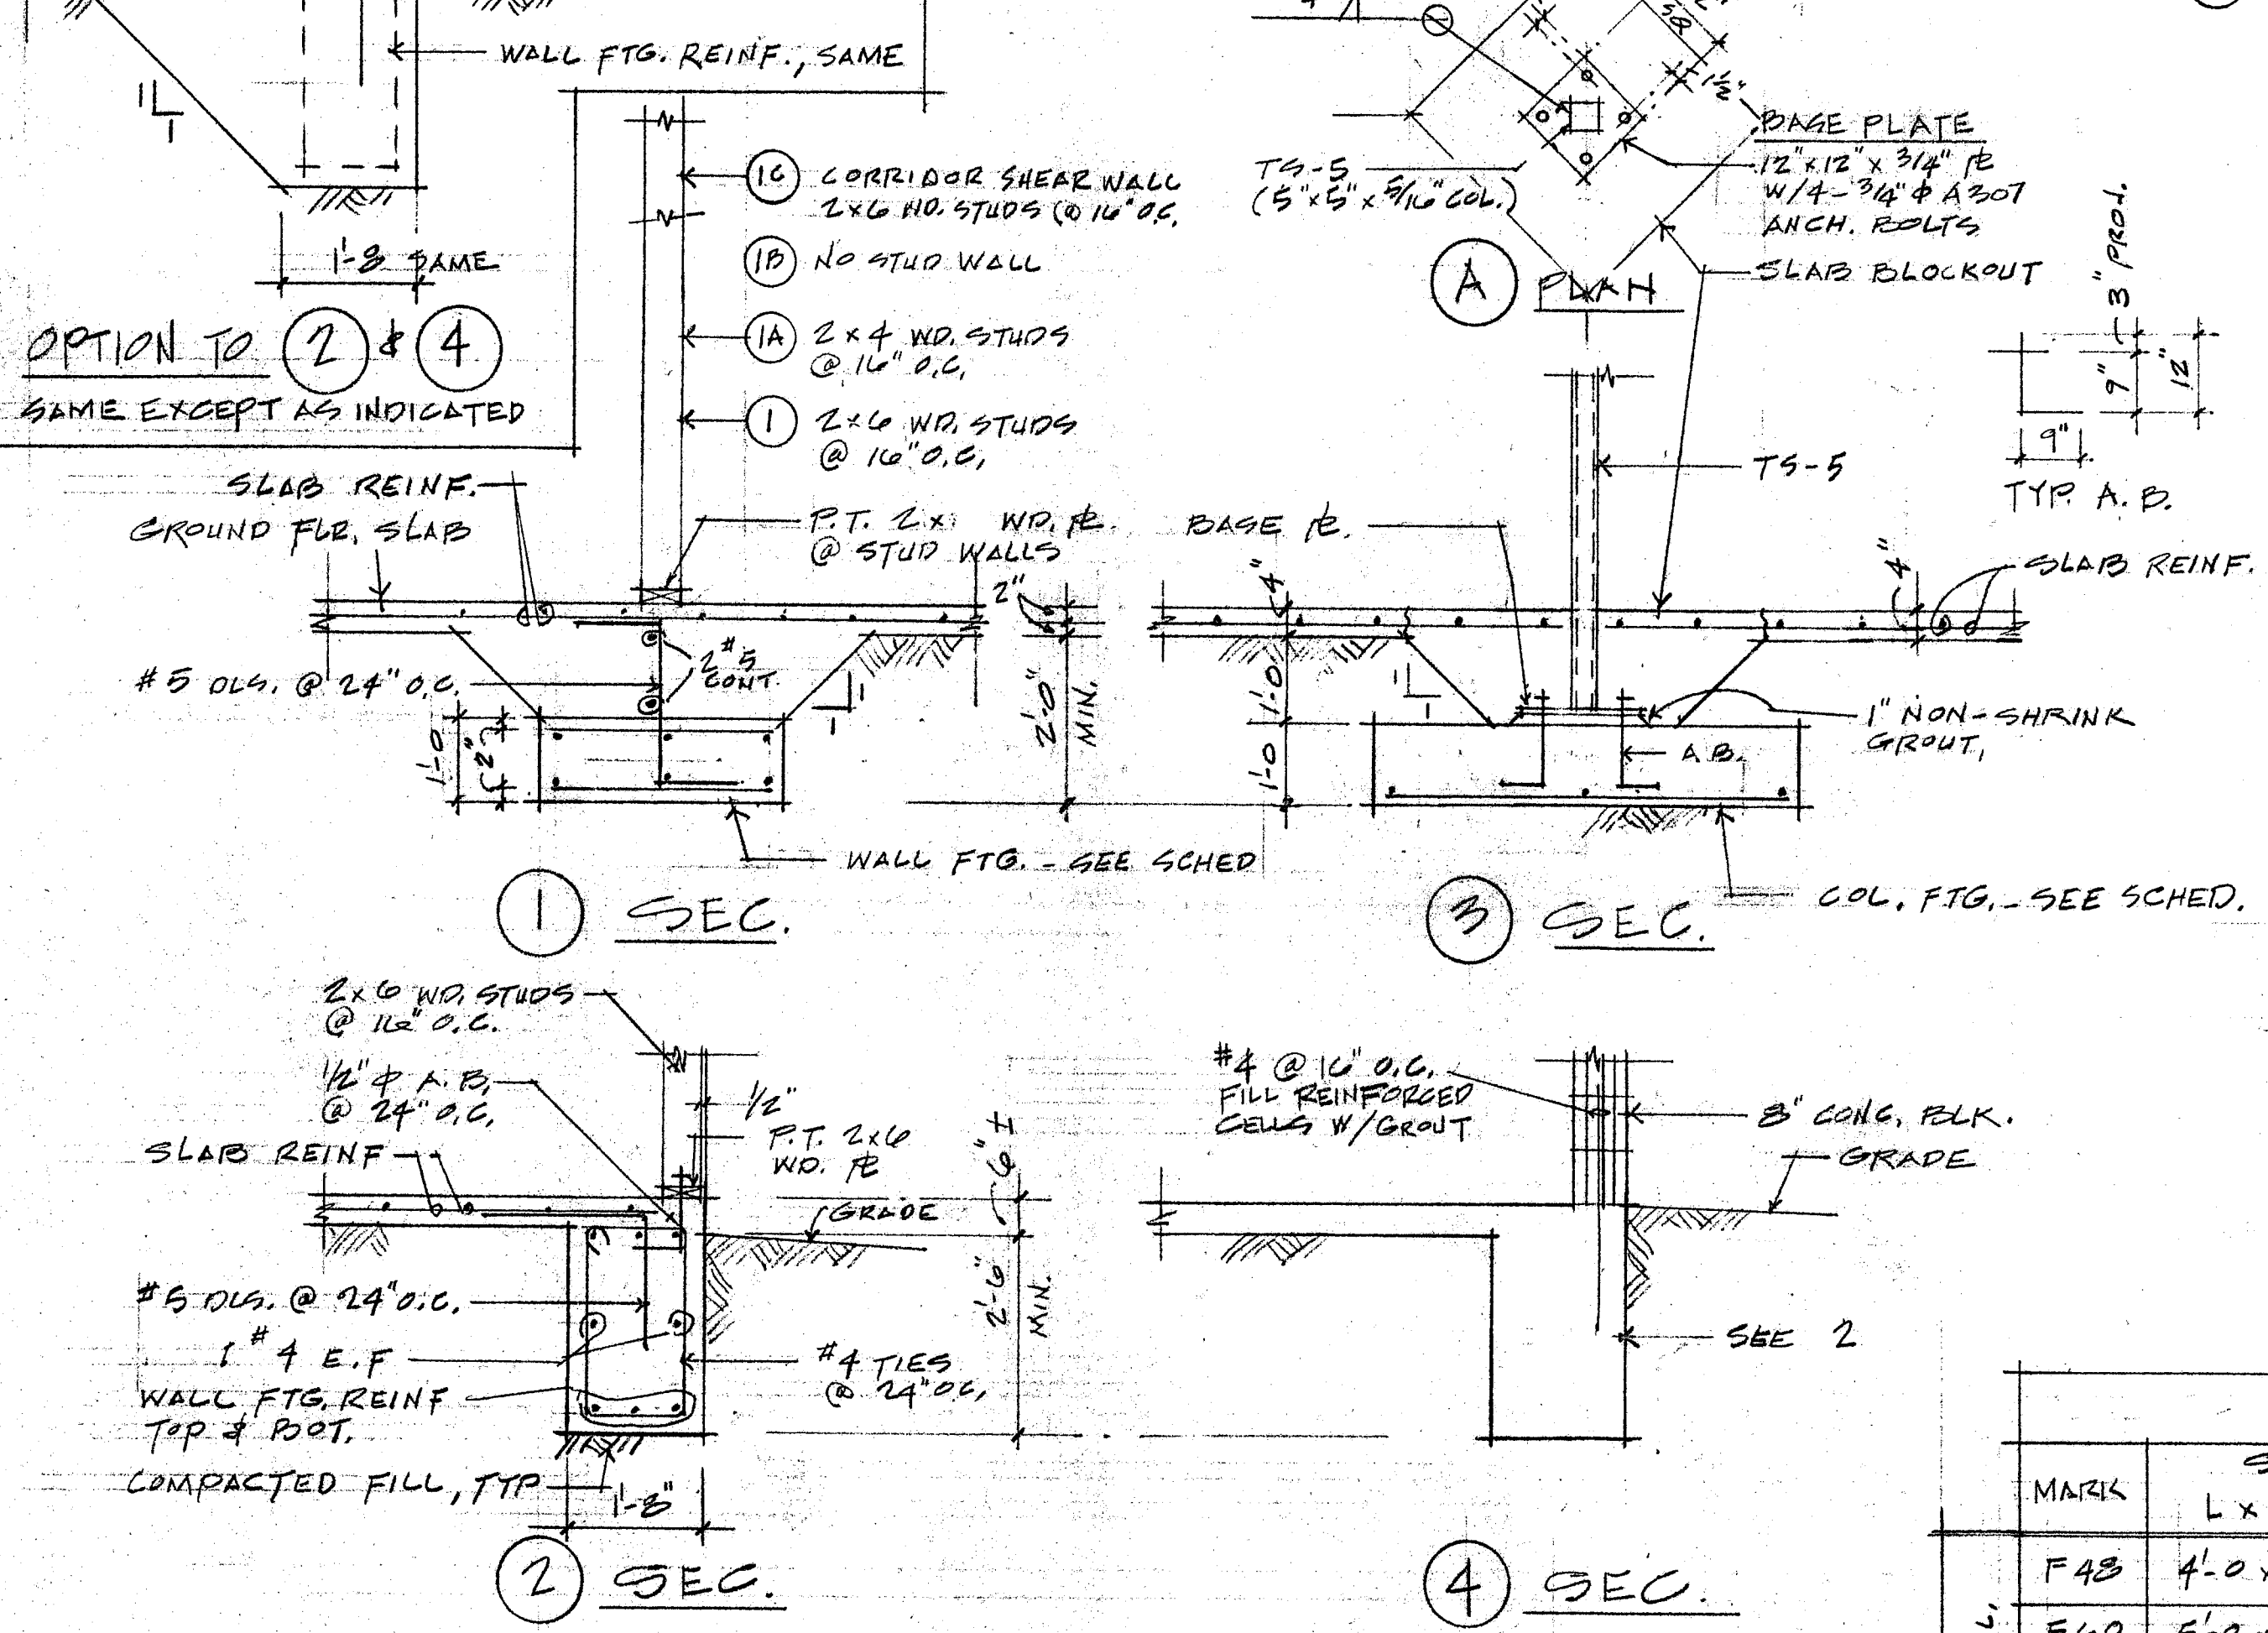


MARK	SIZE	REIN.	REMARKS
M1	6'-0" x 16" CMU	12#5 VERT. #2 @ 5" TIES (4/SET)	

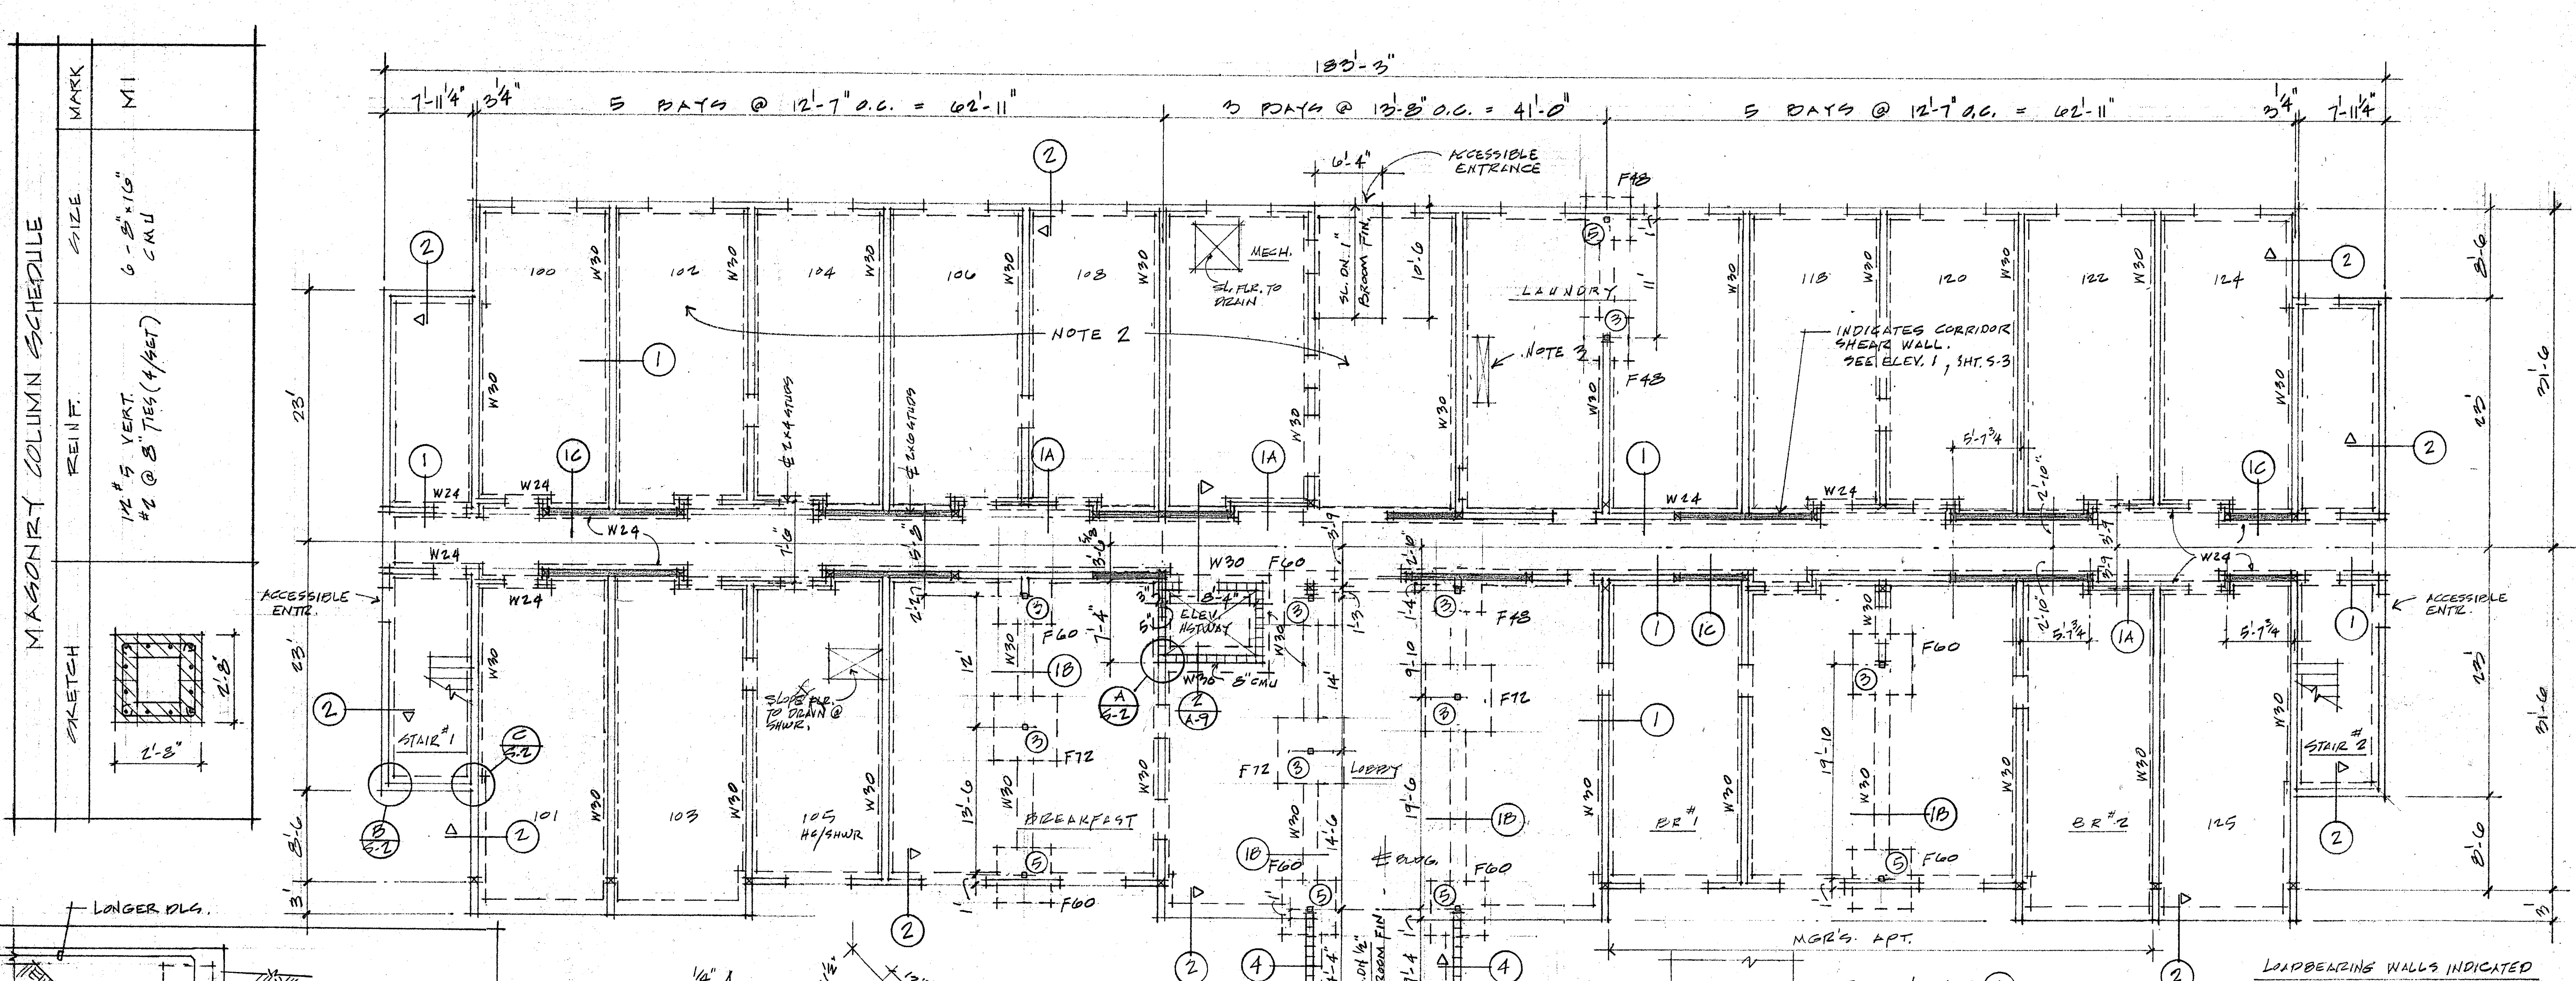

FOOTING SCHEDULE		
MARK	SIZE L x W x D	REINFORCING
FAB	4'-0" x 4'-0" x 12"	5#5 EW, L = 3'-0"
F60	5'-0" x 5'-0" x 12"	6#5 EW, L = 4'-0"
F72	6'-0" x 6'-0" x 12"	6#6 EW, L = 5'-0"
W24	CONT. x 2'-0" x 12"	3#5 T & B CONT., #5 T & B @ 24" O.C.
W30	CONT. x 2'-6" x 12"	

NOTES

- Foundation:

Foundation is designed for a soil bearing pressure of 2000 PSF at bottom of wall strip footings and 2500 PSF at bottom of column footings.

It shall be the Owner's responsibility to employ a licensed soils engineer to provide the following services:

 - Review the Construction Documents and structural shop dwgs. prior to construction to ascertain that the Project is in accordance with the Soils Report guidelines.
 - Observe all site foundation preparation to verify that the Work is being performed as recommended in the Soils Report.
- Floor Slab:

4" conc. reinforced @ mid-depth w/ #3 bars @ 12" O.C.W, installed on vapor barrier per code on termite soil treatment on grade (prepared in accordance w/ Geotechnical Study Report furnished by Owner).
- Provide foundation and drain trench for laundry washer/extractors as recommended by equip. vendor.

FOUNDATION & GROUND FLOOR PLAN
1/8" = 1'-0"

RICHARD MOLENAAR
ARCHITECT

DAYS INN

PEARL, MS

97006

3-25-99

S-1