


5. Unit

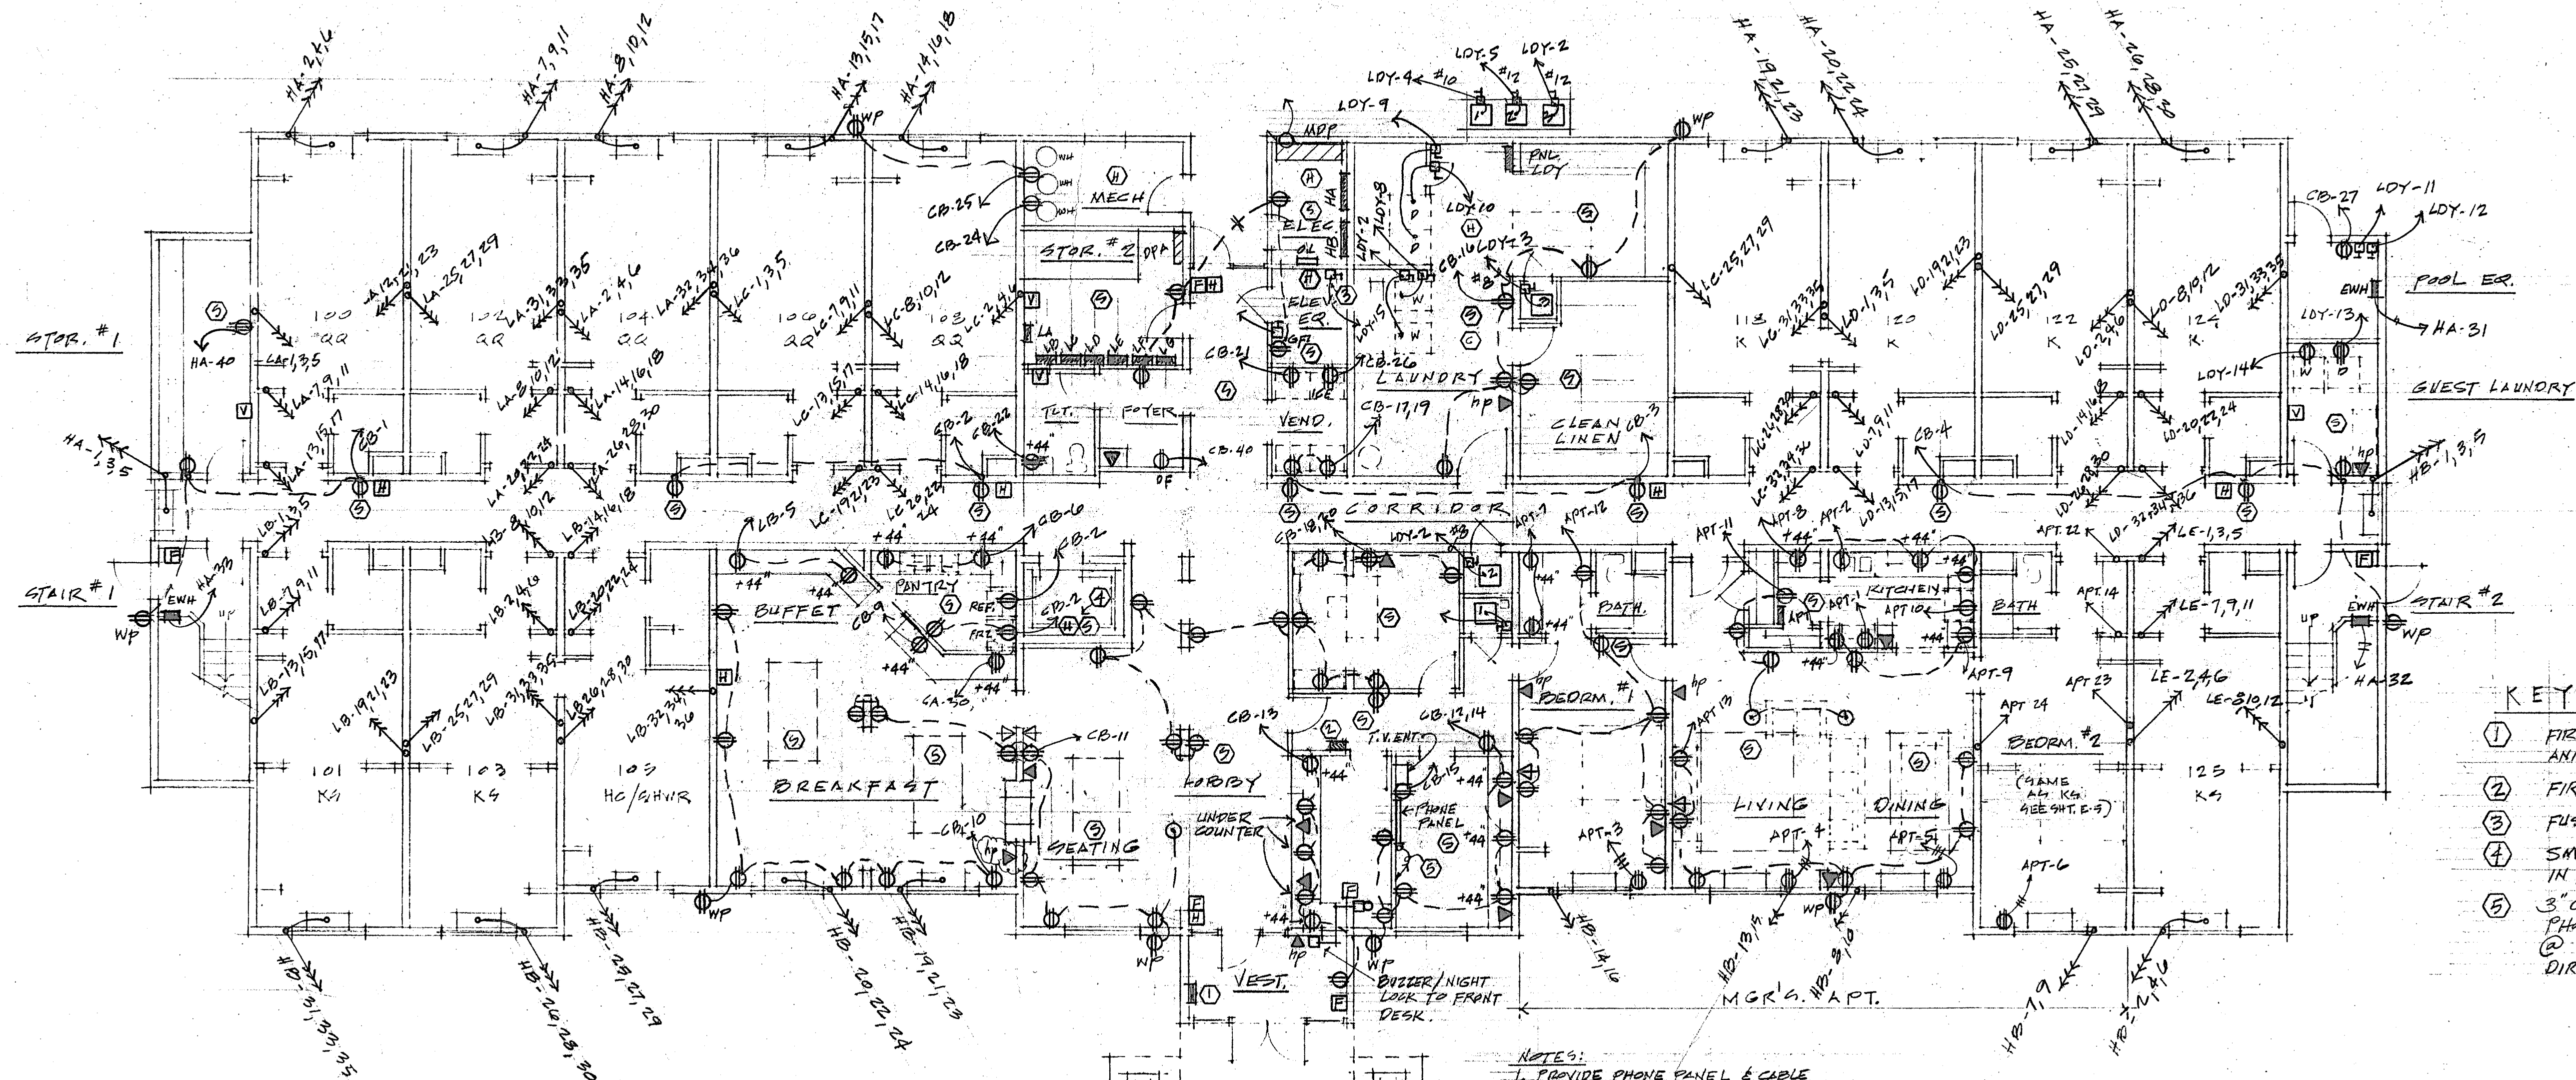

KEYNOTES

- ① FIRE ALARM SYSTEM REMOTE ANNUNCIATOR.
- ② FIRE ALARM CONTROL PANEL.
- ③ FUSED D/S FOR ELEV. CAB FAN & LPS.
- ④ SMOKE & HEAT DETECTORS IN ELEVATOR PIT.
- ⑤ 3" COND. UNDERGRND. TO BE FOR PHONE SERVICE W/ STUB-UP @ POINT & IN MANNER AS DIRECTED BY LOCAL PHONE CO.

NOTES:

1. PROVIDE PHONE PANEL & CABLE TV ENT. ELEC. CONNECTIONS AS REQ'D. BY EQUIP. COORDINATE LOCATIONS W/ OWNER.
2. PROVIDE CONDUIT AS REQ'D. TO PHONE IN ELEVATOR. PHONE SET BY ELEVATOR CONTRACTOR.
3. PROVIDE SECURITY CAMERA SYSTEM FOR AN ALLOWANCE OF \$3,000.00 AS DIRECTED BY OWNER.

LEGEND

- Phone jack
- House phone jack for wall phone (54" AFF)
- TV cable outlet
- Smoke detector
- Heat detector
- Fire alarm pull station
- Fire alarm horn / strobe. See ADA 4.28
- Fire alarm visual alarm. See ADA 4.28.21
- Duplex outlet, general purpose, GFI at wet locations (12" AFF, except 44" where noted at vanities and counters)
- Special purpose outlet (208V)
- GFI duplex outlet

② Carbon monoxide detector

RICHARD MOLENAAR
ARCHITECT

DAYS INN

PEARL, MS

GROUND FLOOR PLAN
POWER

1/8" = 1'-0"

17000

3-25-99

E-2