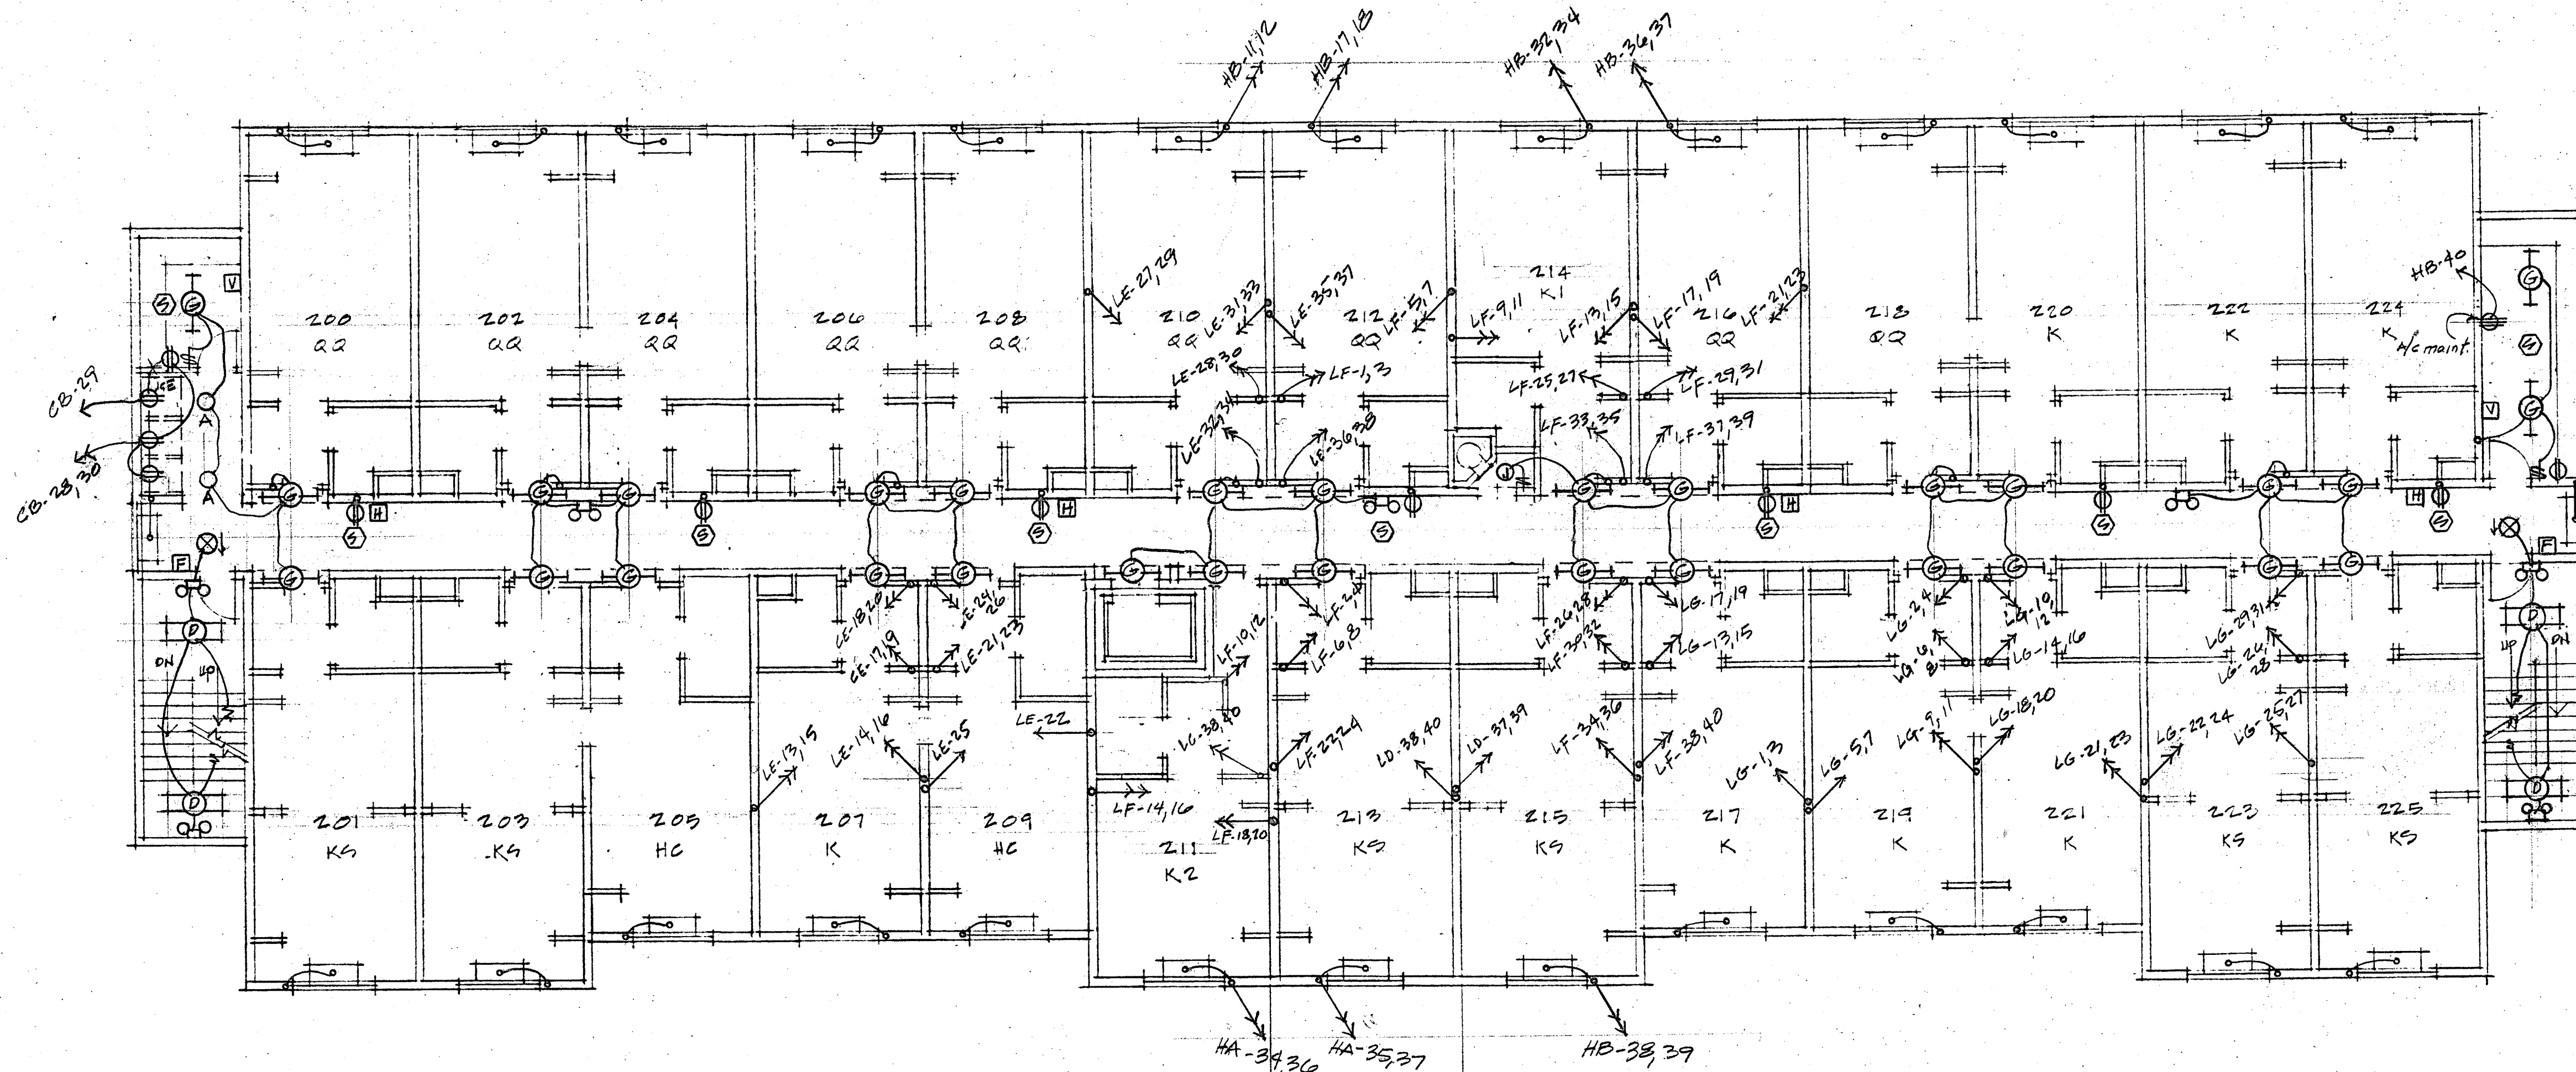


KEYNOTES

- 1 Provide primary service entrance conduits as directed by local power co.
- 2 Pad mounted transformer by local power co. Conc. pad by GC.
- 3 Provide metering equip. as directed by local power co.
- 4 4-#3/0 & 1-#3 ground in 2 - 2" conduit.
- 5 4-#3/0 & 1-#6 ground in 2" conduit.
- 6 4-#3/0 & 1-#1 ground in 3 - 2" conduit.
- 7 4-#2 & 1-#6 ground in 1-1/2" conduit.
- 8 100/3 lighting contactor

ELECTRICAL RISER DIAGRAM

SEE "PANELBOARD SCHEDULE", SHT. E-6

RICHARD MOLENAAR
ARCHITECT

DAYS INN

PEARL, MS

SECOND FLOOR PLAN

1/8" = 1'-0"

97006

3-25-99

E-3